

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: PORTFOLIO

Report Number: P497420

Luminaire Tested: **LDA2B158030R20D010 2LBDL1GPH**

Issue Date: 3/9/2021

This test was performed under the Supervised Manufacturer's Testing Program. The results of this test have not been influenced by sources from within Cooper Lighting Solutions or from external interests.



Test Information

Test Method: LM-79-08
Report Number: P497420
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2011-037-3)
Test Lab: INNOVATION CENTER
Issue Date: 3/9/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LDA2B158030R20D010 2LBDL1GPH
Description: 1500 LUMEN 2IN ADJUSTABLE LED LUMINAIRE WITH 80 CRI LEDS AND 3000K CCT LEDS
Light Source: -
Ballast/Driver: -

Luminaire Equipment: Sample No. Condition Description

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1350.6 lumens
Efficiency: N/A
Efficacy: 95.8 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.34
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct

Input Watts (W): 14.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P497420

CATALOG NUMBER: LDA2B158030R20D010 2LBDL1GPH

Luminous Intensity Polar Plot

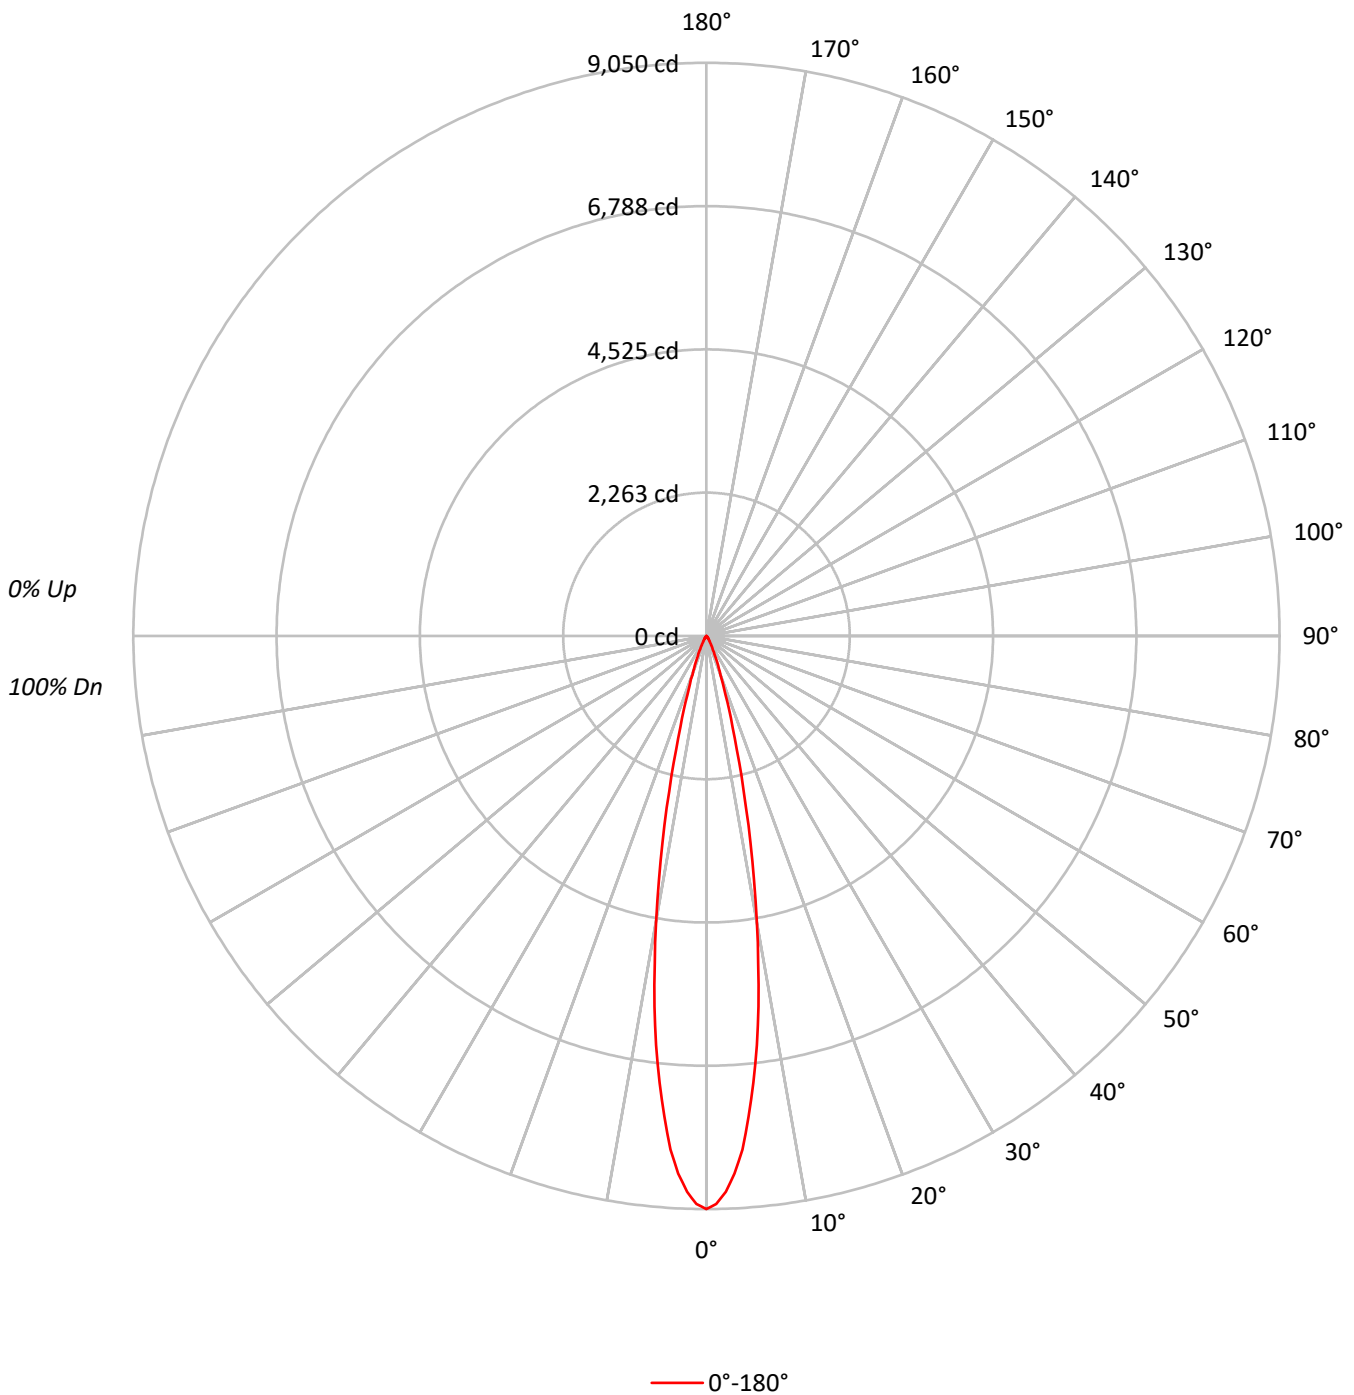



TEST NUMBER: P497420

CATALOG NUMBER: LDA2B158030R20D010 2LBDL1GPH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	115	113	112	110	113	111	110	108	107	106	105	104	103	102	100	100	99	97
2	112	109	106	104	110	107	105	102	104	102	100	101	100	98	98	97	96	95
3	109	105	101	99	107	103	100	98	101	98	96	99	97	95	97	95	94	92
4	106	101	98	95	104	100	97	94	98	95	93	96	94	92	95	93	91	90
5	103	98	94	92	102	97	94	91	96	93	90	94	92	90	93	91	89	88
6	101	95	91	89	100	95	91	88	93	90	88	92	89	87	91	89	87	86
7	98	93	89	86	97	92	89	86	91	88	86	90	87	85	89	87	85	84
8	96	90	87	84	95	90	86	84	89	86	84	88	85	83	87	85	83	82
9	94	88	85	82	93	88	84	82	87	84	82	86	84	82	86	83	81	81
10	92	86	83	80	91	86	83	80	85	82	80	85	82	80	84	82	80	79

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	4465023
5°	3774025
10°	2299515
15°	946040
20°	340636
25°	136581
30°	62096
35°	29211
40°	15393
45°	8303
50°	4835
55°	2408
60°	1381
65°	817
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P497420

CATALOG NUMBER: LDA2B158030R20D010 2LBDL1GPH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	628.6	46.5
10°-20°	543.7	40.3
20°-30°	131.1	9.7
30°-40°	33.6	2.5
40°-50°	10.1	0.7
50°-60°	2.9	0.2
60°-70°	0.7	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1303.4	96.5
0°-40°	1337.0	99.0
0°-60°	1349.9	99.9
0°-90°	1350.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1350.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	9050	
5°	7620	629
15°	1852	544
25°	251	131
35°	48	34
45°	12	10
55°	3	3
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P497420

CATALOG NUMBER: LDA2B158030R20D010 2LBDL1GPH

CANDELA DISTRIBUTION (FULL):

0°	
0°	9050.2
1°	8971.5
2°	8783.8
3°	8498.4
4°	8130.8
5°	7620.5
6°	7093.3
7°	6511.2
8°	5906.7
9°	5228.4
10°	4590.1
11°	3923.1
12°	3338.2
13°	2785.0
14°	2277.5
15°	1852.2
16°	1500.8
17°	1211.9
18°	977.8
19°	804.2
20°	648.8
22.5°	400.0
25°	250.9
27.5°	163.1
30°	109.0
32.5°	71.7
35°	48.5
37.5°	33.7
40°	23.9
42.5°	16.9
45°	11.9
47.5°	9.1
50°	6.3
52.5°	4.2
55°	2.8
57.5°	2.1
60°	1.4
62.5°	0.7
65°	0.7
67.5°	0.7
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0



TEST NUMBER: P497420

CATALOG NUMBER: LDA2B158030R20D010 2LBDL1GPH

CANDELA DISTRIBUTION (continued):

	0°
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)