

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: PORTFOLIO

Report Number: P498410

Luminaire Tested: **LDA2B159024R60D010 2LBD1MW**

Issue Date: 3/8/2021

This test was performed under the Supervised Manufacturer's Testing Program. The results of this test have not been influenced by sources from within Cooper Lighting Solutions or from external interests.



Test Information

Test Method: LM-79-08
Report Number: P498410
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2011-037-53)
Test Lab: INNOVATION CENTER
Issue Date: 3/8/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LDA2B159024R60D010 2LBD1MW
Description: 1500 LUMEN 2IN ADJUSTABLE LED LUMINAIRE WITH 90 CRI LEDS AND 2400K CCT LEDS
Light Source: -
Ballast/Driver: -

Luminaire Equipment: Sample No. Condition Description


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 995.4 lumens
Efficiency: N/A
Efficacy: 70.6 lumens/watt
Spacing Criteria (0/90/45): 0.92 / 0.92 / 0.87
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct

Input Watts (W): 14.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P498410
CATALOG NUMBER: LDA2B159024R60D010 2LBD1MW

Luminous Intensity Polar Plot

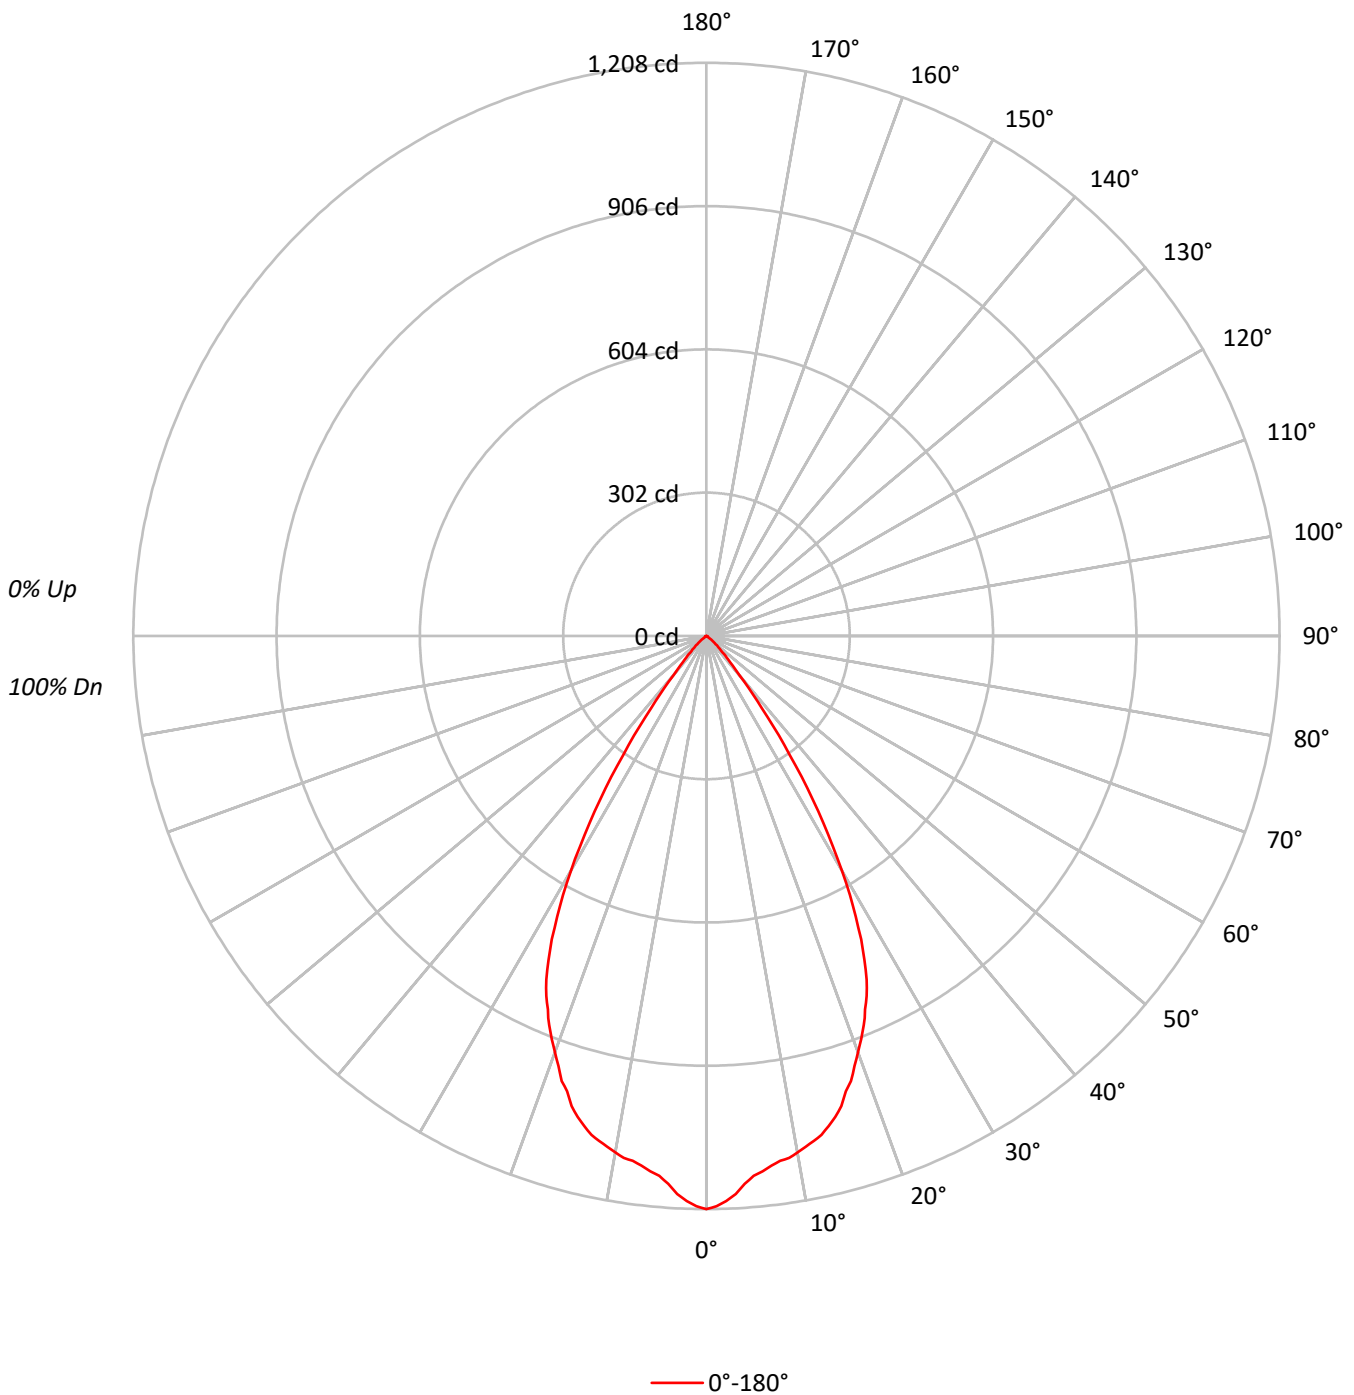



TEST NUMBER: P498410

CATALOG NUMBER: LDA2B159024R60D010 2LBD1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	114	111	109	106	111	109	107	105	105	103	102		101	100	99		98	97	96	94
2	108	104	100	96	106	102	98	95	99	96	93		96	93	91		93	91	89	88
3	103	97	92	88	101	96	91	88	93	89	86		91	87	85		88	86	84	82
4	98	91	86	81	96	90	85	81	88	83	80		86	82	79		84	81	78	77
5	93	85	80	75	92	84	79	75	83	78	74		81	77	74		79	76	73	72
6	89	80	74	70	87	79	74	70	78	73	70		77	72	69		75	72	69	67
7	85	76	70	66	83	75	69	66	74	69	65		73	68	65		71	67	64	63
8	81	71	66	62	79	71	65	61	70	65	61		69	64	61		68	64	61	59
9	77	68	62	58	76	67	62	58	66	61	58		65	61	57		64	60	57	56
10	73	64	58	55	72	64	58	54	63	58	54		62	57	54		61	57	54	53

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	595981
5°	565769
10°	553875
15°	536100
20°	490163
25°	435165
30°	325575
35°	183757
40°	69170
45°	30979
50°	15120
55°	3011
60°	987
65°	584
70°	721
75°	0
80°	0
85°	0



TEST NUMBER: P498410

CATALOG NUMBER: LDA2B159024R60D010 2LBD1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	108.2	10.9
10°-20°	291.5	29.3
20°-30°	356.2	35.8
30°-40°	194.3	19.5
40°-50°	38.9	3.9
50°-60°	5.6	0.6
60°-70°	0.7	0.1
70°-80°	0.2	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	755.9	75.9
0°-40°	950.1	95.4
0°-60°	994.6	99.9
0°-90°	995.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	995.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1208	
5°	1142	108
15°	1050	292
25°	799	356
35°	305	194
45°	44	39
55°	4	6
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P498410

CATALOG NUMBER: LDA2B159024R60D010 2LBD1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	1208.0
1°	1202.4
2°	1191.8
3°	1177.7
4°	1157.5
5°	1142.4
6°	1134.3
7°	1124.8
8°	1117.2
9°	1113.7
10°	1105.6
11°	1096.5
12°	1088.4
13°	1078.9
14°	1064.7
15°	1049.6
16°	1030.4
17°	1003.7
18°	986.6
19°	958.8
20°	933.6
21°	910.4
22.5°	871.6
23°	855.4
24°	830.7
25°	799.4
26°	759.6
27°	717.7
28°	669.8
29°	624.4
30°	571.5
32.5°	438.3
35°	305.1
37.5°	191.2
40°	107.4
42.5°	67.1
45°	44.4
47.5°	30.3
50°	19.7
52.5°	10.1
55°	3.5
57.5°	1.5
60°	1.0
62.5°	1.0
65°	0.5



TEST NUMBER: P498410

CATALOG NUMBER: LDA2B159024R60D010 2LBD1MW

CANDELA DISTRIBUTION (continued):

	0°
67.5°	0.5
70°	0.5
72.5°	0.5
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)