

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P315093

Luminaire Tested: **LDA2B15NFL9040D010 PIN1MW**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P315093
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-1811-033-2)
Test Lab: INNOVATION CENTER(G2)
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LDA2B15NFL9040D010 PIN1MW
Description: PORTFOLIO 2IN ADJ 1500 LUMEN LED LUMINAIRE WITH NARROW FLOOD OPTIC
AND 2in Adj PinHole, Black oculus, matte white finish
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1116.9 lumens
Efficiency: N/A
Efficacy: 79.2 lumens/watt
Spacing Criteria (0/90/45): 0.39 / 0.39 / 0.39
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct

Input Watts (W): 14.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P315093
CATALOG NUMBER: LDA2B15NFL9040D010 PIN1MW

Luminous Intensity Polar Plot

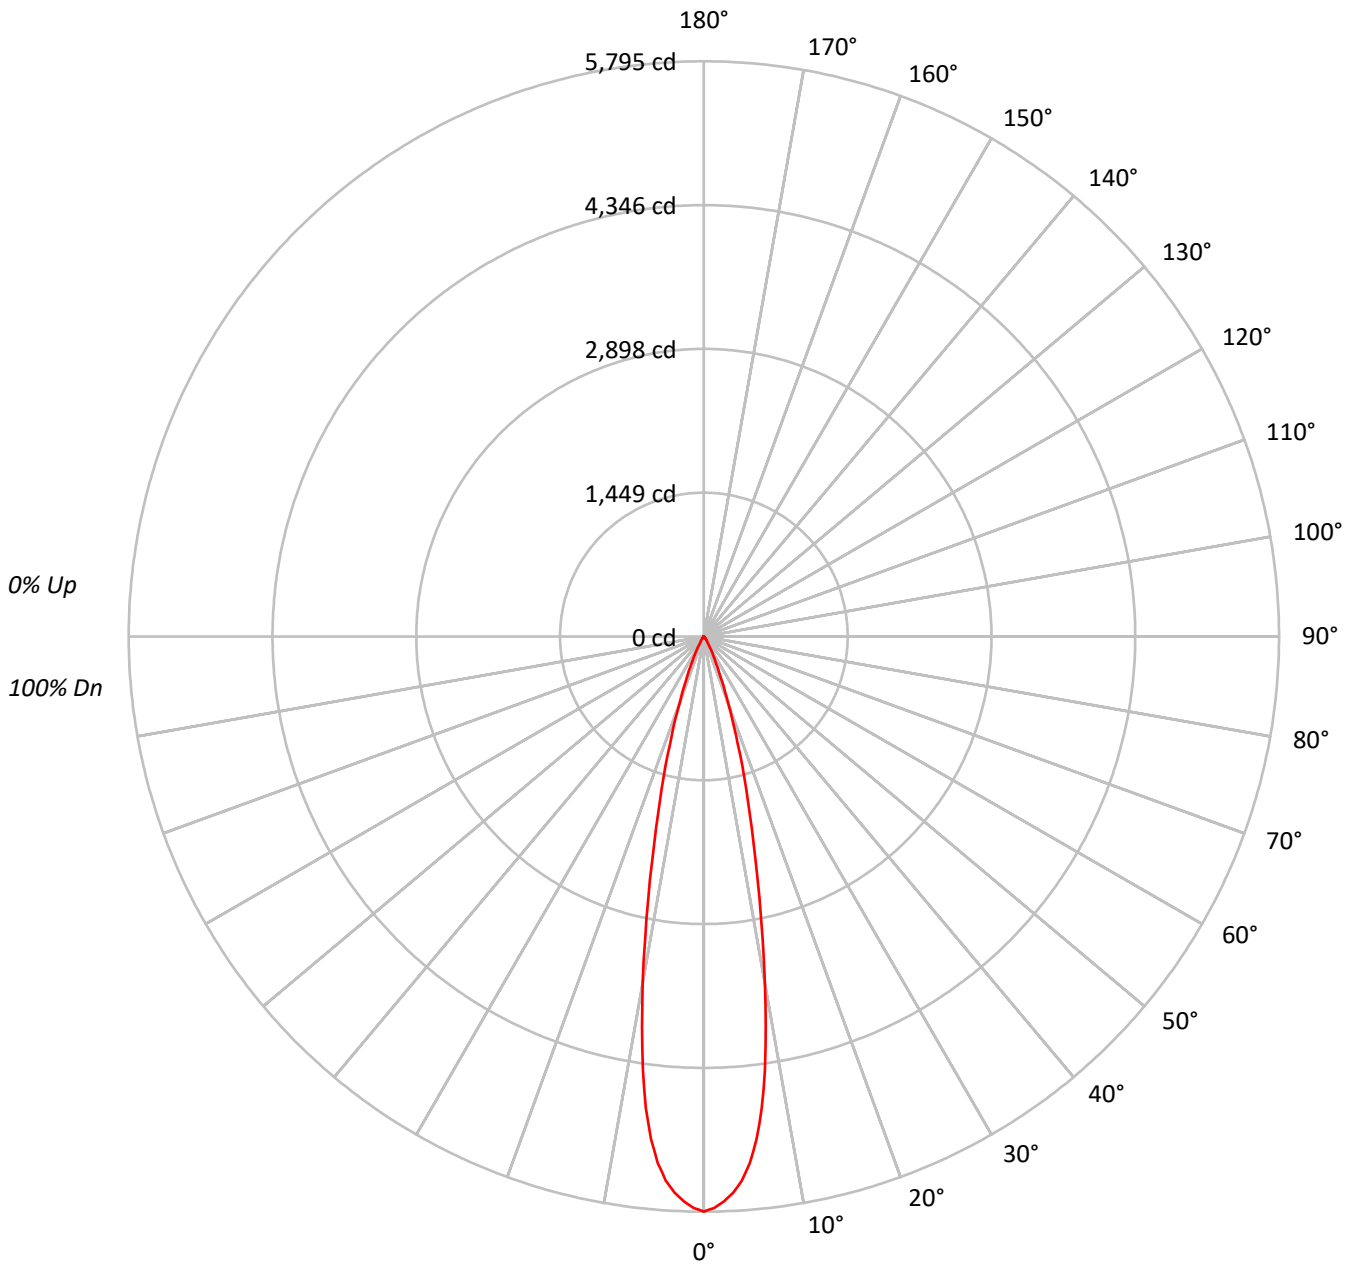



TEST NUMBER: P315093

CATALOG NUMBER: LDA2B15NFL9040D010 PIN1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20					
RC	80				70				50				30				10		0			
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	99	99	97
1	115	113	111	110	113	111	109	108	107	106	105	103	102	102	100	99	99	97	97	97	97	97
2	112	108	105	103	110	107	104	102	103	101	100	101	99	98	98	97	96	96	96	96	96	94
3	108	104	100	98	107	103	99	97	100	98	95	98	96	94	96	94	93	91	91	91	91	91
4	105	100	96	94	104	99	96	93	97	94	92	95	93	91	94	92	90	89	89	89	89	89
5	102	97	93	90	101	96	92	90	94	91	89	93	90	88	92	89	87	86	86	86	86	86
6	100	94	90	87	98	93	89	87	92	89	86	91	88	86	89	87	85	84	84	84	84	84
7	97	91	87	84	96	90	87	84	89	86	84	88	85	83	87	85	83	82	82	82	82	82
8	95	88	85	82	94	88	84	82	87	84	81	86	83	81	85	83	81	80	80	80	80	80
9	92	86	82	80	92	86	82	80	85	82	79	84	81	79	84	81	79	78	78	78	78	78
10	90	84	80	78	90	84	80	78	83	80	77	82	79	77	82	79	77	76	76	76	76	76

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2858884
5°	2636593
10°	1776750
15°	876014
20°	374185
25°	147087
30°	57937
35°	25356
40°	12237
45°	5861
50°	3224
55°	1806
60°	1085
65°	584
70°	721
75°	0
80°	0
85°	0



TEST NUMBER: P315093

CATALOG NUMBER: LDA2B15NFL9040D010 PIN1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	451.0	40.4
10°-20°	485.7	43.5
20°-30°	140.2	12.6
30°-40°	29.6	2.7
40°-50°	7.3	0.7
50°-60°	2.1	0.2
60°-70°	0.7	0.1
70°-80°	0.3	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1076.9	96.4
0°-40°	1106.5	99.1
0°-60°	1115.9	99.9
0°-90°	1116.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1116.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5795	
5°	5324	451
15°	1715	486
25°	270	140
35°	42	30
45°	8	7
55°	2	2
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P315093

CATALOG NUMBER: LDA2B15NFL9040D010 PIN1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	5794.7
1°	5758.4
2°	5696.7
3°	5613.5
4°	5495.5
5°	5323.8
6°	5092.0
7°	4789.7
8°	4417.8
9°	3984.3
10°	3546.6
11°	3104.1
12°	2686.4
13°	2315.6
14°	1989.5
15°	1715.1
17.5°	1133.6
20°	712.7
22.5°	438.3
25°	270.2
27.5°	164.9
30°	101.7
32.5°	64.3
35°	42.1
37.5°	27.9
40°	19.0
42.5°	13.2
45°	8.4
47.5°	5.3
50°	4.2
52.5°	3.2
55°	2.1
57.5°	1.6
60°	1.1
62.5°	1.1
65°	0.5
67.5°	0.5
70°	0.5
72.5°	0.5
75°	0.0
77.5°	0.5
80°	0.0
82.5°	0.0



TEST NUMBER: P315093
CATALOG NUMBER: LDA2B15NFL9040D010 PIN1MW

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)