

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: PORTFOLIO

Report Number: P498834

Luminaire Tested: **LDA2B159030R45D010 2LBDLC1MMS**

Issue Date: 3/9/2021

This test was performed under the Supervised Manufacturer's Testing Program. The results of this test have not been influenced by sources from within Cooper Lighting Solutions or from external interests.



Test Information

Test Method: LM-79-08
Report Number: P498834
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2011-037-42)
Test Lab: INNOVATION CENTER
Issue Date: 3/9/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LDA2B159030R45D010 2LBDLC1MMS
Description: 1500 LUMEN 2IN ADJUSTABLE LED LUMINAIRE WITH 90 CRI LEDS AND 3000K CCT LEDS
Light Source: -
Ballast/Driver: -

Luminaire Equipment: Sample No. Condition Description

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1171.9 lumens
Efficiency: N/A
Efficacy: 83.1 lumens/watt
Spacing Criteria (0/90/45): 0.69 / 0.69 / 0.65
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct

Input Watts (W): 14.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P498834

CATALOG NUMBER: LDA2B159030R45D010 2LBDLC1MMS

Luminous Intensity Polar Plot

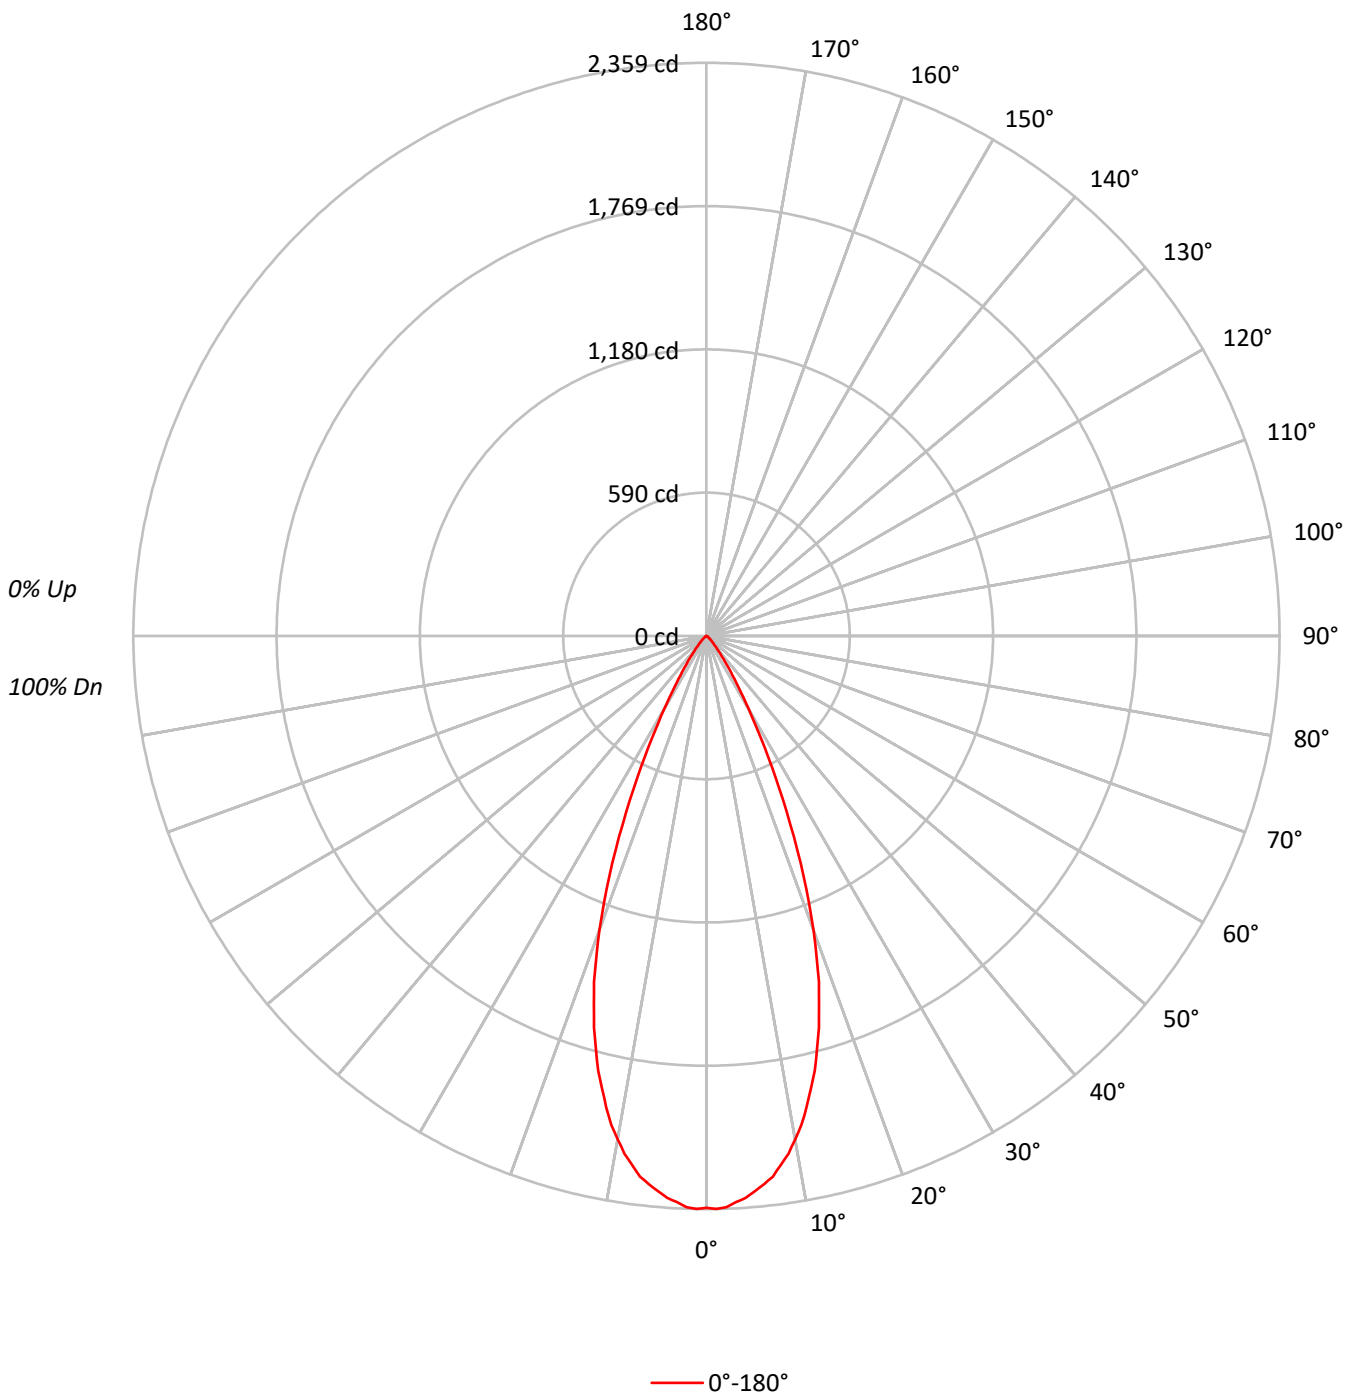



TEST NUMBER: P498834

CATALOG NUMBER: LDA2B159030R45D010 2LBDLC1MMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95
2	110	105	102	99	108	104	101	98	101	98	96	98	96	94	95	93	92	90
3	105	100	96	92	103	98	95	91	96	93	90	94	91	89	91	89	87	86
4	101	95	90	86	99	94	89	86	91	88	85	90	86	84	88	85	83	82
5	97	90	85	81	95	89	84	81	87	83	80	86	82	80	84	81	79	78
6	93	86	81	77	92	85	80	77	84	79	76	82	79	76	81	78	75	74
7	90	82	77	73	88	81	76	73	80	76	73	79	75	72	78	74	72	71
8	86	78	73	70	85	78	73	70	77	72	69	76	72	69	75	71	69	68
9	83	75	70	66	82	74	70	66	74	69	66	73	69	66	72	68	66	65
10	80	72	67	64	79	71	67	64	71	66	63	70	66	63	69	66	63	62

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1161522
5°	1135897
10°	1053896
15°	898794
20°	676652
25°	407947
30°	196712
35°	89198
40°	41025
45°	21141
50°	11206
55°	4215
60°	1184
65°	700
70°	865
75°	0
80°	0
85°	0



TEST NUMBER: P498834

CATALOG NUMBER: LDA2B159030R45D010 2LBDLC1MMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	213.3	18.2
10°-20°	480.5	41.0
20°-30°	343.3	29.3
30°-40°	102.9	8.8
40°-50°	25.5	2.2
50°-60°	5.3	0.5
60°-70°	0.8	0.1
70°-80°	0.2	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1037.1	88.5
0°-40°	1140.0	97.3
0°-60°	1170.9	99.9
0°-90°	1171.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1171.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2354	
5°	2294	213
15°	1760	481
25°	749	343
35°	148	103
45°	30	26
55°	5	5
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P498834

CATALOG NUMBER: LDA2B159030R45D010 2LBDLC1MMS

CANDELA DISTRIBUTION (FULL):

0°	
0°	2354.3
1°	2358.6
2°	2353.1
3°	2333.1
4°	2318.5
5°	2293.6
6°	2268.8
7°	2242.1
8°	2198.4
9°	2157.1
10°	2103.7
11°	2050.3
12°	1983.0
13°	1910.8
14°	1843.4
15°	1759.7
16°	1677.8
17°	1584.9
18°	1496.9
19°	1388.9
20°	1288.8
21°	1177.8
22.5°	1012.1
23°	956.3
24°	847.7
25°	749.4
26°	651.1
27°	561.3
28°	477.5
29°	409.0
30°	345.3
32.5°	226.9
35°	148.1
37.5°	97.1
40°	63.7
42.5°	43.1
45°	30.3
47.5°	21.8
50°	14.6
52.5°	9.1
55°	4.9
57.5°	2.4
60°	1.2
62.5°	1.2
65°	0.6



TEST NUMBER: P498834

CATALOG NUMBER: LDA2B159030R45D010 2LBDLC1MMS

CANDELA DISTRIBUTION (continued):

	0°
67.5°	0.6
70°	0.6
72.5°	0.6
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)