

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: PORTFOLIO

Report Number: P499286

Luminaire Tested: **LDA2B159040R60D010 2LBDL1WHH**

Issue Date: 3/9/2021

This test was performed under the Supervised Manufacturer's Testing Program. The results of this test have not been influenced by sources from within Cooper Lighting Solutions or from external interests.



Test Information

Test Method: LM-79-08
Report Number: P499286
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2011-037-55)
Test Lab: INNOVATION CENTER
Issue Date: 3/9/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LDA2B159040R60D010 2LBDL1WHH
Description: 1500 LUMEN 2IN ADJUSTABLE LED LUMINAIRE WITH 90 CRI LEDS AND 4000K CCT LEDS
Light Source: -
Ballast/Driver: -

Luminaire Equipment: Sample No. Condition Description

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1094.4 lumens
Efficiency: N/A
Efficacy: 77.6 lumens/watt
Spacing Criteria (0/90/45): 0.9 / 0.9 / 0.86
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct

Input Watts (W): 14.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P499286

CATALOG NUMBER: LDA2B159040R60D010 2LBDL1WHH

Luminous Intensity Polar Plot

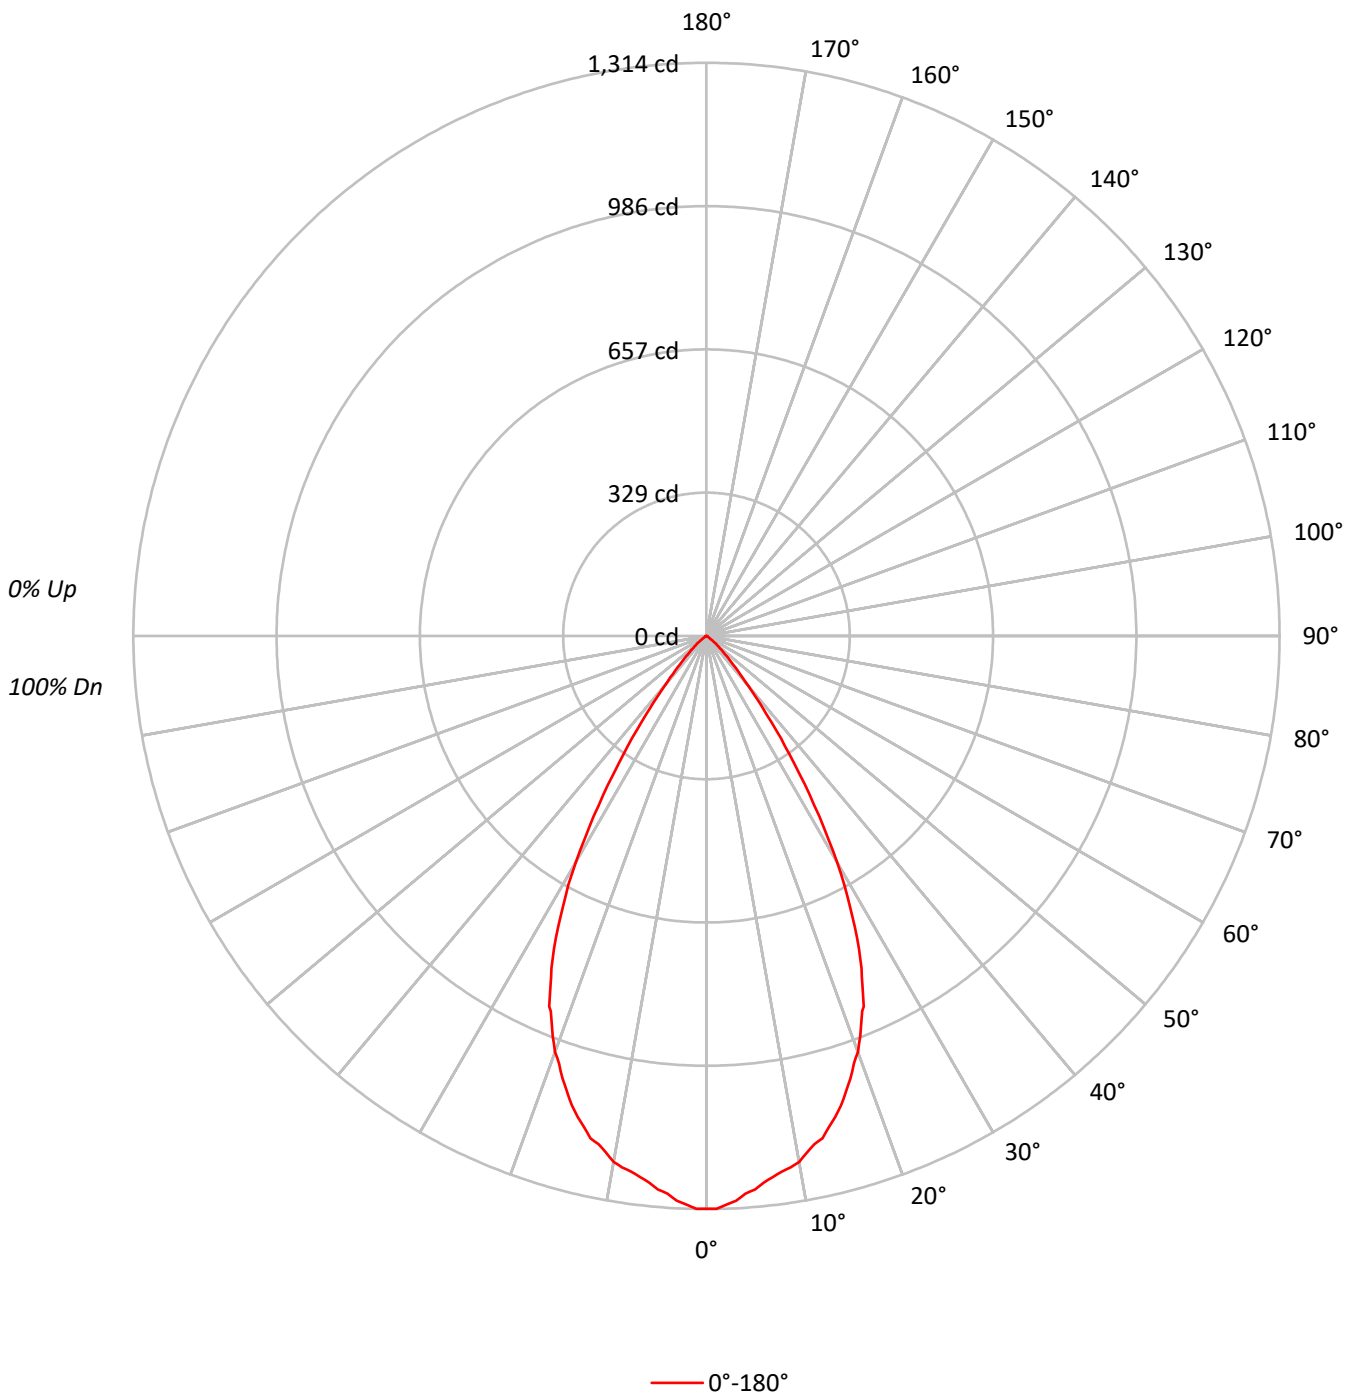



TEST NUMBER: P499286

CATALOG NUMBER: LDA2B159040R60D010 2LBDL1WHH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	111	109	106	111	109	107	105	105	103	101	101	100	98	98	97	96	94
2	108	103	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	85	83	82
4	98	90	85	81	96	89	84	81	87	83	80	85	82	79	83	80	78	76
5	93	85	79	75	91	84	79	75	82	78	74	81	77	73	79	76	73	71
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67
7	84	75	69	65	83	74	69	65	73	68	65	72	68	64	71	67	64	63
8	80	71	65	61	79	70	65	61	69	64	61	68	64	60	67	63	60	59
9	76	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55
10	73	63	58	54	72	63	58	54	62	57	54	61	57	54	61	57	54	52

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	647735
5°	630845
10°	613441
15°	583090
20°	532743
25°	457484
30°	340387
35°	199838
40°	95253
45°	44445
50°	22182
55°	7741
60°	1776
65°	1401
70°	865
75°	1144
80°	0
85°	0



TEST NUMBER: P499286

CATALOG NUMBER: LDA2B159040R60D010 2LBDL1WHH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	119.9	11.0
10°-20°	317.7	29.0
20°-30°	377.2	34.5
30°-40°	212.9	19.5
40°-50°	55.4	5.1
50°-60°	10.1	0.9
60°-70°	1.0	0.1
70°-80°	0.4	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
<hr/>		
0°-30°	814.7	74.4
0°-40°	1027.5	93.9
0°-60°	1093.0	99.9
0°-90°	1094.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1094.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1313	
5°	1274	120
15°	1142	318
25°	840	377
35°	332	213
45°	64	55
55°	9	10
65°	1	1
75°	1	0
85°	0	0
90°	0	



TEST NUMBER: P499286

CATALOG NUMBER: LDA2B159040R60D010 2LBDL1WHH

CANDELA DISTRIBUTION (FULL):

	0°
0°	1312.9
1°	1313.5
2°	1304.5
3°	1296.7
4°	1281.6
5°	1273.8
6°	1260.0
7°	1249.8
8°	1240.2
9°	1233.5
10°	1224.5
11°	1207.1
12°	1190.9
13°	1181.9
14°	1160.8
15°	1141.6
16°	1119.3
17°	1092.9
18°	1067.6
19°	1037.6
20°	1014.7
21°	983.5
22.5°	931.8
23°	922.8
24°	878.9
25°	840.4
26°	797.7
27°	748.4
28°	699.7
29°	652.2
30°	597.5
32.5°	459.9
35°	331.8
37.5°	226.6
40°	147.9
42.5°	96.8
45°	63.7
47.5°	43.3
50°	28.9
52.5°	18.0
55°	9.0
57.5°	3.6
60°	1.8
62.5°	1.2
65°	1.2



TEST NUMBER: P499286

CATALOG NUMBER: LDA2B159040R60D010 2LBDL1WHH

CANDELA DISTRIBUTION (continued):

	0°
67.5°	0.6
70°	0.6
72.5°	0.6
75°	0.6
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)