

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: PORTFOLIO

Report Number: P499457

Luminaire Tested: **LDA2B159050R35D010 2LBDLC1MMS**

Issue Date: 3/9/2021

This test was performed under the Supervised Manufacturer's Testing Program. The results of this test have not been influenced by sources from within Cooper Lighting Solutions or from external interests.



Test Information

Test Method: LM-79-08
Report Number: P499457
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2011-037-29)
Test Lab: INNOVATION CENTER
Issue Date: 3/9/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LDA2B159050R35D010 2LBDLC1MMS
Description: 1500 LUMEN 2IN ADJUSTABLE LED LUMINAIRE WITH 90 CRI LEDS AND 5000K CCT LEDS
Light Source: -
Ballast/Driver: -

Luminaire Equipment: Sample No. Condition Description

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1260.1 lumens
Efficiency: N/A
Efficacy: 89.4 lumens/watt
Spacing Criteria (0/90/45): 0.54 / 0.54 / 0.51
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct

Input Watts (W): 14.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P499457

CATALOG NUMBER: LDA2B159050R35D010 2LBDLC1MMS

Luminous Intensity Polar Plot

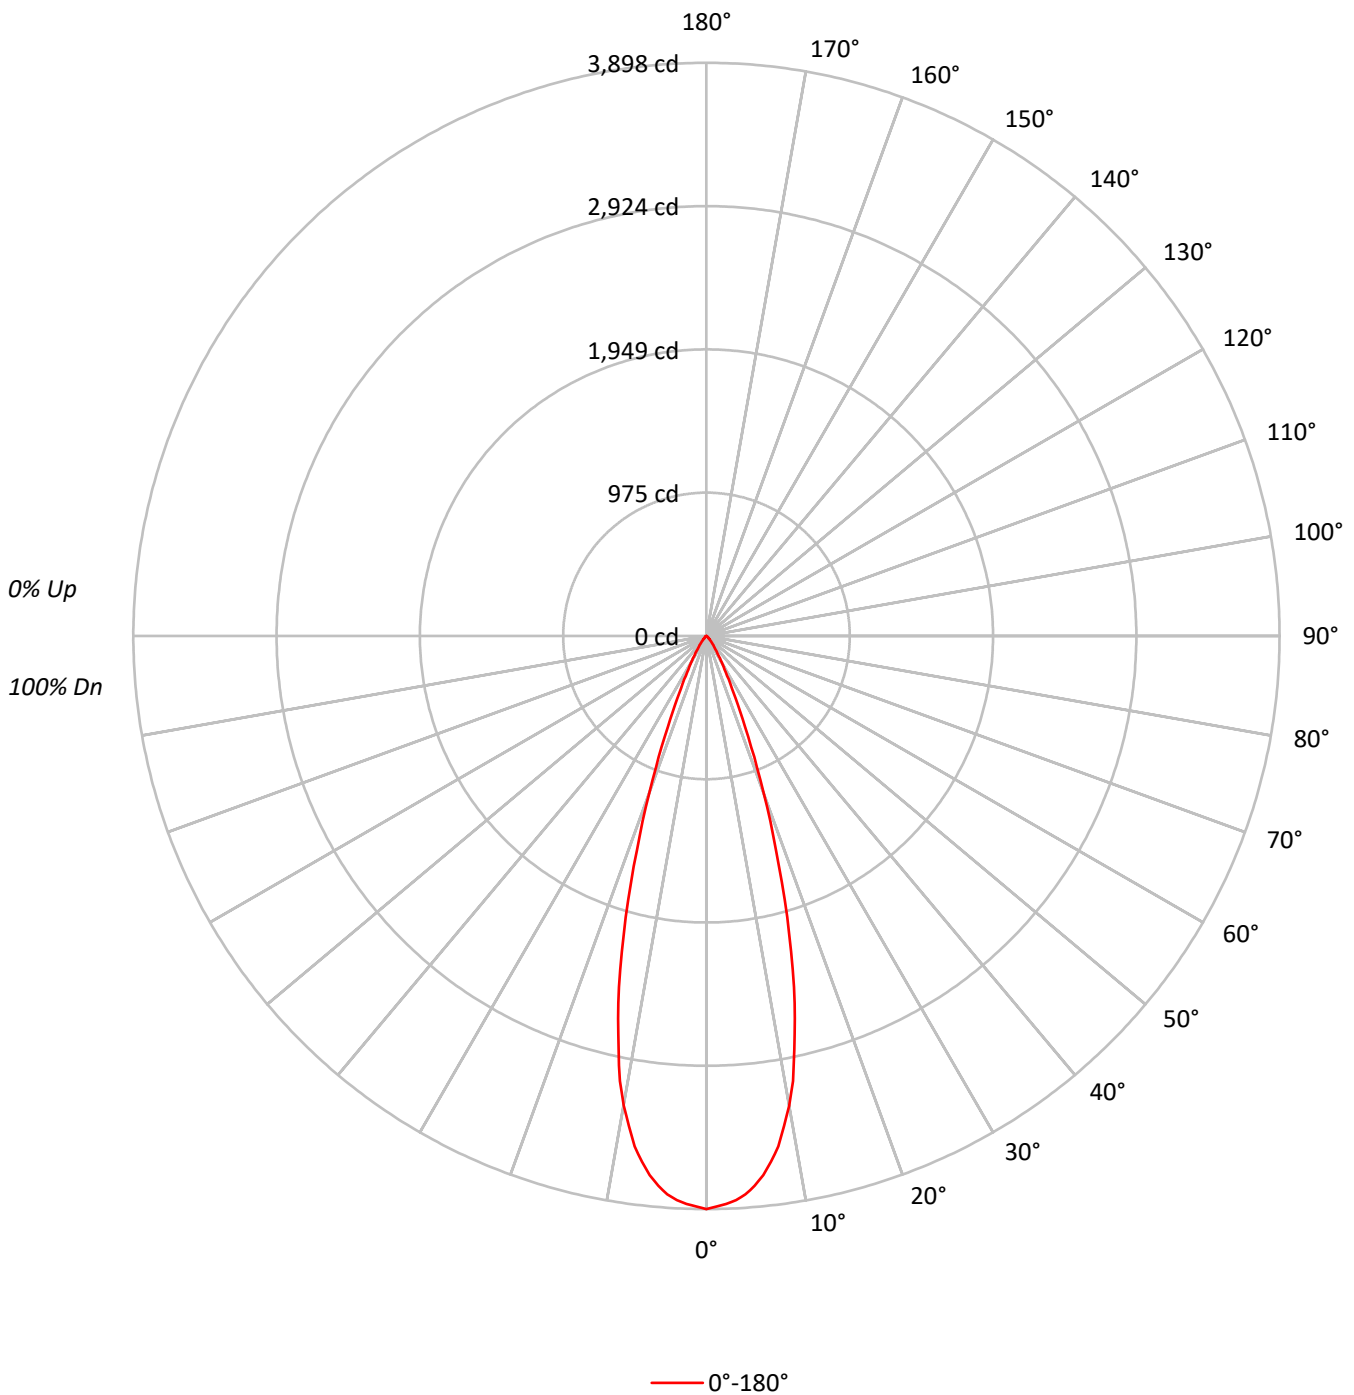



TEST NUMBER: P499457

CATALOG NUMBER: LDA2B159050R35D010 2LBDLC1MMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89
4	103	97	93	90	102	96	92	89	94	91	88	92	90	87	91	88	87	85
5	100	93	89	86	98	93	88	85	91	87	85	89	86	84	88	85	83	82
6	96	90	85	82	95	89	85	82	88	84	81	86	83	81	85	82	80	79
7	93	86	82	79	92	86	82	79	85	81	78	84	80	78	83	80	77	76
8	90	83	79	76	89	83	79	76	82	78	75	81	78	75	80	77	75	74
9	88	81	76	73	87	80	76	73	79	76	73	79	75	73	78	75	72	71
10	85	78	74	71	84	78	73	71	77	73	70	76	73	70	76	72	70	69

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1923174
5°	1859353
10°	1624855
15°	1135943
20°	596481
25°	256287
30°	117184
35°	56795
40°	28853
45°	14722
50°	8059
55°	3441
60°	1283
65°	817
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P499457

CATALOG NUMBER: LDA2B159050R35D010 2LBDLC1MMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	342.2	27.2
10°-20°	593.5	47.1
20°-30°	236.8	18.8
30°-40°	64.6	5.1
40°-50°	17.9	1.4
50°-60°	4.2	0.3
60°-70°	0.8	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1172.6	93.1
0°-40°	1237.1	98.2
0°-60°	1259.3	99.9
0°-90°	1260.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1260.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3898	
5°	3754	342
15°	2224	593
25°	471	237
35°	94	65
45°	21	18
55°	4	4
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P499457

CATALOG NUMBER: LDA2B159050R35D010 2LBDLC1MMS

CANDELA DISTRIBUTION (FULL):

0°	
0°	3898.1
1°	3881.6
2°	3865.8
3°	3842.1
4°	3806.5
5°	3754.4
6°	3686.5
7°	3602.1
8°	3505.8
9°	3372.6
10°	3243.4
11°	3083.1
12°	2878.1
13°	2671.7
14°	2461.4
15°	2224.0
16°	1990.6
17°	1750.6
18°	1535.0
19°	1331.2
20°	1136.1
21°	956.7
22.5°	741.8
23°	672.5
24°	564.4
25°	470.8
26°	396.3
27°	331.0
28°	280.2
29°	238.7
30°	205.7
32.5°	137.8
35°	94.3
37.5°	65.9
40°	44.8
42.5°	30.3
45°	21.1
47.5°	15.2
50°	10.5
52.5°	7.3
55°	4.0
57.5°	2.0
60°	1.3
62.5°	1.3
65°	0.7



TEST NUMBER: P499457

CATALOG NUMBER: LDA2B159050R35D010 2LBDLC1MMS

CANDELA DISTRIBUTION (continued):

	0°
67.5°	0.7
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)