

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P278203

Luminaire Tested: **LDA2B208030D010 EU2B20SP158030 2LBAD1LI**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P278203
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-1811-033-1)
Test Lab: INNOVATION CENTER(G2)
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LDA2B208030D010 EU2B20SP158030 2LBAD1LI
Description: PORTFOLIO 2IN ADJ 2000 LUMEN LED LUMINAIRE WITH SPOT OPTIC AND 2in
ADJ spun Refl, Self-Flanged, LI
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2002.8 lumens
Efficiency: N/A
Efficacy: 97.2 lumens/watt
Spacing Criteria (0/90/45): 0.28 / 0.28 / 0.28
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 20.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P278203

CATALOG NUMBER: LDA2B208030D010 EU2B20SP158030 2LBAD1LI

Luminous Intensity Polar Plot

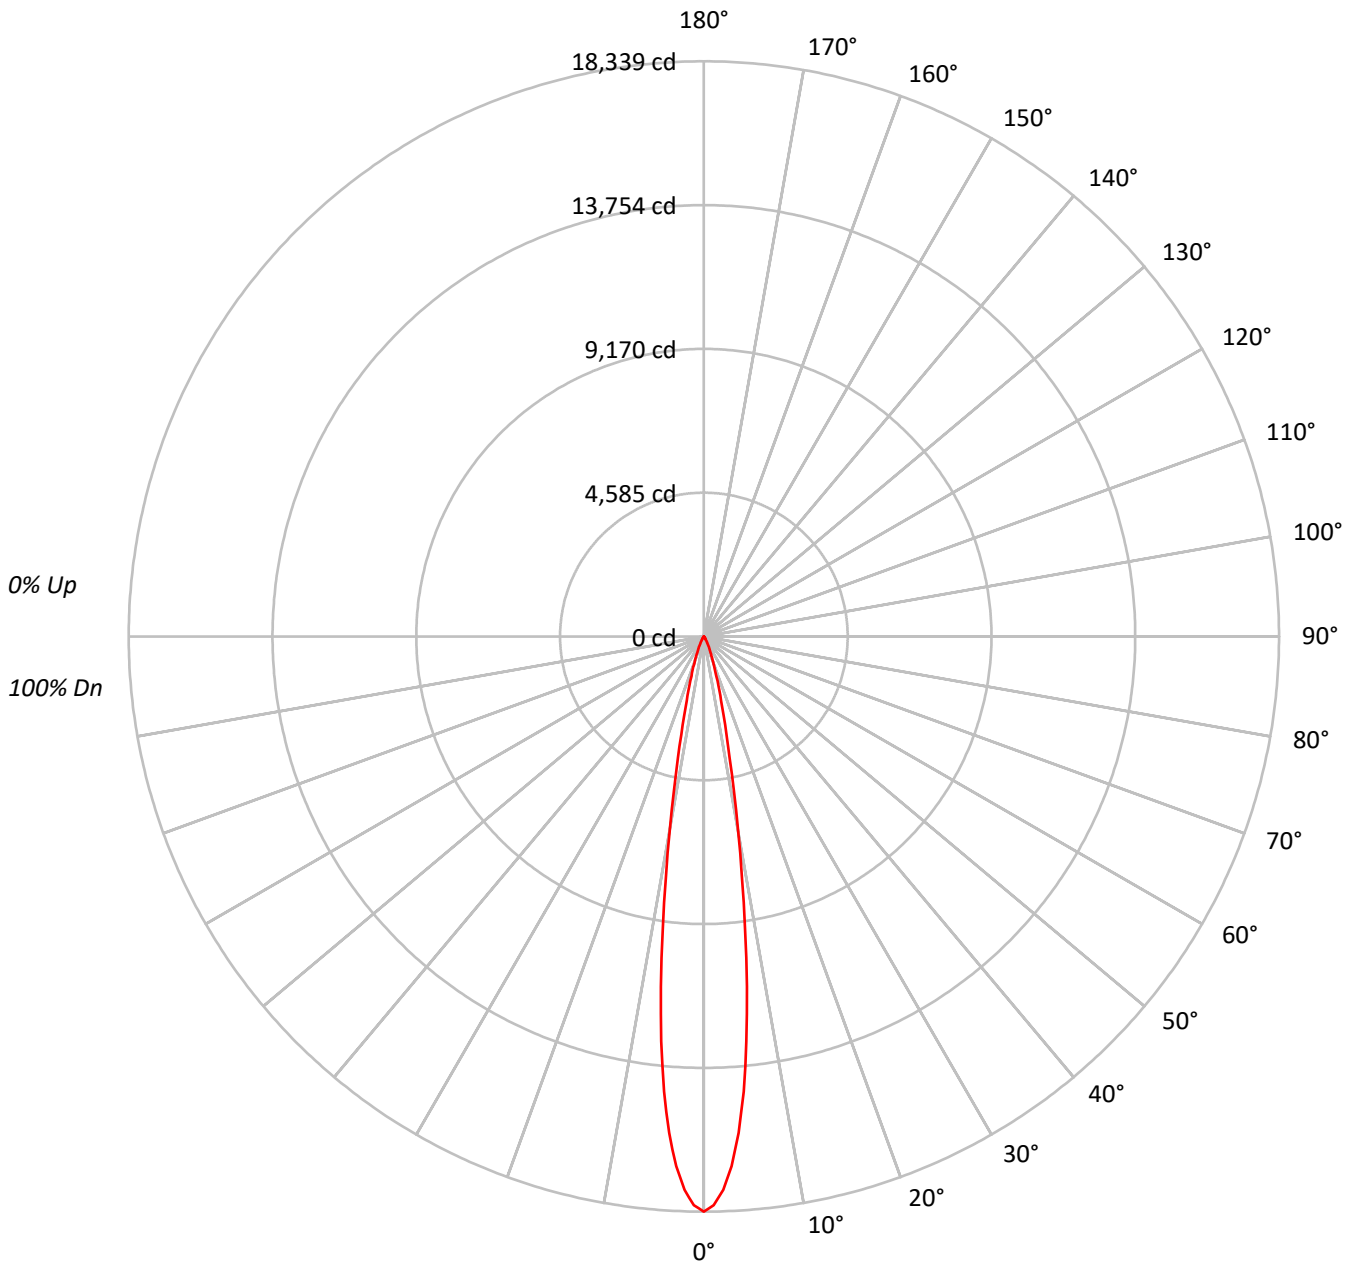



TEST NUMBER: P278203

CATALOG NUMBER: LDA2B208030D010 EU2B20SP158030 2LBAD1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	116	114	112	110	113	112	110	109	108	106	105	104	103	102	101	100	99	98			
2	112	109	107	104	110	108	105	103	105	103	101	102	100	99	99	98	97	96			
3	109	105	102	100	108	104	101	99	102	99	98	100	98	96	97	96	95	93			
4	107	102	99	96	105	101	98	96	99	97	95	98	95	94	96	94	93	92			
5	104	99	96	93	103	99	95	93	97	94	92	96	93	91	94	92	91	90			
6	102	97	93	91	101	96	93	91	95	92	90	94	91	89	93	91	89	88			
7	100	95	91	89	99	94	91	88	93	90	88	92	90	88	91	89	87	86			
8	98	93	89	87	97	92	89	87	91	88	86	90	88	86	90	87	86	85			
9	96	91	87	85	95	90	87	85	90	87	85	89	86	84	88	86	84	83			
10	94	89	86	83	94	89	85	83	88	85	83	87	85	83	87	85	83	82			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	9047762
5°	7213412
10°	3131680
15°	1082006
20°	443646
25°	200381
30°	80610
35°	37522
40°	20416
45°	7605
50°	4528
55°	3441
60°	1973
65°	1167
70°	1442
75°	0
80°	0
85°	0



TEST NUMBER: P278203

CATALOG NUMBER: LDA2B208030D010 EU2B20SP158030 2LBAD1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1100.8	55.0
10°-20°	661.1	33.0
20°-30°	182.0	9.1
30°-40°	43.3	2.2
40°-50°	10.7	0.5
50°-60°	3.5	0.2
60°-70°	1.4	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1943.9	97.1
0°-40°	1987.1	99.2
0°-60°	2001.3	99.9
0°-90°	2002.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2002.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	18339	
5°	14565	###
15°	2118	661
25°	368	182
35°	62	43
45°	11	11
55°	4	4
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P278203

CATALOG NUMBER: LDA2B208030D010 EU2B20SP158030 2LBAD1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	18339.0
1°	18136.2
2°	17650.4
3°	16909.3
4°	15863.5
5°	14565.3
6°	12980.3
7°	11243.8
8°	9419.3
9°	7741.3
10°	6251.2
11°	4989.7
12°	3971.6
13°	3202.8
14°	2591.3
15°	2118.4
17.5°	1314.9
20°	845.0
22.5°	554.1
25°	368.1
27.5°	236.5
30°	141.5
32.5°	89.0
35°	62.3
37.5°	45.5
40°	31.7
42.5°	18.8
45°	10.9
47.5°	7.9
50°	5.9
52.5°	4.9
55°	4.0
57.5°	3.0
60°	2.0
62.5°	2.0
65°	1.0
67.5°	1.0
70°	1.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P278203

CATALOG NUMBER: LDA2B208030D010 EU2B20SP158030 2LBAD1LI

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)