

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P279913

Luminaire Tested: **LDA2B208035D010 EU2B20FL408035 2LBAD1GPH**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P279913
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-1811-033-3)
Test Lab: INNOVATION CENTER(G2)
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LDA2B208035D010 EU2B20FL408035 2LBAD1GPH
Description: PORTFOLIO 2IN ADJ 2000 LUMEN LED LUMINAIRE WITH FLOOD OPTIC AND 2in
ADJ spun Refl, Self-Flanged, GPH
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2147.4 lumens
Efficiency: N/A
Efficacy: 104.2 lumens/watt
Spacing Criteria (0/90/45): 0.61 / 0.61 / 0.55
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 20.6
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P279913

CATALOG NUMBER: LDA2B208035D010 EU2B20FL408035 2LBAD1GPH

Luminous Intensity Polar Plot

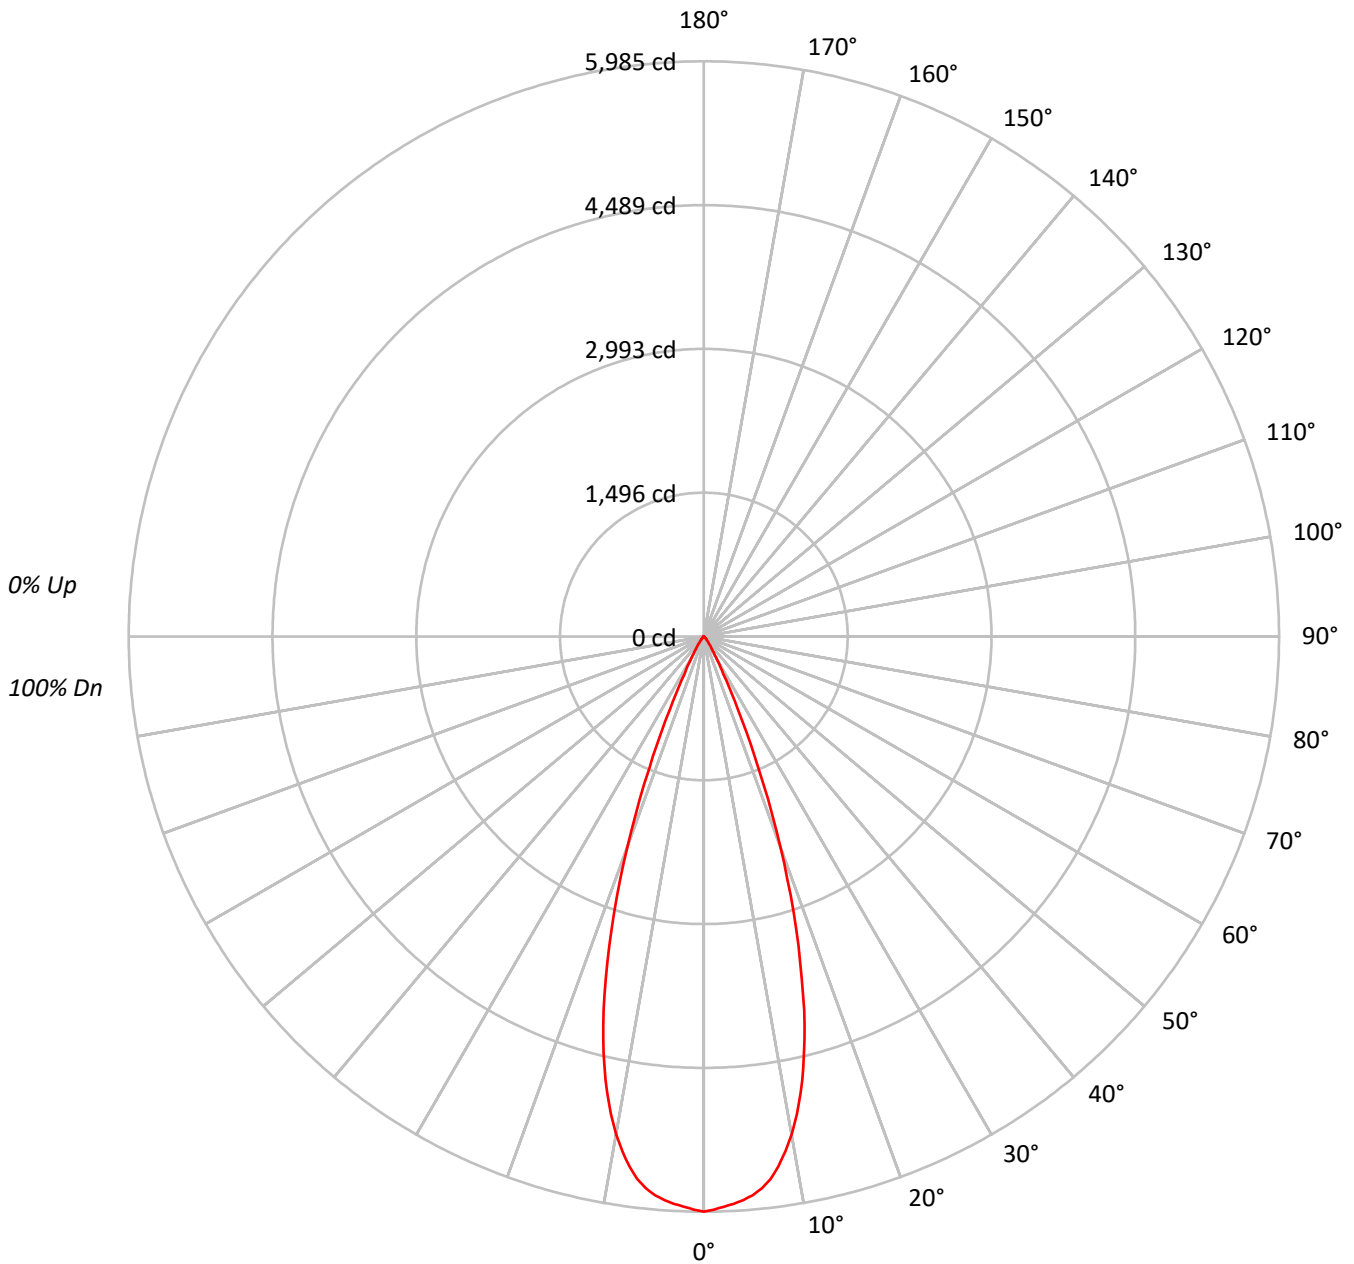



TEST NUMBER: P279913

CATALOG NUMBER: LDA2B208035D010 EU2B20FL408035 2LBAD1GPH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92			
3	107	102	98	95	105	101	97	94	98	95	93	96	94	92	94	92	90	89			
4	103	98	93	90	102	97	93	90	95	91	89	93	90	88	91	89	87	85			
5	100	94	89	86	98	93	89	86	91	88	85	90	87	84	88	86	83	82			
6	97	90	85	82	95	89	85	82	88	84	82	87	83	81	85	83	80	79			
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74			
9	88	81	76	73	87	80	76	73	79	76	73	79	75	73	78	75	73	72			
10	85	78	74	71	84	78	74	71	77	73	71	76	73	70	76	72	70	69			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2952721
5°	2890258
10°	2634315
15°	2057875
20°	1218372
25°	452911
30°	141510
35°	62939
40°	29175
45°	13745
50°	7599
55°	4215
60°	1973
65°	1167
70°	1442
75°	0
80°	0
85°	0



TEST NUMBER: P279913

CATALOG NUMBER: LDA2B208035D010 EU2B20FL408035 2LBAD1GPH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	539.5	25.1
10°-20°	1072.8	50.0
20°-30°	439.4	20.5
30°-40°	72.7	3.4
40°-50°	17.2	0.8
50°-60°	4.6	0.2
60°-70°	1.1	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2051.6	95.5
0°-40°	2124.3	98.9
0°-60°	2146.1	99.9
0°-90°	2147.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2147.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5985	
5°	5836	539
15°	4029	1073
25°	832	439
35°	104	73
45°	20	17
55°	5	5
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P279913

CATALOG NUMBER: LDA2B208035D010 EU2B20FL408035 2LBAD1GPH

CANDELA DISTRIBUTION (FULL):

	0°
0°	5984.9
1°	5964.2
2°	5936.6
3°	5912.0
4°	5879.4
5°	5836.0
6°	5772.0
7°	5688.2
8°	5568.9
9°	5424.0
10°	5258.4
11°	5066.1
12°	4849.2
13°	4601.8
14°	4326.8
15°	4029.0
17.5°	3195.0
20°	2320.6
22.5°	1485.6
25°	832.0
27.5°	438.7
30°	248.4
32.5°	157.7
35°	104.5
37.5°	69.0
40°	45.3
42.5°	29.6
45°	19.7
47.5°	13.8
50°	9.9
52.5°	6.9
55°	4.9
57.5°	3.0
60°	2.0
62.5°	1.0
65°	1.0
67.5°	1.0
70°	1.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P279913

CATALOG NUMBER: LDA2B208035D010 EU2B20FL408035 2LBAD1GPH

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)