

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P278288

Luminaire Tested: **LDA2B209727D010 EU2B20SP159727 2LBAD1WHH**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P278288
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-1811-033-1)
Test Lab: INNOVATION CENTER(G2)
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LDA2B209727D010 EU2B20SP159727 2LBAD1WHH
Description: PORTFOLIO 2IN ADJ 2000 LUMEN LED LUMINAIRE WITH SPOT OPTIC AND 2in
ADJ spun Refl, Self-Flanged, WHH
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1393.2 lumens
Efficiency: N/A
Efficacy: 67.6 lumens/watt
Spacing Criteria (0/90/45): 0.28 / 0.28 / 0.28
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 20.6
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P278288

CATALOG NUMBER: LDA2B209727D010 EU2B20SP159727 2LBAD1WHH

Luminous Intensity Polar Plot

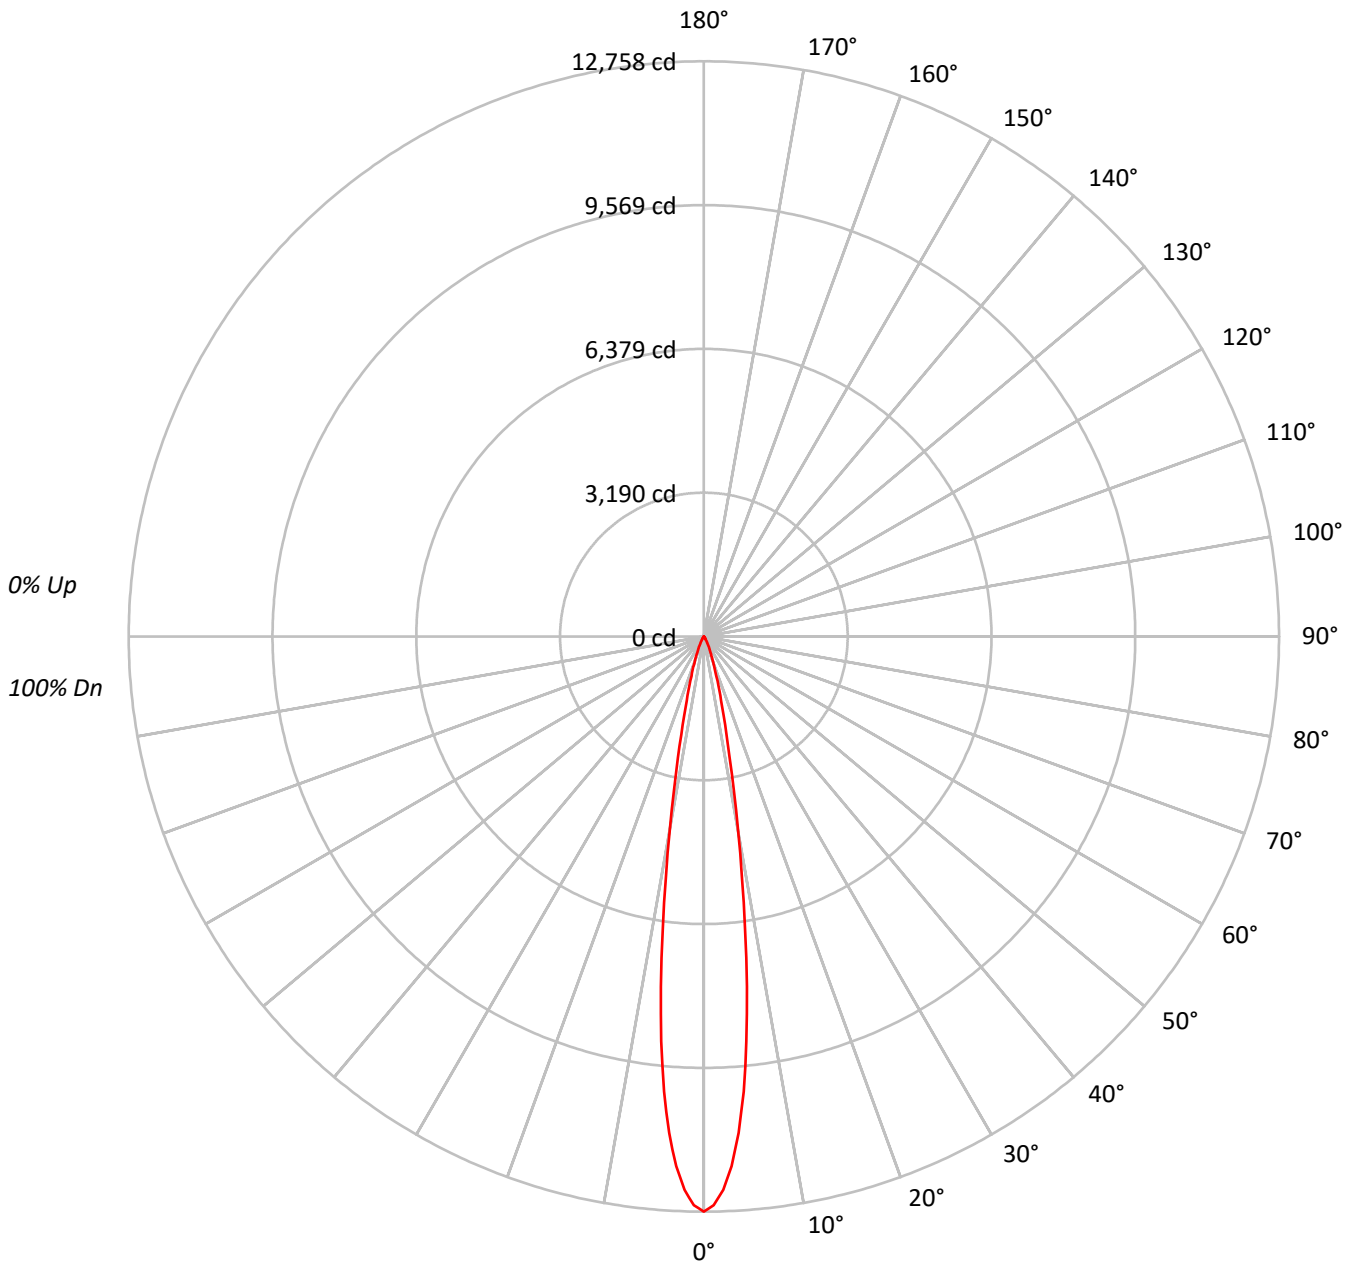



TEST NUMBER: P278288

CATALOG NUMBER: LDA2B209727D010 EU2B20SP159727 2LBAD1WHH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	116	114	112	110	113	112	110	109	108	106	105	104	103	102	101	100	99	98			
2	112	109	107	104	110	108	105	103	105	103	101	102	100	99	99	98	97	96			
3	109	105	102	100	108	104	101	99	102	99	98	100	98	96	97	96	95	93			
4	107	102	99	96	105	101	98	96	99	97	95	98	95	94	96	94	93	92			
5	104	99	96	93	103	99	95	93	97	94	92	96	93	91	94	92	91	90			
6	102	97	93	91	101	96	93	91	95	92	90	94	91	89	93	91	89	88			
7	100	95	91	89	99	94	91	88	93	90	88	92	90	88	91	89	87	86			
8	98	93	89	87	97	92	89	87	91	88	86	90	88	86	90	87	86	85			
9	96	91	87	85	95	90	87	85	90	87	85	89	86	84	88	86	84	83			
10	94	89	86	83	94	89	85	83	88	85	83	87	85	83	87	85	83	82			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	6294063
5°	5018034
10°	2178530
15°	752664
20°	308609
25°	139357
30°	56057
35°	26139
40°	14169
45°	5303
50°	3147
55°	2408
60°	1381
65°	817
70°	1010
75°	0
80°	0
85°	0



TEST NUMBER: P278288

CATALOG NUMBER: LDA2B209727D010 EU2B20SP159727 2LBAD1WHH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	765.8	55.0
10°-20°	459.9	33.0
20°-30°	126.6	9.1
30°-40°	30.1	2.2
40°-50°	7.4	0.5
50°-60°	2.5	0.2
60°-70°	0.9	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1352.2	97.1
0°-40°	1382.3	99.2
0°-60°	1392.2	99.9
0°-90°	1393.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1393.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	12758	
5°	10132	766
15°	1474	460
25°	256	127
35°	43	30
45°	8	7
55°	3	2
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P278288

CATALOG NUMBER: LDA2B209727D010 EU2B20SP159727 2LBAD1WHH

CANDELA DISTRIBUTION (FULL):

	0°
0°	12757.5
1°	12616.4
2°	12278.5
3°	11762.9
4°	11035.4
5°	10132.4
6°	9029.7
7°	7821.8
8°	6552.5
9°	5385.2
10°	4348.6
11°	3471.1
12°	2762.8
13°	2228.0
14°	1802.6
15°	1473.6
17.5°	914.7
20°	587.8
22.5°	385.4
25°	256.0
27.5°	164.5
30°	98.4
32.5°	61.9
35°	43.4
37.5°	31.7
40°	22.0
42.5°	13.1
45°	7.6
47.5°	5.5
50°	4.1
52.5°	3.4
55°	2.8
57.5°	2.1
60°	1.4
62.5°	1.4
65°	0.7
67.5°	0.7
70°	0.7
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P278288

CATALOG NUMBER: LDA2B209727D010 EU2B20SP159727 2LBAD1WHH

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)