

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P280976

Luminaire Tested: **LDA2B209730D010 EU2B20WFL559730 2LBALD1WHH**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P280976
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-1811-033-5)
Test Lab: INNOVATION CENTER(G2)
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LDA2B209730D010 EU2B20WFL559730 2LBALD1WHH
Description: PORTFOLIO 2IN ADJ 2000 LUMEN LED LUMINAIRE WITH WIDE FLOOD OPTIC AND
2in ADJ spun Refl w/lens Self-Flanged, WHH
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1569.5 lumens
Efficiency: N/A
Efficacy: 76.2 lumens/watt
Spacing Criteria (0/90/45): 0.74 / 0.74 / 0.73
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 20.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P280976

CATALOG NUMBER: LDA2B209730D010 EU2B20WFL559730 2LBALD1WHH

Luminous Intensity Polar Plot

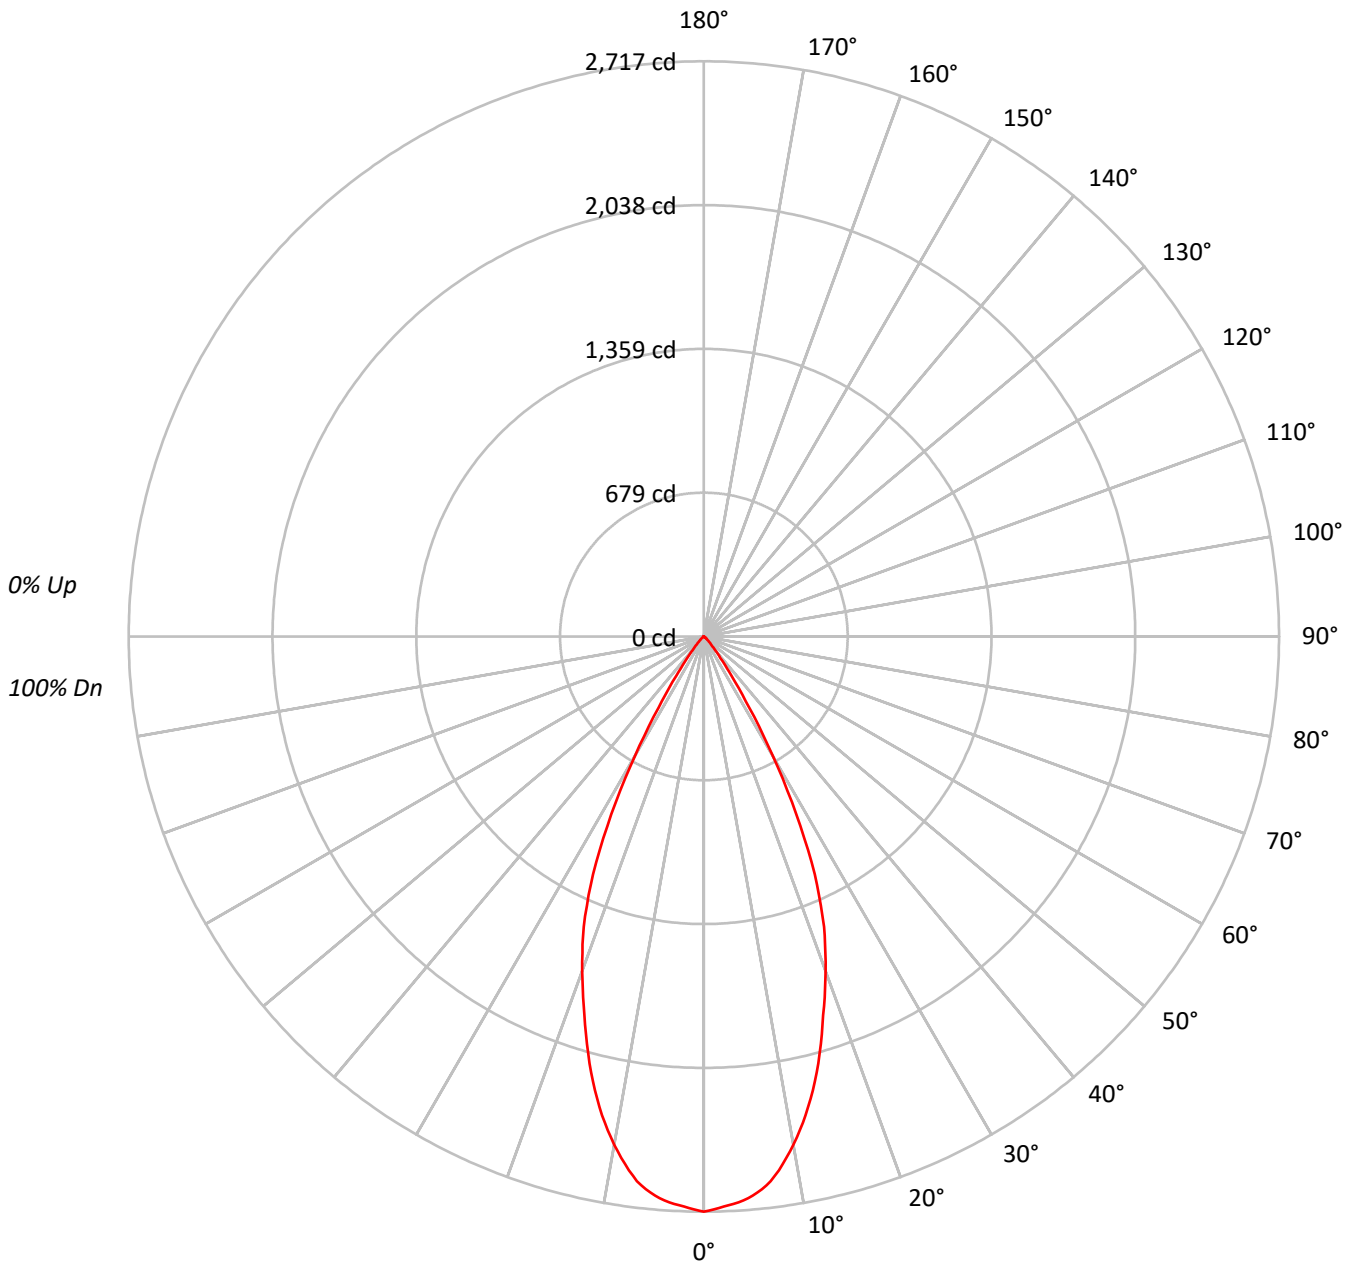



TEST NUMBER: P280976

CATALOG NUMBER: LDA2B209730D010 EU2B20WFL559730 2LBALD1WHH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	112	109	107	112	110	108	106	106	104	103	102	101	99	98	97	97	95		
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90		
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	88	86	85		
4	100	94	89	85	99	93	88	85	91	87	84	89	85	83	87	84	82	80		
5	96	89	84	80	95	88	83	80	86	82	79	85	81	78	83	80	78	76		
6	92	84	79	75	91	84	79	75	82	78	75	81	77	74	80	76	74	72		
7	88	80	75	71	87	80	75	71	78	74	71	77	73	70	76	73	70	69		
8	85	76	71	68	84	76	71	67	75	70	67	74	70	67	73	69	67	65		
9	81	73	68	64	80	72	68	64	72	67	64	71	67	64	70	66	64	62		
10	78	70	65	61	77	69	64	61	69	64	61	68	64	61	67	63	61	59		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1340464
5°	1313146
10°	1221121
15°	1066172
20°	882724
25°	675121
30°	369441
35°	136779
40°	47337
45°	21350
50°	10055
55°	4989
60°	1480
65°	817
70°	1010
75°	0
80°	0
85°	0



TEST NUMBER: P280976

CATALOG NUMBER: LDA2B209730D010 EU2B20WFL559730 2LBALD1WHH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	246.4	15.7
10°-20°	576.9	36.8
20°-30°	545.3	34.7
30°-40°	167.9	10.7
40°-50°	26.5	1.7
50°-60°	5.6	0.4
60°-70°	0.8	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1368.6	87.2
0°-40°	1536.5	97.9
0°-60°	1568.6	99.9
0°-90°	1569.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1569.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2717	
5°	2652	246
15°	2087	577
25°	1240	545
35°	227	168
45°	31	27
55°	6	6
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P280976

CATALOG NUMBER: LDA2B209730D010 EU2B20WFL559730 2LBALD1WHH

CANDELA DISTRIBUTION (FULL):

	0°
0°	2717.0
1°	2706.8
2°	2694.4
3°	2684.2
4°	2671.1
5°	2651.5
6°	2626.0
7°	2591.8
8°	2545.9
9°	2492.8
10°	2437.5
11°	2376.4
12°	2311.6
13°	2241.0
14°	2167.5
15°	2087.4
17.5°	1875.6
20°	1681.3
22.5°	1484.0
25°	1240.2
27.5°	946.2
30°	648.5
32.5°	398.1
35°	227.1
37.5°	126.6
40°	73.5
42.5°	45.9
45°	30.6
47.5°	20.4
50°	13.1
52.5°	8.7
55°	5.8
57.5°	3.6
60°	1.5
62.5°	0.7
65°	0.7
67.5°	0.7
70°	0.7
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P280976

CATALOG NUMBER: LDA2B209730D010 EU2B20WFL559730 2LBALD1WHH

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)