

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: PORTFOLIO

Report Number: P491800

Luminaire Tested: **LDA2B058030R20D010 2LBDC1MMS**

Issue Date: 3/8/2021

This test was performed under the Supervised Manufacturer's Testing Program. The results of this test have not been influenced by sources from within Cooper Lighting Solutions or from external interests.



Test Information

Test Method: LM-79-08
Report Number: P491800
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2011-037-1)
Test Lab: INNOVATION CENTER
Issue Date: 3/8/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LDA2B058030R20D010 2LBDC1MMS
Description: 500 LUMEN 2IN ADJUSTABLE LED LUMINAIRE WITH 80 CRI LEDS AND 3000K CCT LEDS
Light Source: -
Ballast/Driver: -

Luminaire Equipment: Sample No. Condition Description

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 797.5 lumens
Efficiency: N/A
Efficacy: 113.9 lumens/watt
Spacing Criteria (0/90/45): 0.33 / 0.33 / 0.32
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct

Input Watts (W): 7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P491800

CATALOG NUMBER: LDA2B058030R20D010 2LBDC1MMS

Luminous Intensity Polar Plot

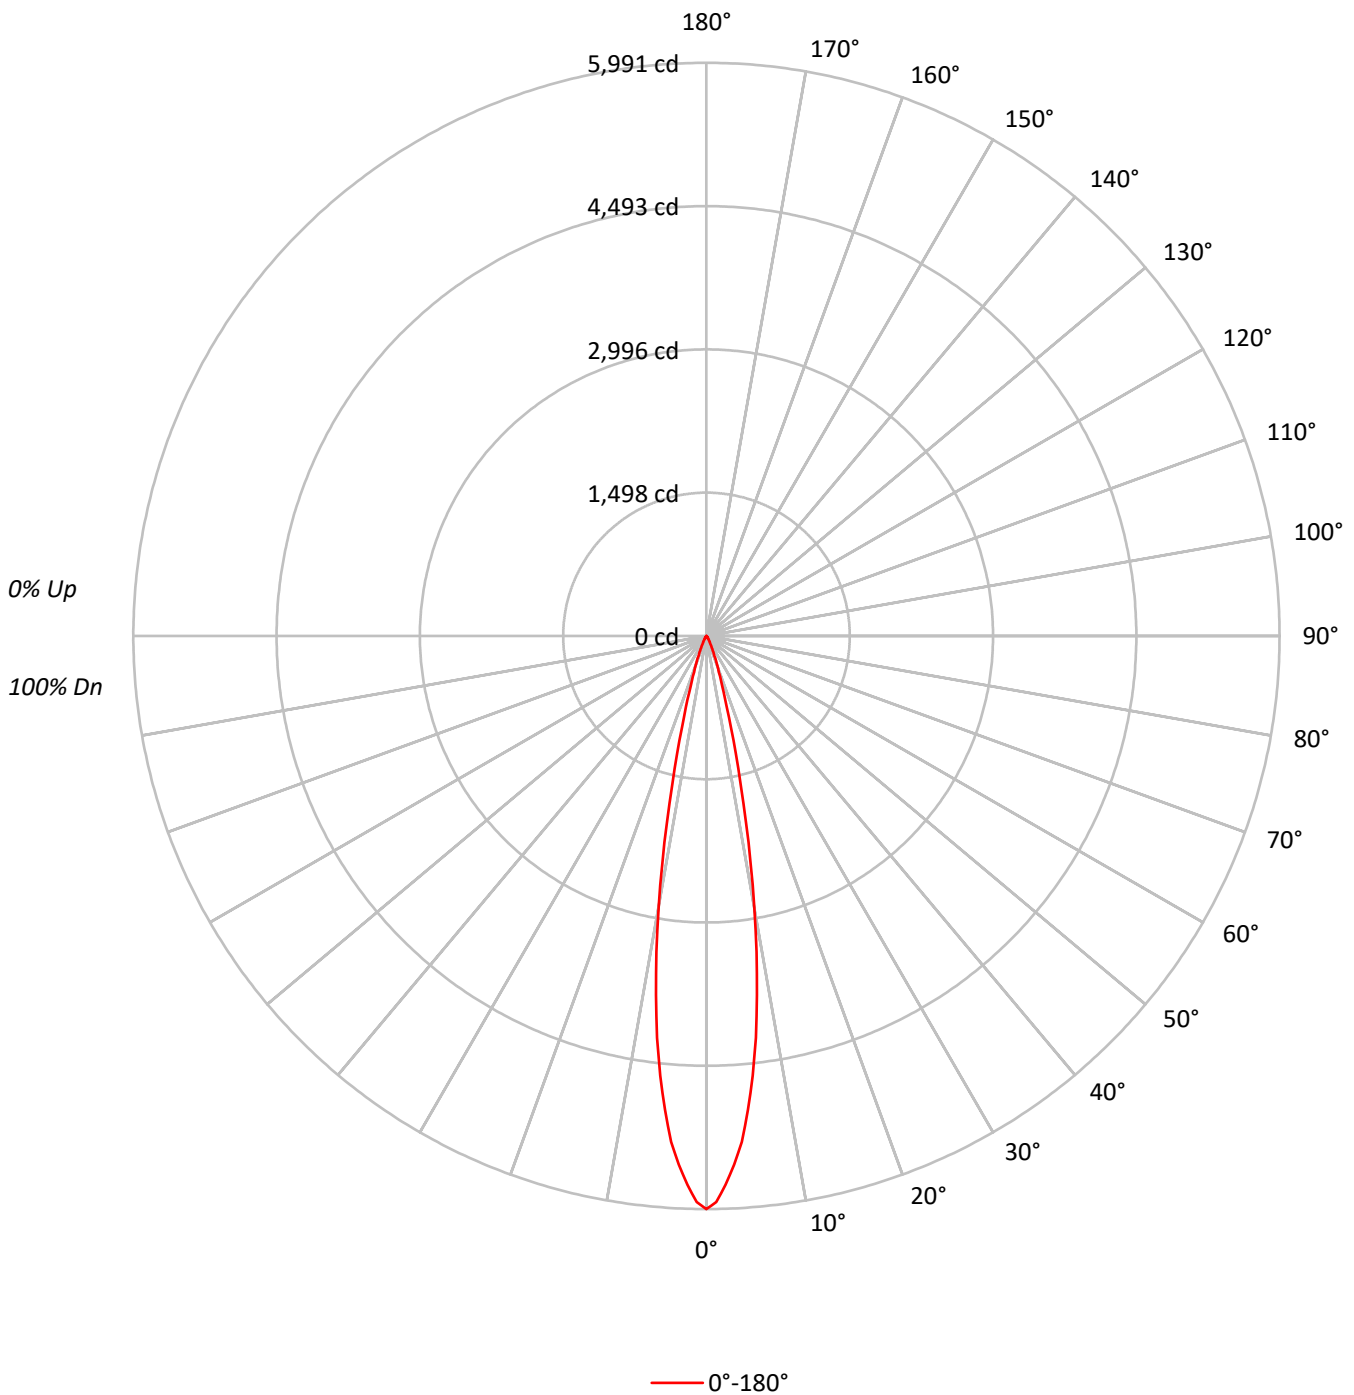



TEST NUMBER: P491800

CATALOG NUMBER: LDA2B058030R20D010 2LBDC1MMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	116	114	112	110	113	111	110	109	108	106	105		104	103	102		101	100	99	98
2	112	109	106	104	110	107	105	103	104	102	101		102	100	99		99	98	97	95
3	109	105	102	100	108	104	101	99	102	99	97		99	97	96		97	96	94	93
4	107	102	99	96	105	101	98	95	99	96	94		97	95	93		96	94	92	91
5	104	99	95	93	103	98	95	92	97	94	92		95	93	91		94	92	90	89
6	102	96	93	90	101	96	92	90	94	92	89		93	91	89		92	90	88	87
7	100	94	91	88	99	94	90	88	92	90	87		92	89	87		91	88	87	86
8	98	92	88	86	97	91	88	86	91	88	86		90	87	85		89	87	85	84
9	96	90	87	84	95	90	86	84	89	86	84		88	86	84		88	85	83	83
10	94	88	85	83	93	88	85	82	87	84	82		87	84	82		86	84	82	81

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2955780
5°	2462712
10°	1444304
15°	505862
20°	170265
25°	65596
30°	30136
35°	13371
40°	6505
45°	3768
50°	2072
55°	688
60°	395
65°	467
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P491800

CATALOG NUMBER: LDA2B058030R20D010 2LBDC1MMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	406.8	51.0
10°-20°	305.5	38.3
20°-30°	64.2	8.0
30°-40°	15.4	1.9
40°-50°	4.4	0.6
50°-60°	1.0	0.1
60°-70°	0.2	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	776.5	97.4
0°-40°	791.9	99.3
0°-60°	797.3	100.0
0°-90°	797.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	797.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5991	
5°	4973	407
15°	990	305
25°	120	64
35°	22	15
45°	5	4
55°	1	1
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P491800

CATALOG NUMBER: LDA2B058030R20D010 2LBDC1MMS

CANDELA DISTRIBUTION (FULL):

0°	
0°	5991.1
1°	5918.0
2°	5739.1
3°	5533.0
4°	5302.4
5°	4972.7
6°	4622.7
7°	4234.2
8°	3790.6
9°	3342.6
10°	2883.0
11°	2410.1
12°	1993.7
13°	1587.3
14°	1263.4
15°	990.4
16°	776.9
17°	612.8
18°	492.7
19°	399.4
20°	324.3
22.5°	196.8
25°	120.5
27.5°	78.9
30°	52.9
32.5°	32.3
35°	22.2
37.5°	15.2
40°	10.1
42.5°	7.4
45°	5.4
47.5°	3.9
50°	2.7
52.5°	1.6
55°	0.8
57.5°	0.4
60°	0.4
62.5°	0.4
65°	0.4
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0



TEST NUMBER: P491800

CATALOG NUMBER: LDA2B058030R20D010 2LBDC1MMS

CANDELA DISTRIBUTION (continued):

	0°
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)