

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P280278

Luminaire Tested: **LDA2B059727D010 EU2B05WFL559727 2LBAD1WMH**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P280278  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-1811-033-5)  
Test Lab: INNOVATION CENTER(G2)  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LDA2B059727D010 EU2B05WFL559727 2LBAD1WMH  
Description: PORTFOLIO 2IN ADJ 500 LUMEN LED LUMINAIRE WITH WIDE FLOOD OPTIC AND  
2in ADJ spun Refl, Self-Flanged, WMH  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 594.4 lumens  
Efficiency: N/A  
Efficacy: 84.9 lumens/watt  
Spacing Criteria (0/90/45): 0.74 / 0.74 / 0.73  
Luminous Opening: Circular (Dia: 0.17' x H: 0')  
CIE Type: Direct


Input Watts (W): 7  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P280278

CATALOG NUMBER: LDA2B059727D010 EU2B05WFL559727 2LBAD1WMH

### Luminous Intensity Polar Plot

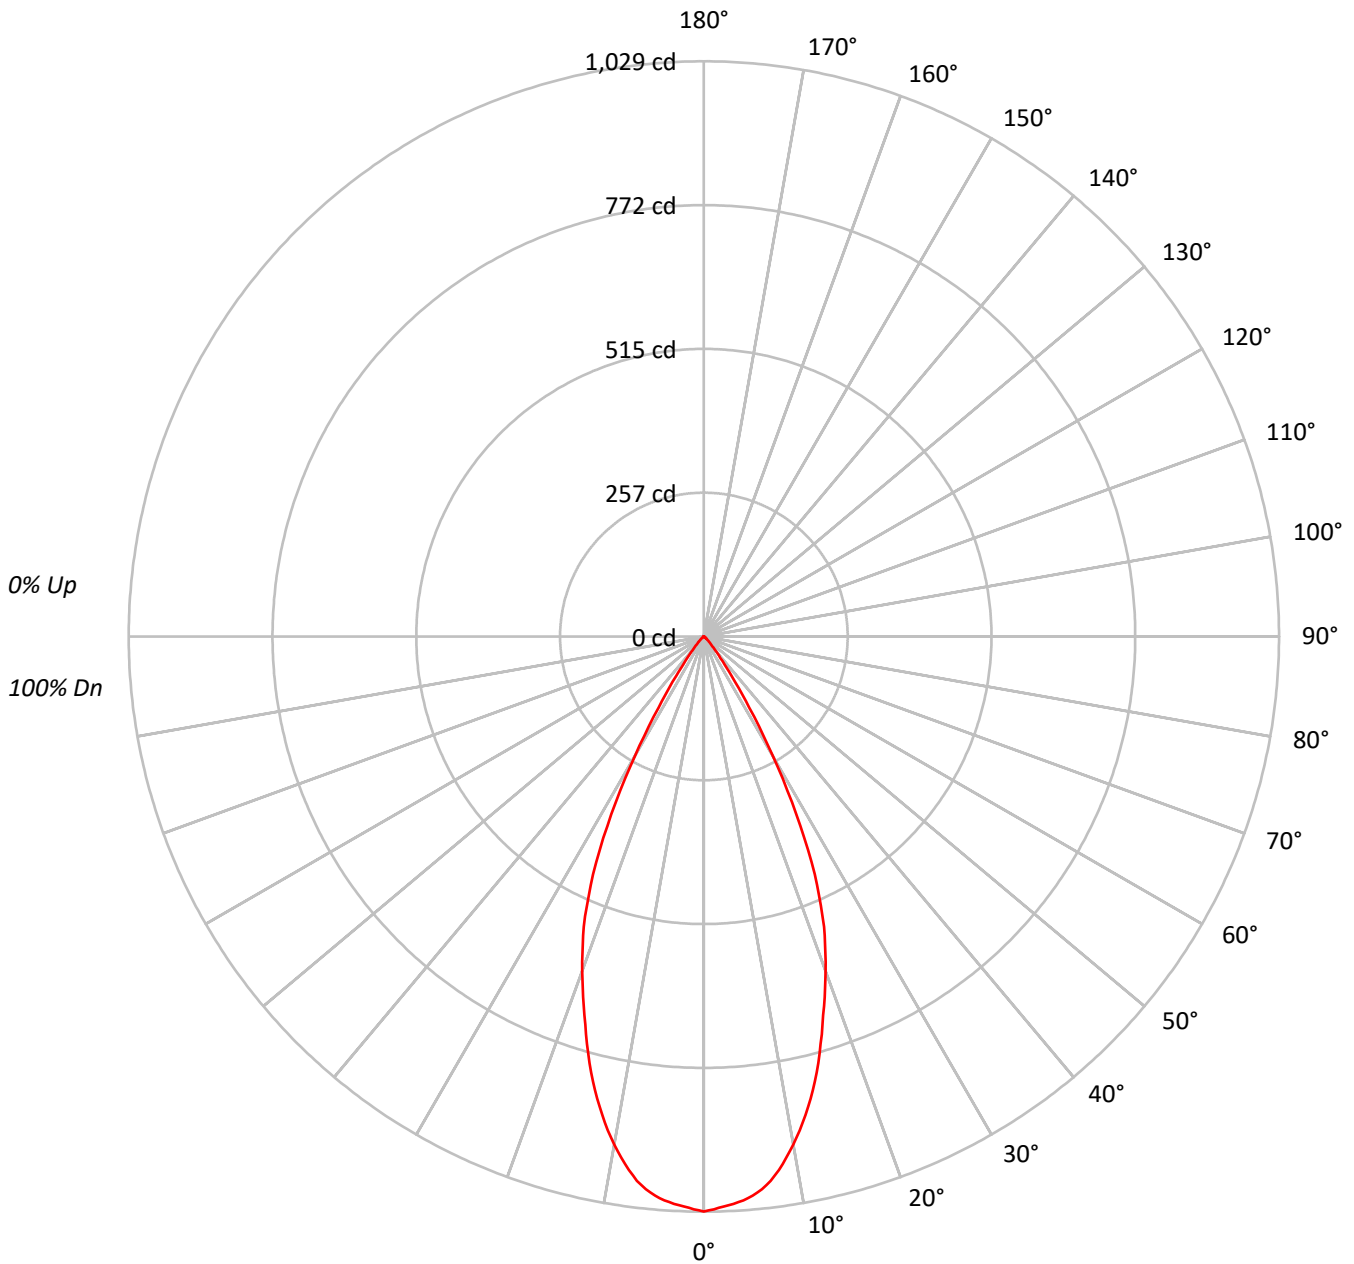



TEST NUMBER: P280278

CATALOG NUMBER: LDA2B059727D010 EU2B05WFL559727 2LBAD1WMH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	112	109	107	112	110	108	106	106	104	103	102	101	99	98	97	97	95
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	88	86	85
4	100	94	89	85	99	93	88	85	91	87	84	89	85	83	87	84	82	80
5	96	89	84	80	95	88	83	80	86	82	79	85	81	78	83	80	78	76
6	92	84	79	75	91	84	79	75	82	78	75	81	77	74	80	76	74	72
7	88	80	75	71	87	80	75	71	78	74	71	77	73	70	76	73	70	69
8	85	76	71	68	84	76	71	67	75	70	67	74	70	67	73	69	67	65
9	81	73	68	64	80	72	68	64	72	67	64	71	67	64	70	66	64	62
10	78	70	65	61	77	69	64	61	69	64	61	68	64	61	67	63	61	59

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	507571
5°	497227
10°	462398
15°	403709
20°	334231
25°	255634
30°	139915
35°	51796
40°	17904
45°	8094
50°	3838
55°	1892
60°	592
65°	350
70°	433
75°	0
80°	0
85°	0



TEST NUMBER: P280278

CATALOG NUMBER: LDA2B059727D010 EU2B05WFL559727 2LBAD1WMH

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	93.3	15.7
10°-20°	218.5	36.8
20°-30°	206.5	34.7
30°-40°	63.6	10.7
40°-50°	10.1	1.7
50°-60°	2.1	0.4
60°-70°	0.3	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	518.2	87.2
0°-40°	581.8	97.9
0°-60°	594.0	99.9
0°-90°	594.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	594.4	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1029	
5°	1004	93
15°	790	218
25°	470	206
35°	86	64
45°	12	10
55°	2	2
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P280278

CATALOG NUMBER: LDA2B059727D010 EU2B05WFL559727 2LBAD1WMH

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1028.8
1°	1025.0
2°	1020.3
3°	1016.4
4°	1011.4
5°	1004.0
6°	994.4
7°	981.4
8°	964.0
9°	943.9
10°	923.0
11°	899.8
12°	875.3
13°	848.6
14°	820.7
15°	790.4
17.5°	710.2
20°	636.6
22.5°	561.9
25°	469.6
27.5°	358.3
30°	245.6
32.5°	150.8
35°	86.0
37.5°	48.0
40°	27.8
42.5°	17.4
45°	11.6
47.5°	7.7
50°	5.0
52.5°	3.3
55°	2.2
57.5°	1.4
60°	0.6
62.5°	0.3
65°	0.3
67.5°	0.3
70°	0.3
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P280278

CATALOG NUMBER: LDA2B059727D010 EU2B05WFL559727 2LBAD1WMH

**CANDELA DISTRIBUTION (continued):**

0°  
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)