

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P742702

Luminaire Tested: LD4D10D010-EU4DR650210IC9040-4LBS1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P742702
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D10D010-EU4DR650210IC9040-4LBS1B
Description: 4 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 928.4 lumens
Efficiency: N/A
Efficacy: 79.4 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P742702
CATALOG NUMBER: LD4D10D010-EU4DR650210IC9040-4LBS1B

Luminous Intensity Polar Plot

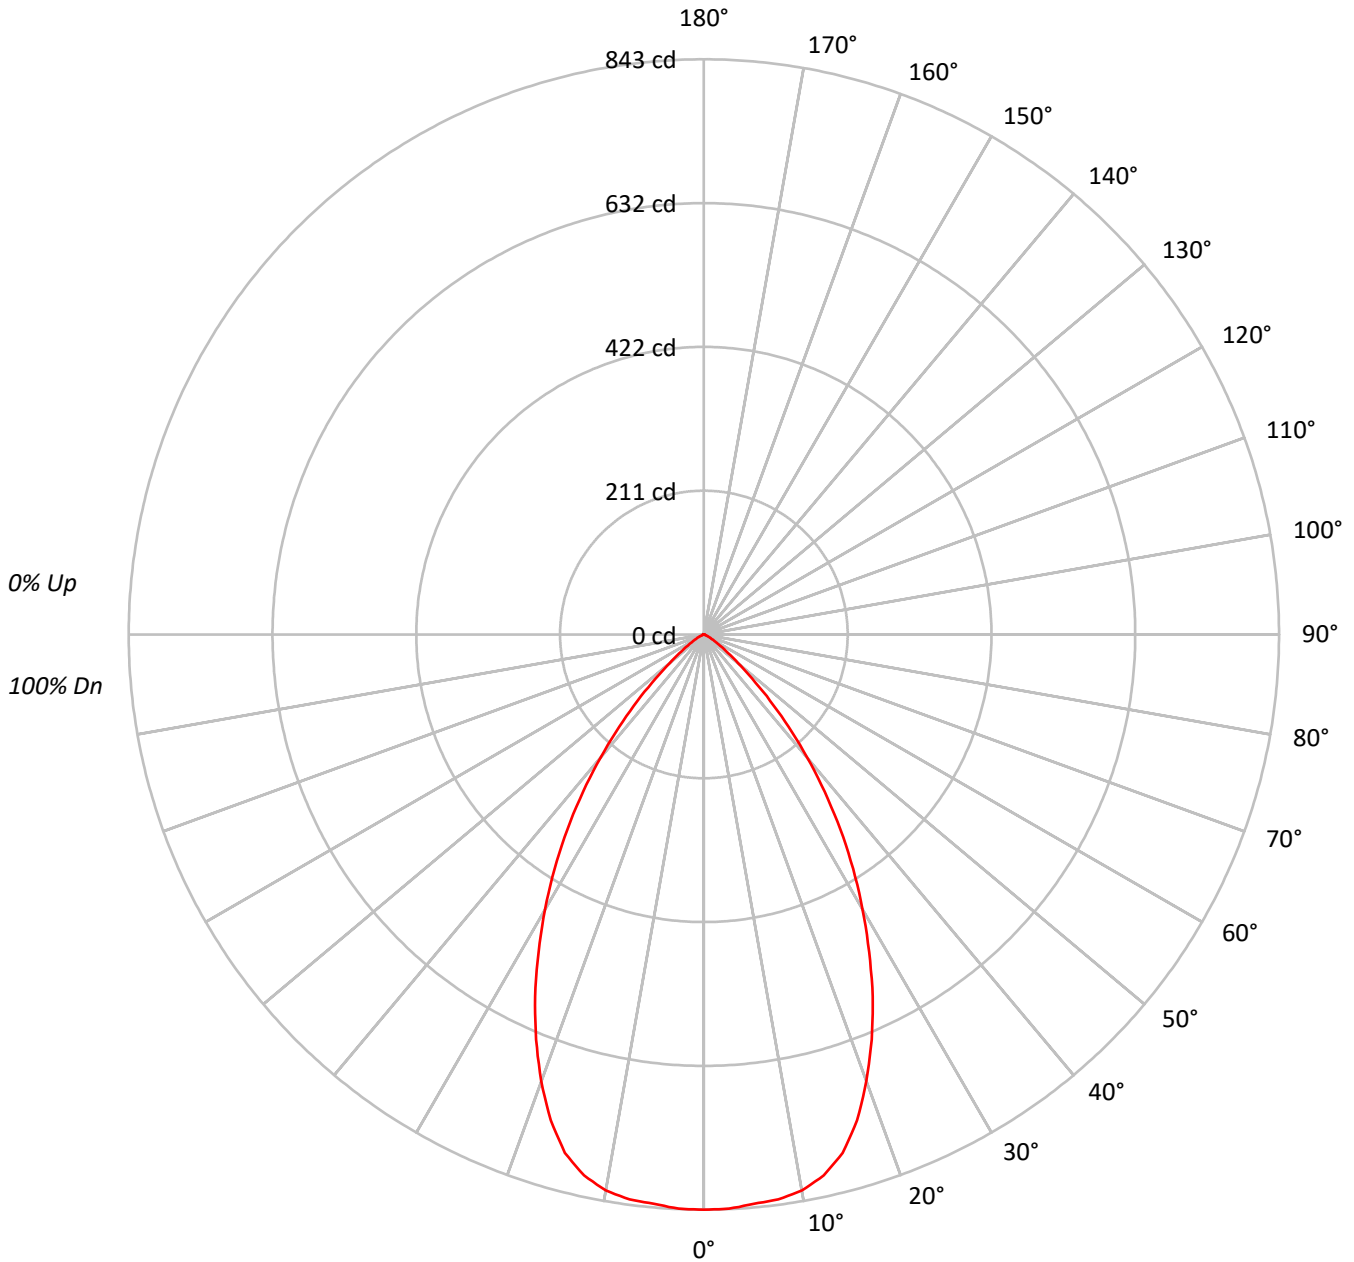



TEST NUMBER: P742702

CATALOG NUMBER: LD4D10D010-EU4DR650210IC9040-4LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	110	107	105	111	108	106	103	104	102	100	100	99	97	97	95	94	93			
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85			
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78			
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72			
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66			
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61			
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56			
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52			
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49			
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	49234
5°	49112
10°	49069
15°	47555
20°	43295
25°	37724
30°	31379
35°	24869
40°	17947
45°	11340
50°	5906
55°	3136
60°	1647
65°	912
70°	376
75°	406
80°	303
85°	201

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 11340 cd/sqm



TEST NUMBER: P742702

CATALOG NUMBER: LD4D10D010-EU4DR650210IC9040-4LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	79.7	8.6
10°-20°	218.3	23.5
20°-30°	266.8	28.7
30°-40°	216.5	23.3
40°-50°	107.9	11.6
50°-60°	30.1	3.2
60°-70°	6.8	0.7
70°-80°	1.8	0.2
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	564.9	60.8
0°-40°	781.4	84.2
0°-60°	919.4	99.0
0°-90°	928.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	928.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	843	
5°	838	80
15°	786	218
25°	585	267
35°	349	217
45°	137	108
55°	31	30
65°	7	7
75°	2	2
85°	0	0
90°	0	



TEST NUMBER: P742702

CATALOG NUMBER: LD4D10D010-EU4DR650210IC9040-4LBS1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	843.0
2.5°	842.4
5°	837.7
7.5°	835.0
10°	827.4
12.5°	812.0
15°	786.5
17.5°	746.6
20°	696.6
22.5°	642.6
25°	585.4
27.5°	524.4
30°	465.3
32.5°	407.0
35°	348.8
37.5°	290.6
40°	235.4
42.5°	183.6
45°	137.3
47.5°	95.6
50°	65.0
52.5°	44.9
55°	30.8
57.5°	20.8
60°	14.1
62.5°	9.8
65°	6.6
67.5°	3.3
70°	2.2
72.5°	2.1
75°	1.8
77.5°	1.3
80°	0.9
82.5°	0.6
85°	0.3
87.5°	0.2
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)