

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P742484

Luminaire Tested: LD4D10D010-EU4DR500210IC9050-4LBS1MW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P742484
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D10D010-EU4DR500210IC9050-4LBS1MW
Description: 4 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 50° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1111.4 lumens
Efficiency: N/A
Efficacy: 95.0 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P742484

CATALOG NUMBER: LD4D10D010-EU4DR500210IC9050-4LBS1MW

Luminous Intensity Polar Plot

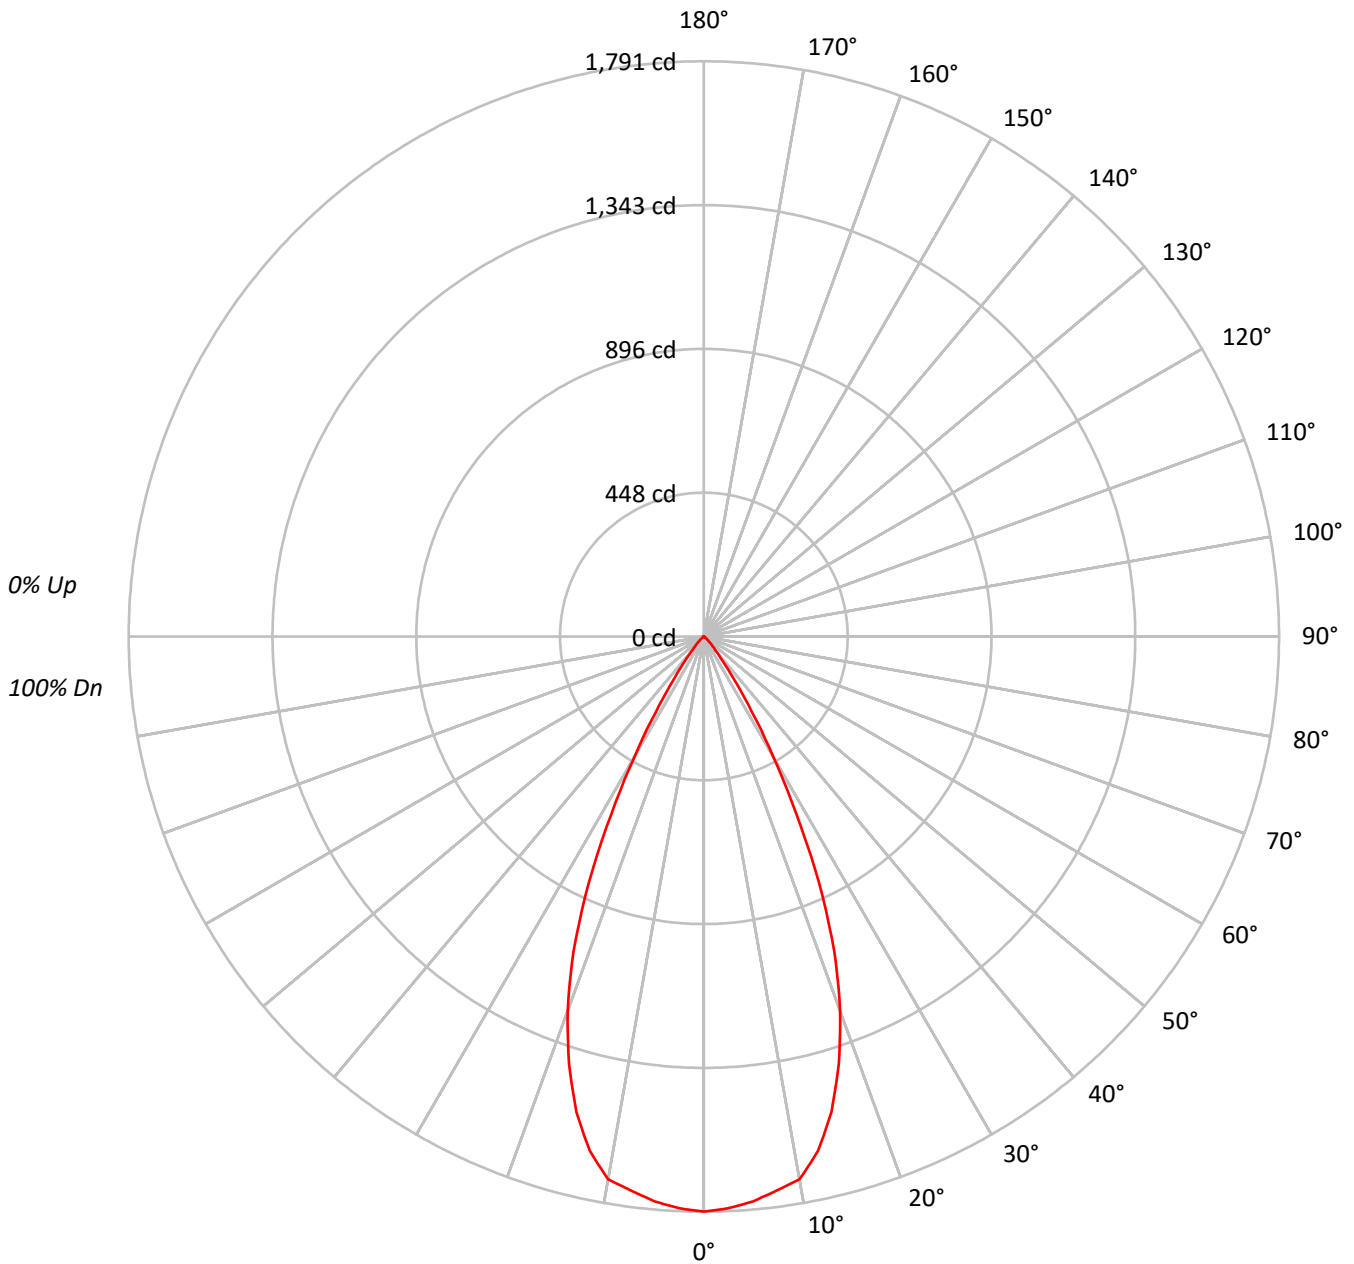



TEST NUMBER: P742484

CATALOG NUMBER: LD4D10D010-EU4DR500210IC9050-4LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			0
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	114	112	109	107	112	110	108	106	106	104	102		102	101	99		98	97	97	95
2	109	105	101	98	107	103	100	97	100	98	95		97	95	93		95	93	91	90
3	105	99	95	91	103	98	94	90	95	92	89		93	90	88		91	88	86	85
4	100	94	89	85	99	93	88	85	90	87	84		89	85	83		87	84	82	80
5	96	89	84	80	95	88	83	79	86	82	79		85	81	78		83	80	77	76
6	92	84	79	75	91	83	79	75	82	78	74		81	77	74		79	76	74	72
7	88	80	75	71	87	79	74	71	78	74	71		77	73	70		76	73	70	69
8	85	76	71	67	84	76	71	67	75	70	67		74	70	67		73	69	66	65
9	81	73	68	64	80	72	67	64	71	67	64		71	67	64		70	66	63	62
10	78	70	64	61	77	69	64	61	68	64	61		68	64	61		67	63	60	59

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	195653
5°	193604
10°	190417
15°	173383
20°	144271
25°	102412
30°	54212
35°	22088
40°	8201
45°	3755
50°	1547
55°	800
60°	393
65°	129
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 3755 cd/sqm



TEST NUMBER: P742484

CATALOG NUMBER: LD4D10D010-EU4DR500210IC9050-4LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	166.8	15.0
10°-20°	421.7	37.9
20°-30°	378.8	34.1
30°-40°	118.6	10.7
40°-50°	20.8	1.9
50°-60°	4.1	0.4
60°-70°	0.6	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	967.3	87.0
0°-40°	1085.8	97.7
0°-60°	1110.7	99.9
0°-90°	1111.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1111.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1791	
5°	1765	167
15°	1533	422
25°	850	379
35°	166	119
45°	24	21
55°	4	4
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P742484

CATALOG NUMBER: LD4D10D010-EU4DR500210IC9050-4LBS1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	1790.7
2.5°	1781.8
5°	1765.2
7.5°	1739.8
10°	1716.3
12.5°	1640.8
15°	1532.8
17.5°	1395.8
20°	1240.8
22.5°	1061.6
25°	849.5
27.5°	624.6
30°	429.7
32.5°	279.8
35°	165.6
37.5°	95.1
40°	57.5
42.5°	37.4
45°	24.3
47.5°	14.8
50°	9.1
52.5°	6.2
55°	4.2
57.5°	2.9
60°	1.8
62.5°	1.0
65°	0.5
67.5°	0.2
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)