

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P743713

Luminaire Tested: LD4D15D010-EU4DR700215IC9024-4LBDP1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P743713
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-73)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D15D010-EU4DR700215IC9024-4LBDP1MW
Description: 4 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 923.7 lumens
Efficiency: N/A
Efficacy: 58.5 lumens/watt
Spacing Criteria (0/90/45): 0.88 / 0.88 / 0.82
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P743713

CATALOG NUMBER: LD4D15D010-EU4DR700215IC9024-4LBDP1MW

Luminous Intensity Polar Plot

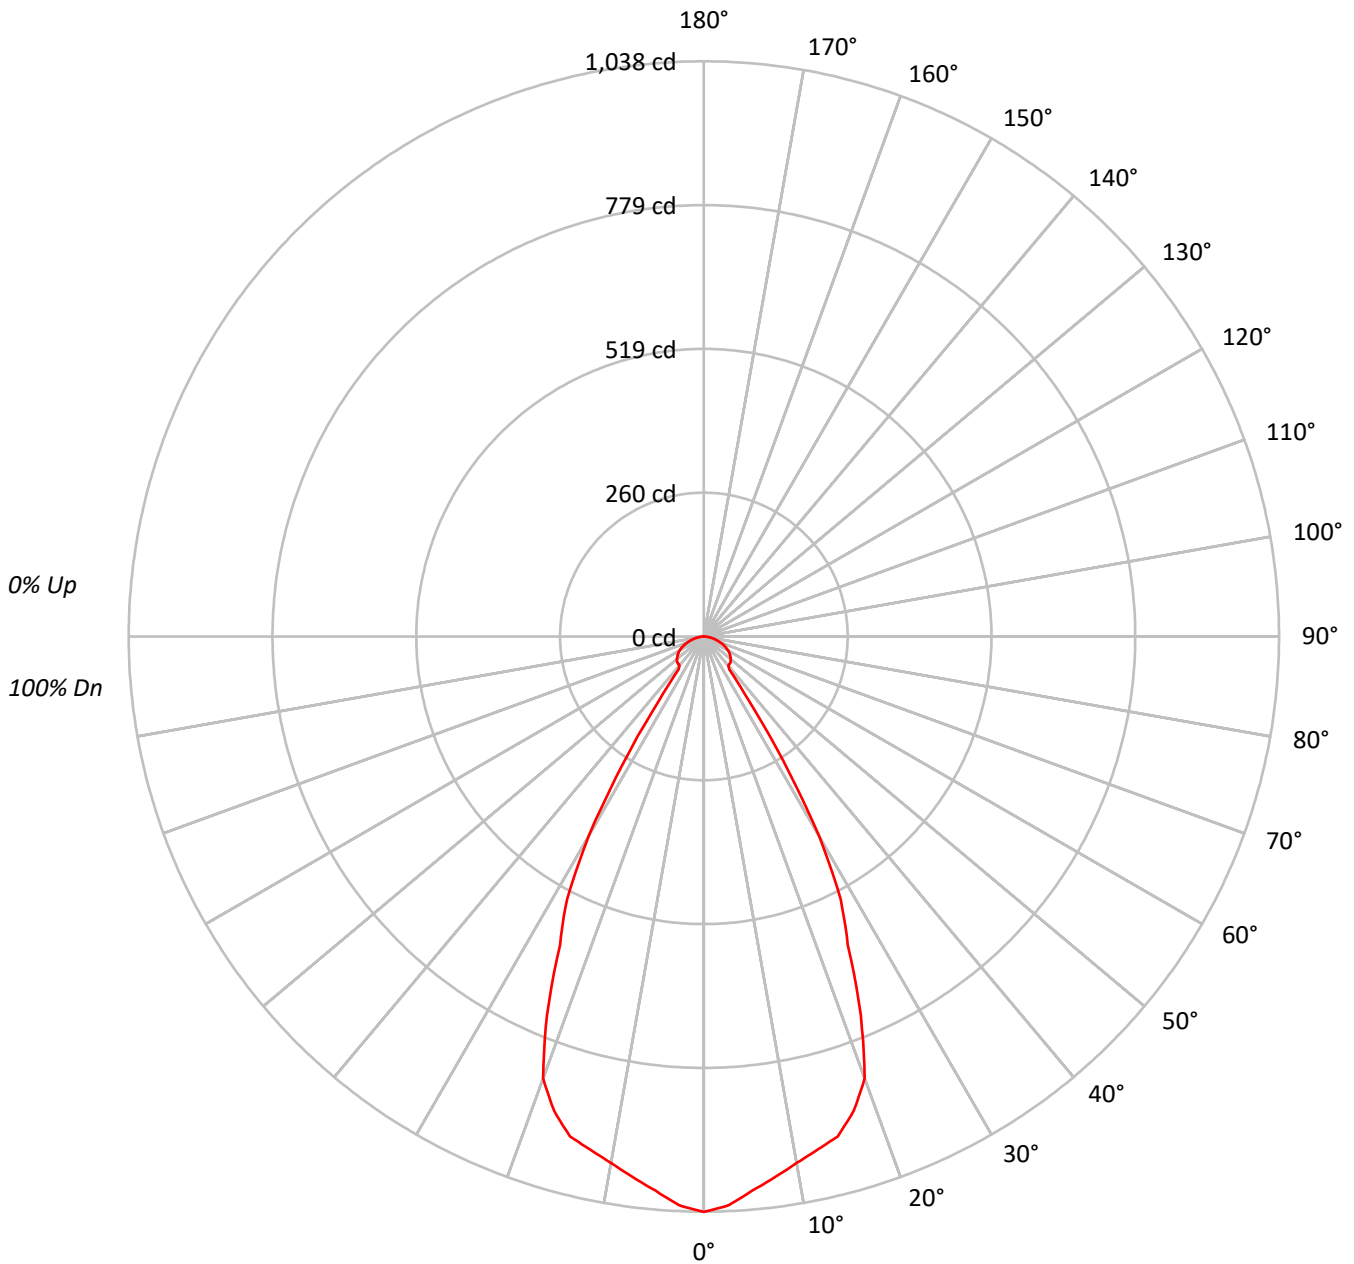



TEST NUMBER: P743713

CATALOG NUMBER: LD4D15D010-EU4DR700215IC9024-4LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	112	109	106	103	110	107	104	102	103	101	99	99	97	96	95	94	93	91			
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	85	83			
3	100	92	87	82	98	91	86	81	88	84	80	86	82	79	83	80	78	76			
4	94	86	80	75	92	85	79	74	82	77	73	80	76	73	78	75	72	70			
5	89	80	74	69	87	79	73	69	77	72	68	75	71	67	74	70	67	65			
6	85	75	68	64	83	74	68	64	73	67	63	71	66	63	70	66	62	61			
7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57			
8	77	66	60	56	75	66	60	56	65	59	55	64	59	55	63	58	55	53			
9	73	63	57	52	72	62	56	52	61	56	52	60	55	52	60	55	52	50			
10	70	59	53	49	69	59	53	49	58	53	49	57	52	49	57	52	49	48			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	113467
5°	110095
10°	107030
15°	105627
20°	98634
25°	74094
30°	52383
35°	18554
40°	9756
45°	10399
50°	10760
55°	10953
60°	11035
65°	10807
70°	10191
75°	9414
80°	8368
85°	6770

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 57.5°
 Luminance: 11042 cd/sqm



TEST NUMBER: P743713

CATALOG NUMBER: LD4D15D010-EU4DR700215IC9024-4LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	94.7	10.2
10°-20°	259.7	28.1
20°-30°	286.0	31.0
30°-40°	109.3	11.8
40°-50°	51.6	5.6
50°-60°	51.3	5.6
60°-70°	41.1	4.4
70°-80°	23.6	2.6
80°-90°	6.4	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	640.4	69.3
0°-40°	749.7	81.2
0°-60°	852.6	92.3
0°-90°	923.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	923.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1038	
5°	1004	95
15°	934	260
25°	615	286
35°	139	109
45°	67	52
55°	58	51
65°	42	41
75°	22	24
85°	5	6
90°	0	



TEST NUMBER: P743713

CATALOG NUMBER: LD4D15D010-EU4DR700215IC9024-4LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	1038.5
2.5°	1027.6
5°	1003.8
7.5°	983.9
10°	964.7
12.5°	948.4
15°	933.8
17.5°	898.4
20°	848.3
22.5°	740.1
25°	614.6
27.5°	535.0
30°	415.2
32.5°	268.2
35°	139.1
37.5°	75.2
40°	68.4
42.5°	67.9
45°	67.3
47.5°	65.8
50°	63.3
52.5°	60.5
55°	57.5
57.5°	54.3
60°	50.5
62.5°	46.2
65°	41.8
67.5°	36.8
70°	31.9
72.5°	27.0
75°	22.3
77.5°	17.6
80°	13.3
82.5°	9.4
85°	5.4
87.5°	2.1
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)