

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P742946

Luminaire Tested: LD4D15D010-EU4DR1515309050-4LBS1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P742946
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D15D010-EU4DR1515309050-4LBS1H
Description: 4 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1530.5 lumens
Efficiency: N/A
Efficacy: 96.9 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P742946
CATALOG NUMBER: LD4D15D010-EU4DR1515309050-4LBS1H

Luminous Intensity Polar Plot

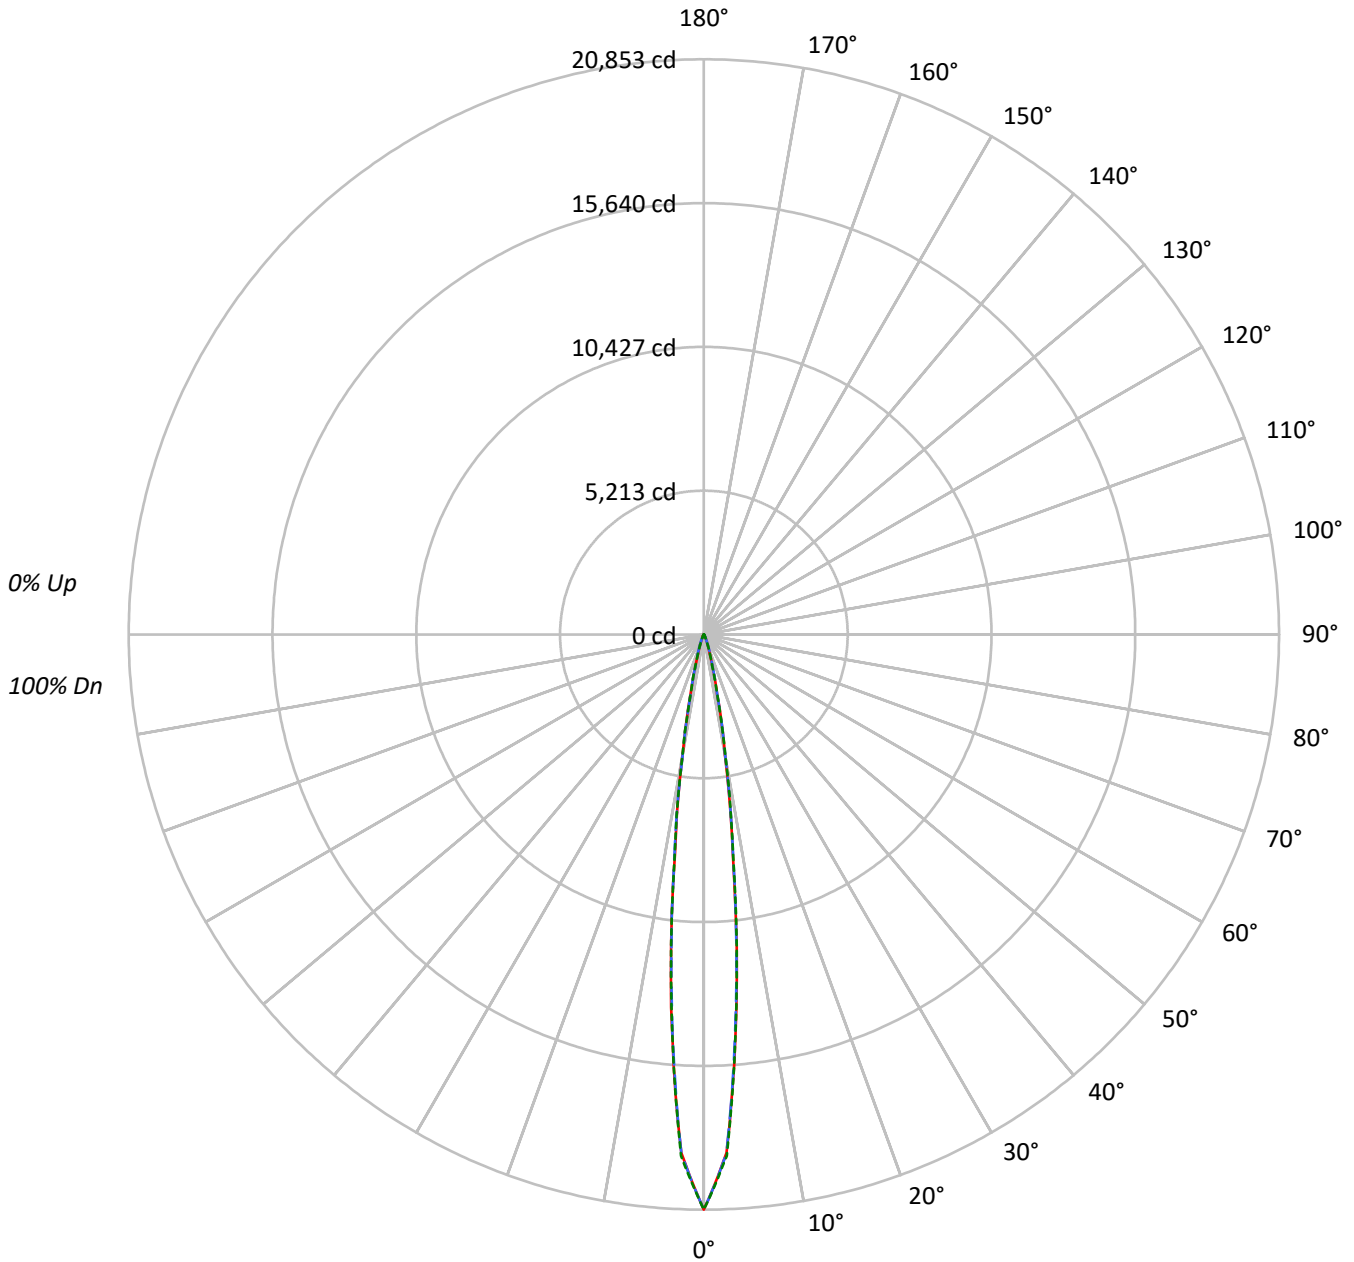



TEST NUMBER: P742946

CATALOG NUMBER: LD4D15D010-EU4DR1515309050-4LBS1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98						98													
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96						96													
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94						94													
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93						93													
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92						92													
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90						90													
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89						89													
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88						88													
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	88	87						87													
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86						86													

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2346345	2346345	2346345
5°	1378820	1360963	1371736
10°	411514	414398	420743
15°	102361	104350	101136
20°	30626	35462	31273
25°	10797	13757	10937
30°	3969	5219	4029
35°	1990	2244	1924
40°	1257	1378	1257
45°	924	987	924
50°	737	737	737
55°	613	613	613
60°	498	498	498
65°	378	378	378
70°	322	322	322
75°	197	197	265
80°	142	142	142
85°	75	75	75

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 987 cd/sqm



TEST NUMBER: P742946

CATALOG NUMBER: LD4D15D010-EU4DR1515309050-4LBS1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	992.6	64.9
10°-20°	408.3	26.7
20°-30°	81.1	5.3
30°-40°	20.2	1.3
40°-50°	10.6	0.7
50°-60°	7.9	0.5
60°-70°	5.6	0.4
70°-80°	3.1	0.2
80°-90°	1.0	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1482.0	96.8
0°-40°	1502.3	98.2
0°-60°	1520.8	99.4
0°-90°	1530.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1530.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	20853	20853	20853	20853	20853	
5°	13567	13428	13392	13484	13498	991
15°	1178	1201	1201	1180	1164	404
25°	139	157	177	156	140	73
35°	27	29	31	29	26	19
45°	13	13	14	13	13	10
55°	9	9	9	9	9	8
65°	5	5	5	5	5	6
75°	3	3	3	3	4	3
85°	1	1	1	1	1	1
90°	0	0	0	0	0	



TEST NUMBER: P742946

CATALOG NUMBER: LD4D15D010-EU4DR1515309050-4LBS1H

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	20852.7	20852.7	20852.7	20852.7	20852.7
2.5°	18810.0	18825.8	18832.0	18850.6	18919.4
5°	13567.2	13427.7	13391.5	13484.2	13497.5
7.5°	8036.7	8064.9	8168.2	8191.2	8108.2
10°	4410.3	4446.5	4441.2	4473.0	4509.2
12.5°	2255.5	2227.2	2218.4	2254.6	2204.3
15°	1178.5	1200.6	1201.4	1180.3	1164.4
17.5°	633.8	659.4	701.8	667.4	614.4
20°	374.3	397.2	433.4	405.2	382.2
22.5°	231.3	249.8	275.4	253.4	234.8
25°	138.6	157.1	176.6	156.2	140.4
27.5°	82.1	98.0	110.3	97.1	81.2
30°	53.0	61.8	69.7	60.9	53.8
32.5°	37.1	40.6	44.1	40.6	37.1
35°	27.4	29.1	30.9	29.1	26.5
37.5°	21.2	23.0	23.8	22.1	20.3
40°	17.7	18.5	19.4	18.5	17.7
42.5°	15.0	15.9	15.9	15.9	15.0
45°	13.2	13.2	14.1	13.2	13.2
47.5°	11.5	11.5	12.4	11.5	11.5
50°	10.6	10.6	10.6	10.6	10.6
52.5°	9.7	9.7	9.7	9.7	9.7
55°	8.8	8.8	8.8	8.8	8.8
57.5°	7.9	7.9	7.9	7.9	7.9
60°	7.1	7.1	7.1	7.1	7.1
62.5°	6.2	6.2	6.2	6.2	6.2
65°	5.3	5.3	5.3	5.3	5.3
67.5°	5.3	5.3	5.3	5.3	5.3
70°	4.4	4.4	4.4	4.4	4.4
72.5°	3.5	3.5	3.5	3.5	3.5
75°	2.6	2.6	2.6	2.6	3.5
77.5°	2.6	2.6	2.6	2.6	2.6
80°	1.8	1.8	1.8	1.8	1.8
82.5°	1.8	1.8	1.8	1.8	1.8
85°	0.9	0.9	0.9	0.9	0.9
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)