

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P744642

Luminaire Tested: LD4D20D010-EU4DR6520359024-4LBDP1B

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P744642
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D20D010-EU4DR6520359024-4LBDP1B
Description: 4 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1050.0 lumens
Efficiency: N/A
Efficacy: 45.5 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 23.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P744642
CATALOG NUMBER: LD4D20D010-EU4DR6520359024-4LBDP1B

Luminous Intensity Polar Plot

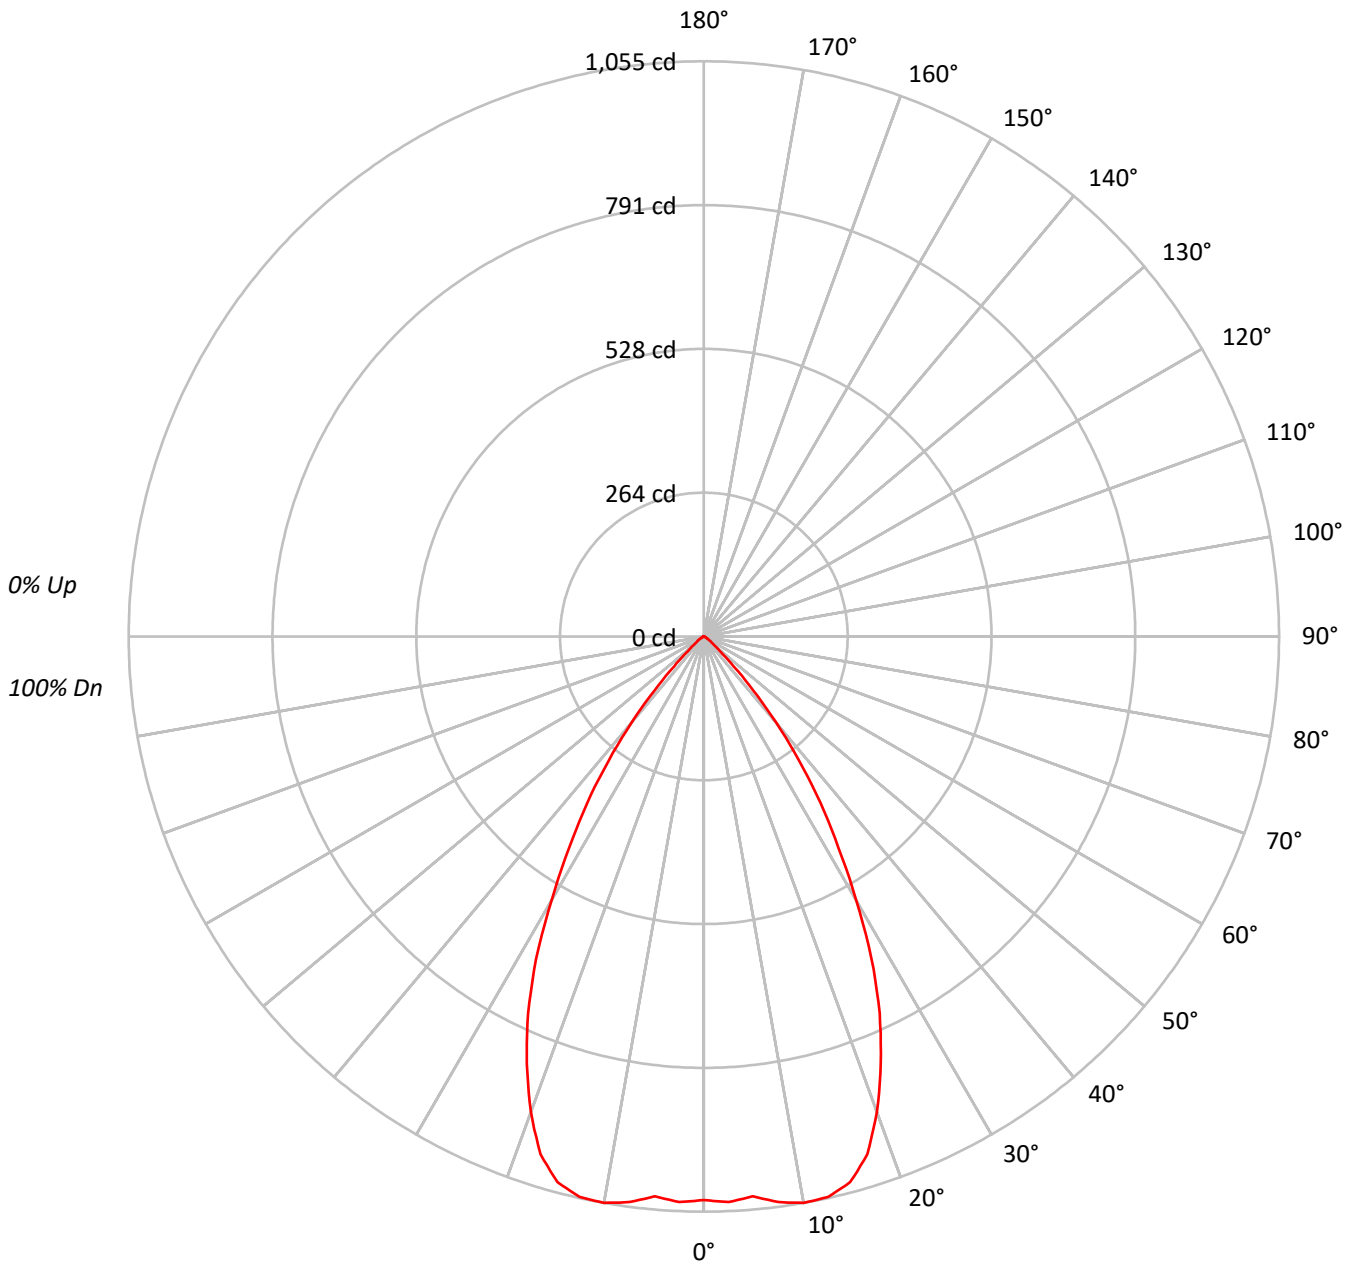



TEST NUMBER: P744642

CATALOG NUMBER: LD4D20D010-EU4DR6520359024-4LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	113	111	108	106	111	108	106	104	104	103	101		101	99	98		97	96	95	93
2	108	103	99	95	106	101	97	94	98	95	92		95	92	90		92	90	88	87
3	102	96	91	87	100	94	90	86	92	88	85		89	86	83		87	84	82	80
4	97	89	84	79	95	88	83	79	86	82	78		84	80	77		82	79	76	75
5	92	83	78	73	90	83	77	73	81	76	72		79	75	72		77	74	71	69
6	87	78	72	68	86	77	72	68	76	71	67		74	70	67		73	69	66	65
7	83	73	67	63	81	73	67	63	71	66	62		70	66	62		69	65	62	60
8	79	69	63	59	77	68	63	59	67	62	58		66	62	58		65	61	58	57
9	75	65	59	55	74	65	59	55	64	58	55		63	58	55		62	58	54	53
10	71	61	56	52	70	61	55	52	60	55	51		59	55	51		59	54	51	50

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	112954
5°	113045
10°	117037
15°	117232
20°	107924
25°	91960
30°	70399
35°	49738
40°	29353
45°	11913
50°	4317
55°	2419
60°	1377
65°	750
70°	799
75°	633
80°	629
85°	627

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 11913 cd/sqm



TEST NUMBER: P744642

CATALOG NUMBER: LD4D20D010-EU4DR6520359024-4LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	99.5	9.5
10°-20°	287.2	27.3
20°-30°	344.5	32.8
30°-40°	231.5	22.1
40°-50°	69.3	6.6
50°-60°	12.2	1.2
60°-70°	3.5	0.3
70°-80°	1.7	0.2
80°-90°	0.5	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	731.2	69.6
0°-40°	962.8	91.7
0°-60°	1044.3	99.5
0°-90°	1050.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1050.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1034	
5°	1031	100
15°	1036	287
25°	763	345
35°	373	232
45°	77	69
55°	13	12
65°	3	3
75°	2	2
85°	0	1
90°	0	



TEST NUMBER: P744642

CATALOG NUMBER: LD4D20D010-EU4DR6520359024-4LBDP1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	1033.8
2.5°	1038.2
5°	1030.7
7.5°	1046.3
10°	1054.9
12.5°	1052.8
15°	1036.4
17.5°	996.1
20°	928.2
22.5°	848.3
25°	762.8
27.5°	666.2
30°	558.0
32.5°	459.9
35°	372.9
37.5°	286.9
40°	205.8
42.5°	134.4
45°	77.1
47.5°	40.9
50°	25.4
52.5°	17.6
55°	12.7
57.5°	9.1
60°	6.3
62.5°	4.1
65°	2.9
67.5°	2.6
70°	2.5
72.5°	1.9
75°	1.5
77.5°	1.3
80°	1.0
82.5°	0.7
85°	0.5
87.5°	0.3
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)