

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P744344

Luminaire Tested: LD4D20D010-EU4DR4520359027-4LBDP1H

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P744344
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D20D010-EU4DR4520359027-4LBDP1H
Description: 4 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1829.0 lumens
Efficiency: N/A
Efficacy: 79.2 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 23.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P744344
CATALOG NUMBER: LD4D20D010-EU4DR4520359027-4LBDP1H

Luminous Intensity Polar Plot

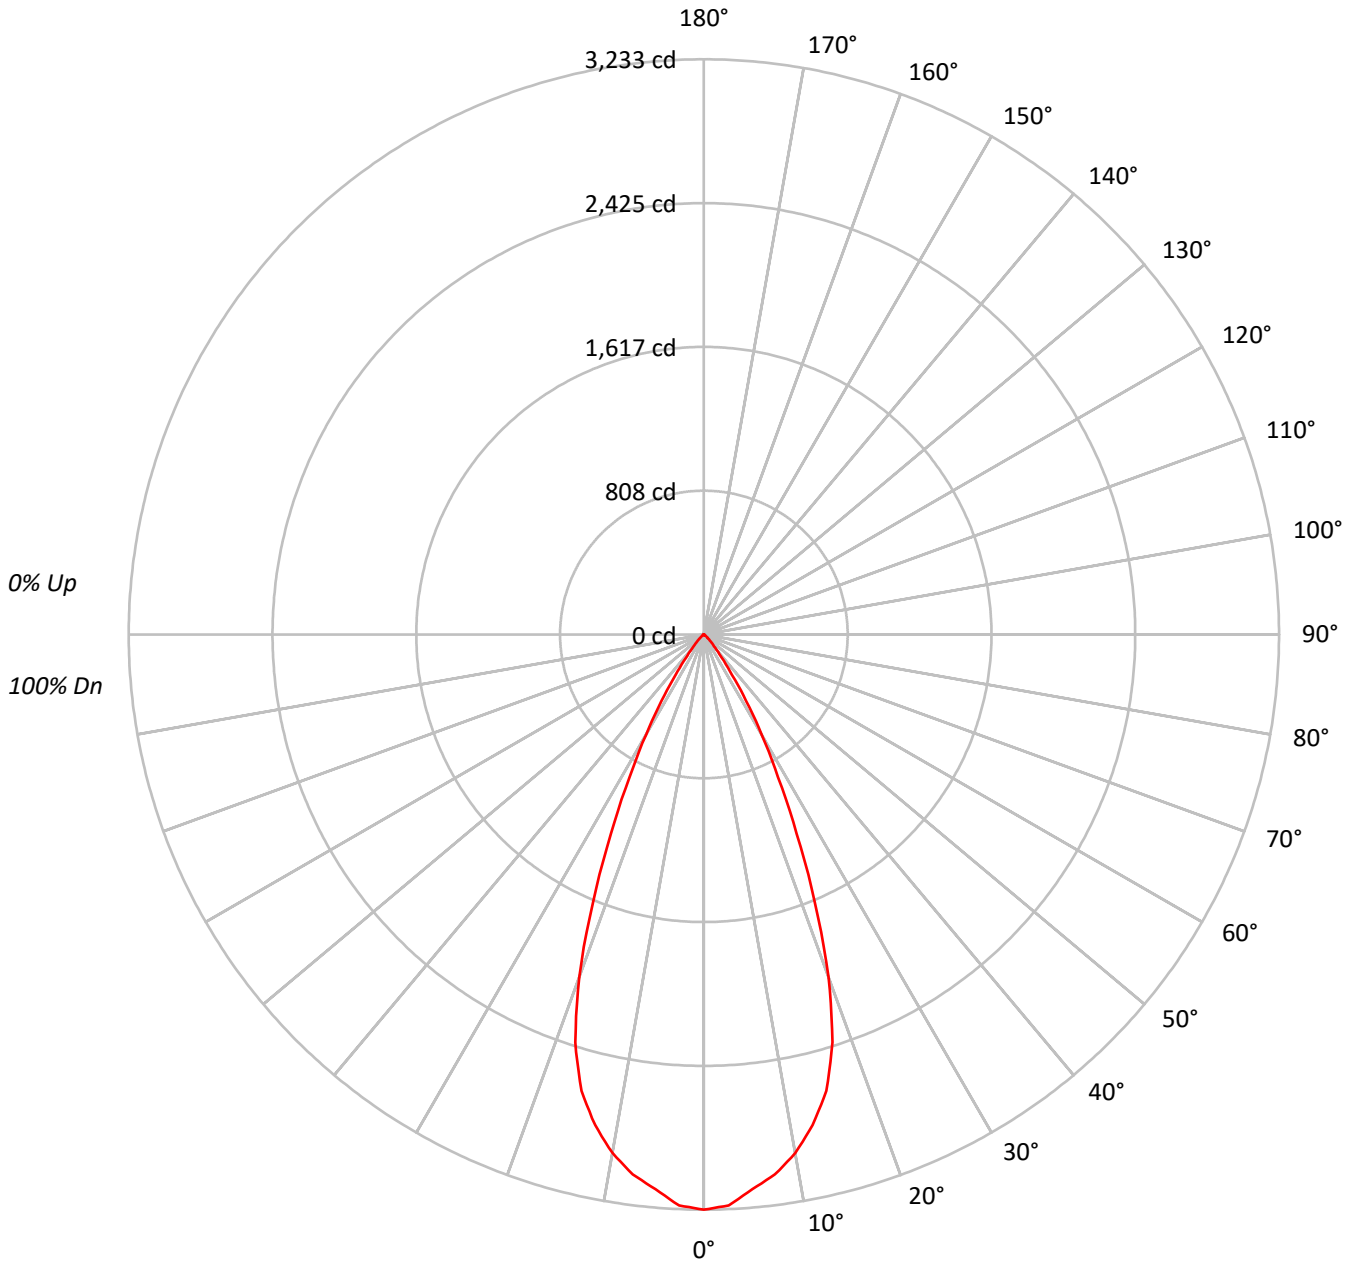



TEST NUMBER: P744344

CATALOG NUMBER: LD4D20D010-EU4DR4520359027-4LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95			95
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90			90
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85			85
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81			81
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77			77
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73			73
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69			69
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66			66
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63			63
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60			60

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	353229
5°	343172
10°	328323
15°	300479
20°	238383
25°	148826
30°	82031
35°	36840
40°	14505
45°	6830
50°	3247
55°	1695
60°	830
65°	181
70°	64
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 6830 cd/sqm



TEST NUMBER: P744344

CATALOG NUMBER: LD4D20D010-EU4DR4520359027-4LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	294.0	16.1
10°-20°	723.5	39.6
20°-30°	573.0	31.3
30°-40°	190.8	10.4
40°-50°	37.9	2.1
50°-60°	8.6	0.5
60°-70°	1.2	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1590.5	87.0
0°-40°	1781.3	97.4
0°-60°	1827.7	99.9
0°-90°	1829.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1829.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3233	
5°	3129	294
15°	2656	724
25°	1234	573
35°	276	191
45°	44	38
55°	9	9
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P744344

CATALOG NUMBER: LD4D20D010-EU4DR4520359027-4LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	3232.9
2.5°	3211.8
5°	3128.9
7.5°	3060.5
10°	2959.3
12.5°	2824.5
15°	2656.4
17.5°	2403.7
20°	2050.2
22.5°	1629.1
25°	1234.5
27.5°	903.9
30°	650.2
32.5°	442.2
35°	276.2
37.5°	163.7
40°	101.7
42.5°	66.9
45°	44.2
47.5°	28.5
50°	19.1
52.5°	12.7
55°	8.9
57.5°	5.8
60°	3.8
62.5°	2.1
65°	0.7
67.5°	0.2
70°	0.2
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)