

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P744501

Luminaire Tested: LD4D20D010-EU4DR5520359027-4LBDP1LI

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P744501
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-52)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D20D010-EU4DR5520359027-4LBDP1LI
Description: 4 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 55° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1917.5 lumens
Efficiency: N/A
Efficacy: 83.0 lumens/watt
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.87
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 23.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P744501
CATALOG NUMBER: LD4D20D010-EU4DR5520359027-4LBDP1LI

Luminous Intensity Polar Plot

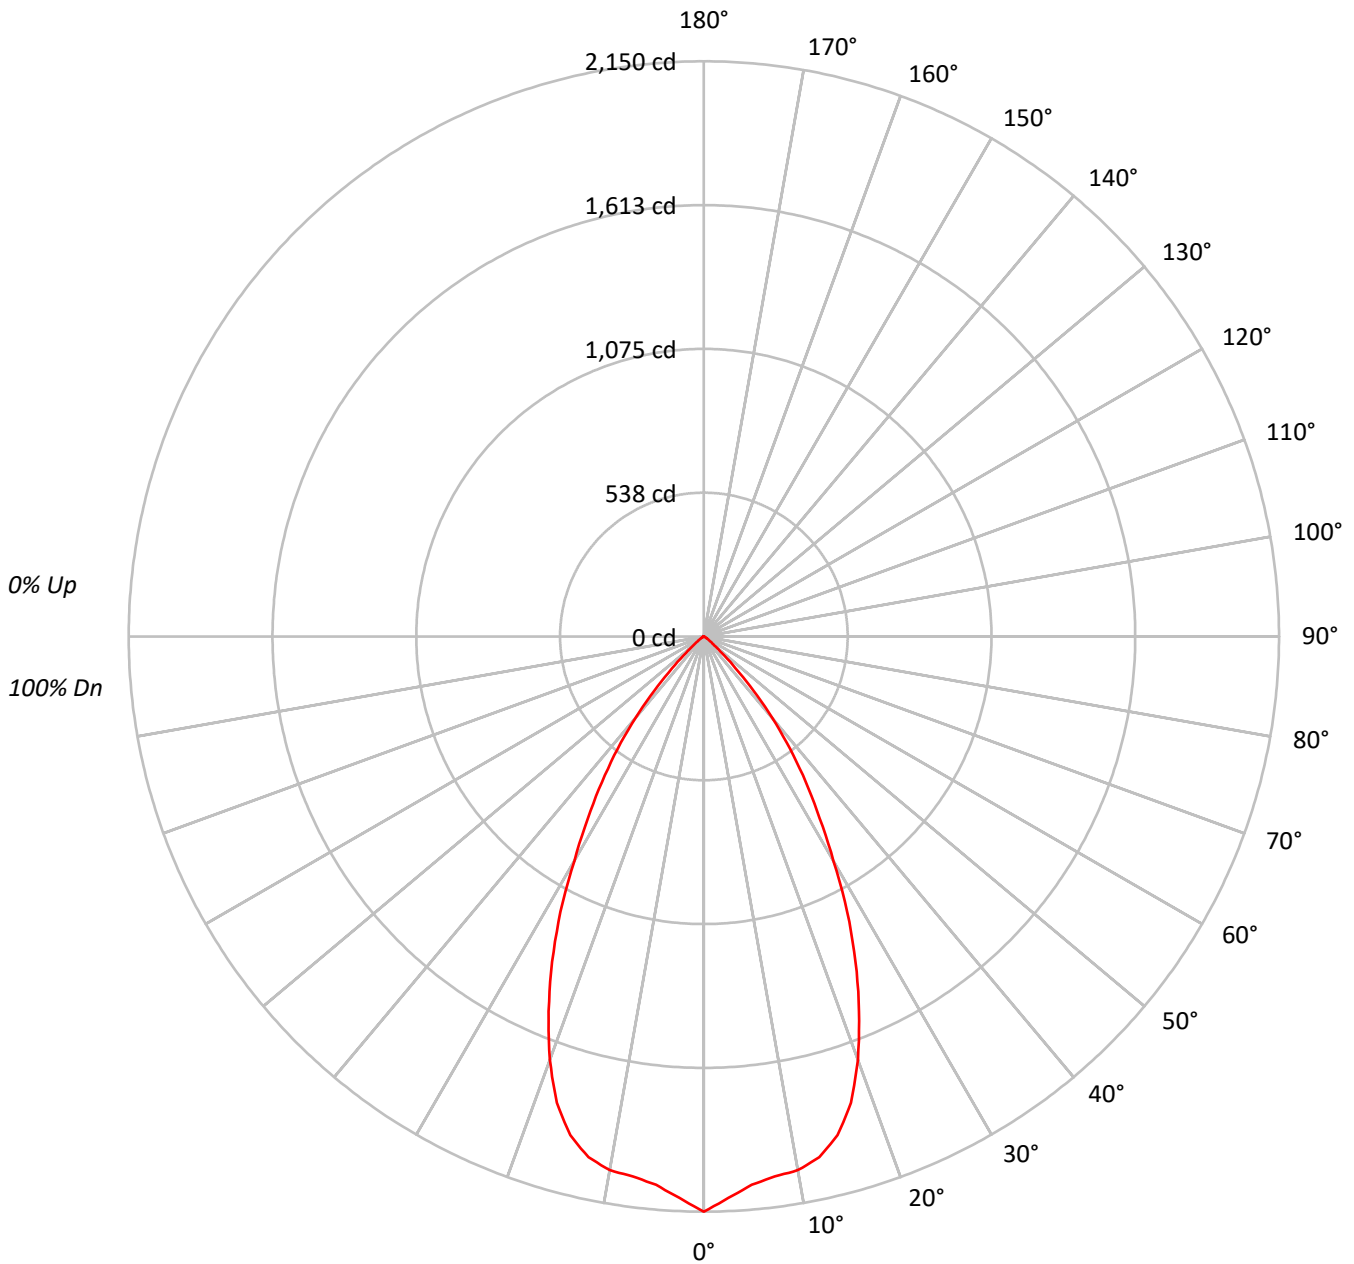



TEST NUMBER: P744501
 CATALOG NUMBER: LD4D20D010-EU4DR5520359027-4LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94			
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87			
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81			
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75			
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70			
6	88	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65			
7	83	74	68	64	82	73	67	63	72	67	63	71	66	63	70	65	62	61			
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	62	58	57			
9	75	66	60	56	74	65	59	55	64	59	55	63	58	55	62	58	55	54			
10	72	62	56	52	71	61	56	52	61	56	52	60	55	52	59	55	52	50			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	234922
5°	225586
10°	224744
15°	218289
20°	195722
25°	161750
30°	122189
35°	88593
40°	56695
45°	25897
50°	8465
55°	3657
60°	1573
65°	207
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 25897 cd/sqm



TEST NUMBER: P744501

CATALOG NUMBER: LD4D20D010-EU4DR5520359027-4LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	195.7	10.2
10°-20°	534.2	27.9
20°-30°	608.7	31.7
30°-40°	414.4	21.6
40°-50°	142.8	7.4
50°-60°	19.8	1.0
60°-70°	1.9	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1338.6	69.8
0°-40°	1753.0	91.4
0°-60°	1915.5	99.9
0°-90°	1917.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1917.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2150	
5°	2057	196
15°	1930	534
25°	1342	609
35°	664	414
45°	168	143
55°	19	20
65°	1	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P744501
CATALOG NUMBER: LD4D20D010-EU4DR5520359027-4LBDP1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	2150.1
2.5°	2100.8
5°	2056.8
7.5°	2035.2
10°	2025.7
12.5°	1993.7
15°	1929.8
17.5°	1828.2
20°	1683.3
22.5°	1516.0
25°	1341.7
27.5°	1160.3
30°	968.5
32.5°	806.0
35°	664.2
37.5°	529.4
40°	397.5
42.5°	275.5
45°	167.6
47.5°	90.3
50°	49.8
52.5°	29.6
55°	19.2
57.5°	12.3
60°	7.2
62.5°	3.2
65°	0.8
67.5°	0.3
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)