

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P744682

Luminaire Tested: LD4D20D010-EU4DR6520359035-4LBDP1H

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P744682
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D20D010-EU4DR6520359035-4LBDP1H
Description: 4 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1705.8 lumens
Efficiency: N/A
Efficacy: 73.8 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 23.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P744682
CATALOG NUMBER: LD4D20D010-EU4DR6520359035-4LBDP1H

Luminous Intensity Polar Plot

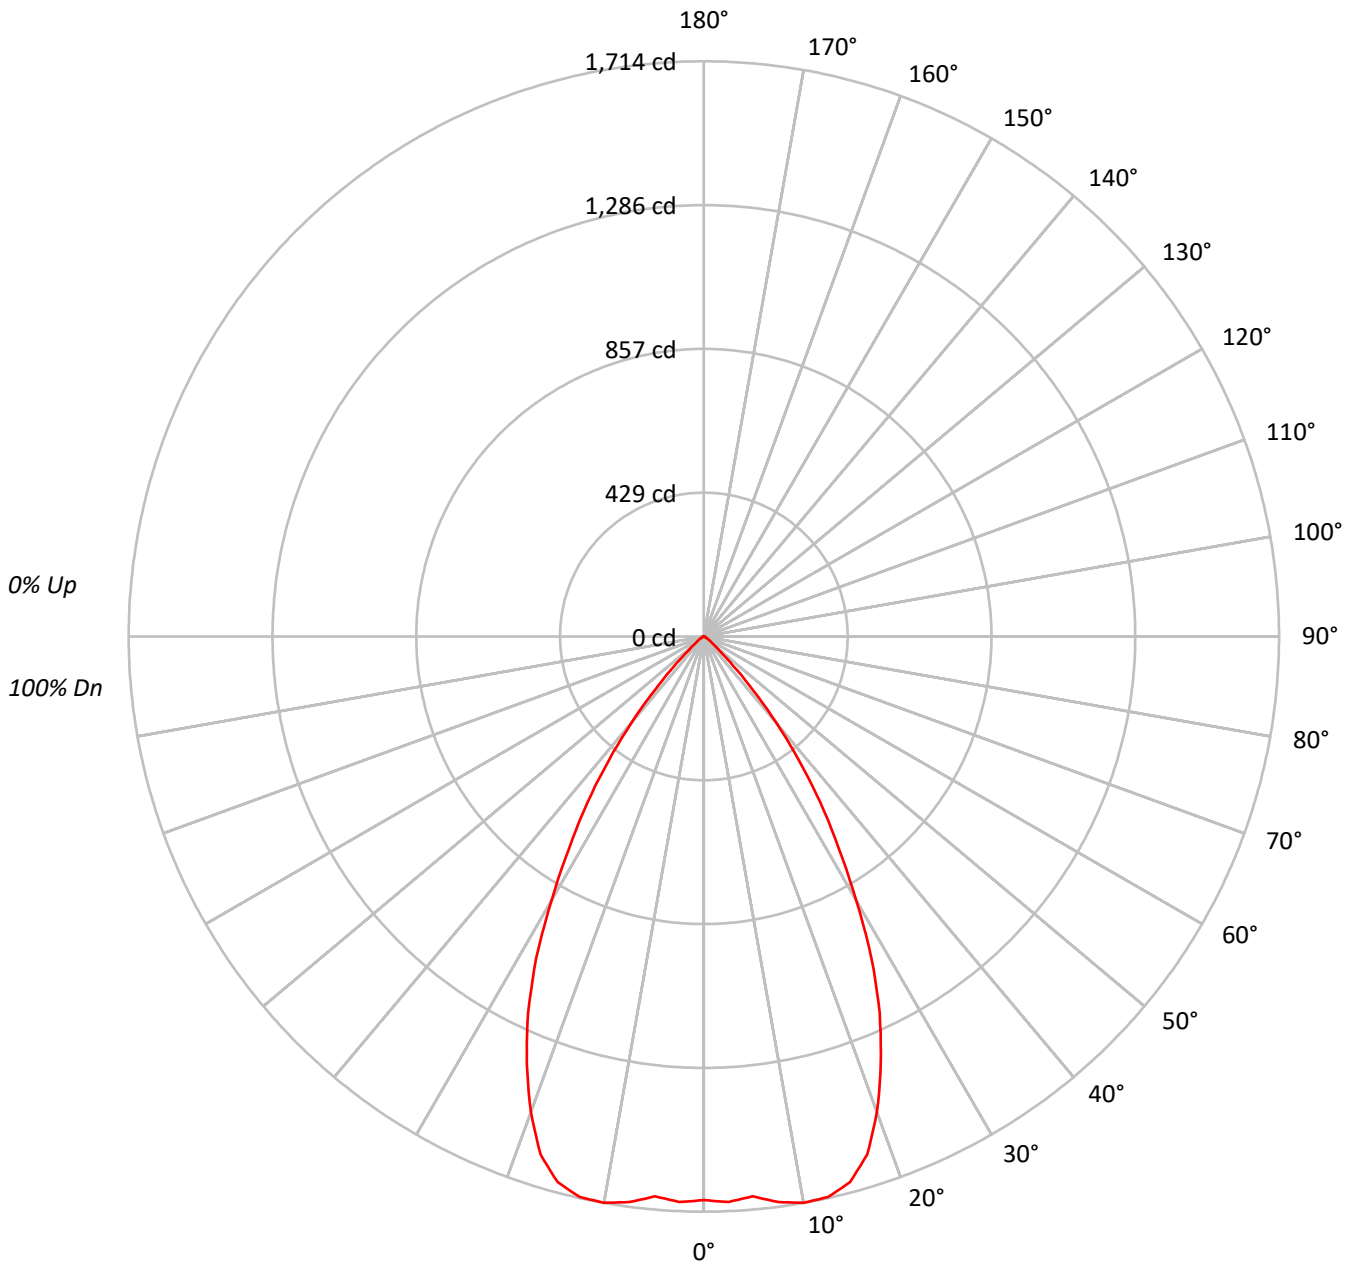



TEST NUMBER: P744682

CATALOG NUMBER: LD4D20D010-EU4DR6520359035-4LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	183493
5°	183645
10°	190106
15°	190418
20°	175316
25°	149381
30°	114355
35°	80790
40°	47695
45°	19361
50°	7020
55°	3905
60°	2251
65°	1241
70°	1310
75°	1013
80°	1070
85°	878

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 19361 cd/sqm



TEST NUMBER: P744682

CATALOG NUMBER: LD4D20D010-EU4DR6520359035-4LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	161.7	9.5
10°-20°	466.5	27.3
20°-30°	559.7	32.8
30°-40°	376.1	22.1
40°-50°	112.6	6.6
50°-60°	19.9	1.2
60°-70°	5.7	0.3
70°-80°	2.8	0.2
80°-90°	0.9	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1187.9	69.6
0°-40°	1564.0	91.7
0°-60°	1696.4	99.5
0°-90°	1705.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1705.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1679	
5°	1674	162
15°	1683	466
25°	1239	560
35°	606	376
45°	125	113
55°	20	20
65°	5	6
75°	2	3
85°	1	1
90°	0	



TEST NUMBER: P744682
CATALOG NUMBER: LD4D20D010-EU4DR6520359035-4LBDP1H

CANDELA DISTRIBUTION (FULL):

0°	
0°	1679.4
2.5°	1686.5
5°	1674.4
7.5°	1699.7
10°	1713.5
12.5°	1710.2
15°	1683.4
17.5°	1618.1
20°	1507.8
22.5°	1378.0
25°	1239.1
27.5°	1082.3
30°	906.4
32.5°	747.0
35°	605.7
37.5°	466.1
40°	334.4
42.5°	218.4
45°	125.3
47.5°	66.3
50°	41.3
52.5°	28.6
55°	20.5
57.5°	14.8
60°	10.3
62.5°	6.7
65°	4.8
67.5°	4.3
70°	4.1
72.5°	3.1
75°	2.4
77.5°	2.1
80°	1.7
82.5°	1.2
85°	0.7
87.5°	0.5
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)