

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P744619

Luminaire Tested: LD4D20D010-EU4DR6020359040-4LBDP1MW

Issue Date: 2/5/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P744619  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/5/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD4D20D010-EU4DR6020359040-4LBDP1MW  
Description: 4 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 60° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1816.8 lumens  
Efficiency: N/A  
Efficacy: 78.6 lumens/watt  
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.83  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 23.1  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight



TEST NUMBER: P744619  
CATALOG NUMBER: LD4D20D010-EU4DR6020359040-4LBDP1MW

### Luminous Intensity Polar Plot

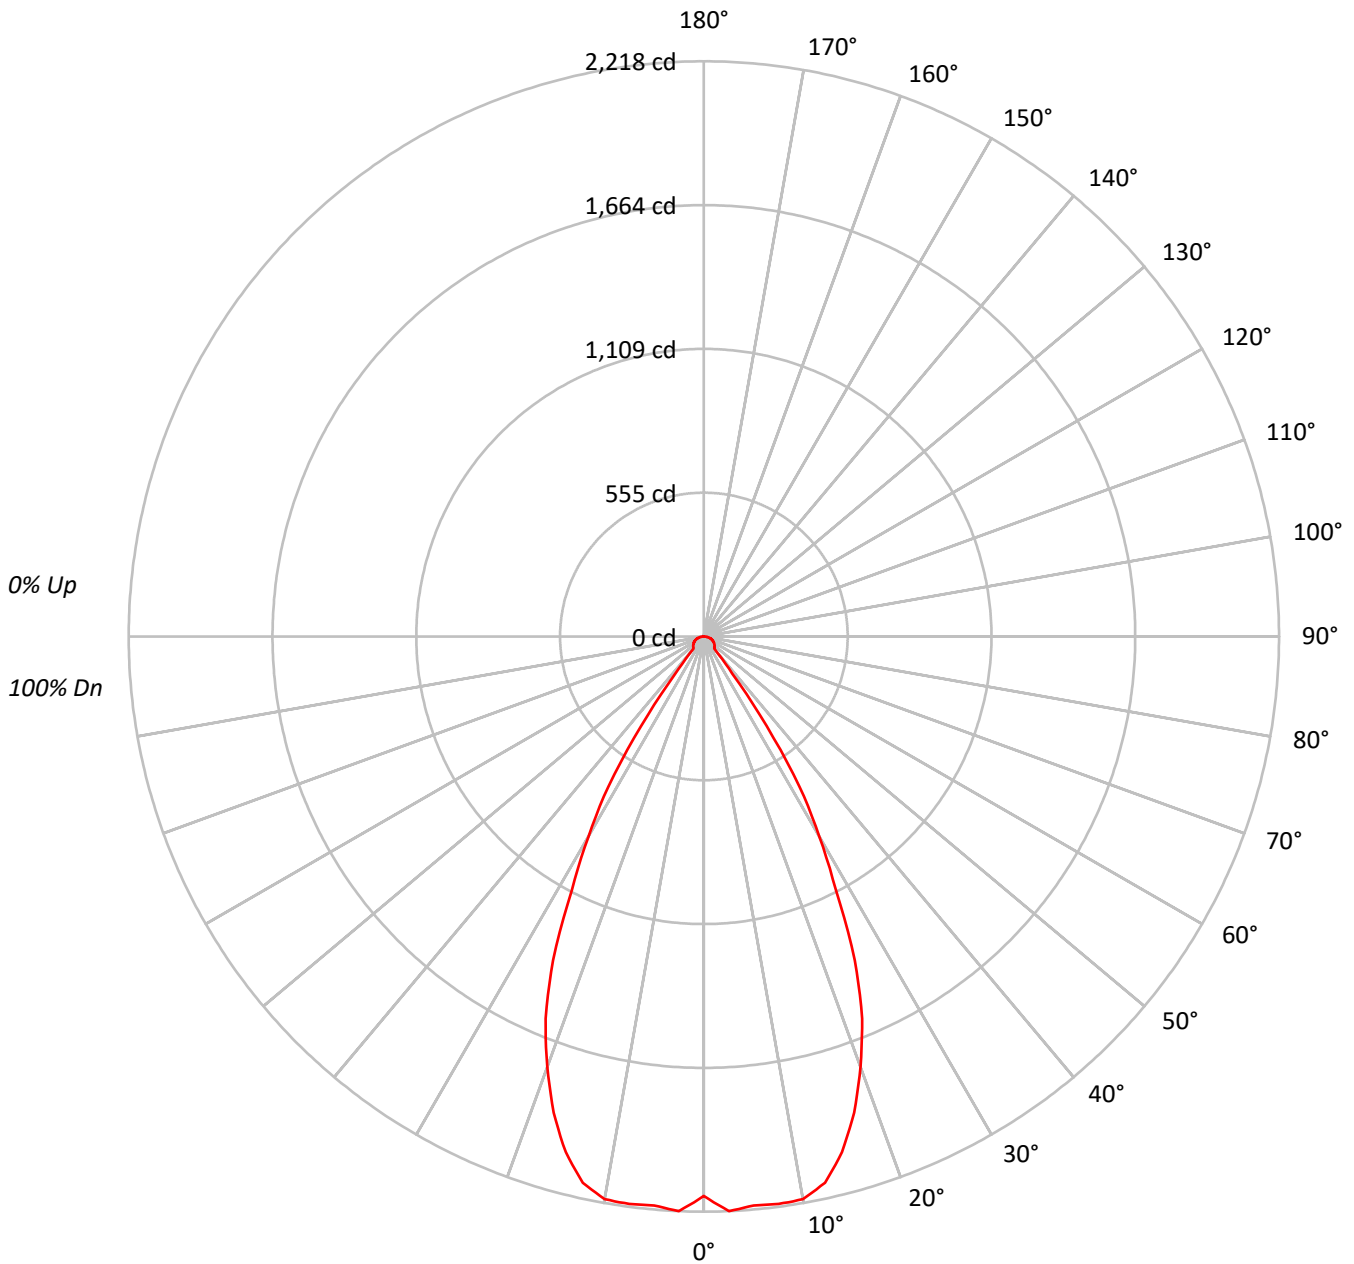



TEST NUMBER: P744619

CATALOG NUMBER: LD4D20D010-EU4DR6020359040-4LBDP1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93		
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86		
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80		
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75		
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70		
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66		
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62		
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59		
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55		
10	73	64	58	54	72	63	58	54	62	58	54	62	57	54	61	57	54	53		

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	235741
5°	241544
10°	244459
15°	232881
20°	205326
25°	166078
30°	112336
35°	56288
40°	9128
45°	8947
50°	9111
55°	9258
60°	9506
65°	9721
70°	9967
75°	10089
80°	9753
85°	8149

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 75°  
 Luminance: 10089 cd/sqm



TEST NUMBER: P744619

CATALOG NUMBER: LD4D20D010-EU4DR6020359040-4LBDP1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	210.5	11.6
10°-20°	569.5	31.3
20°-30°	612.7	33.7
30°-40°	266.3	14.7
40°-50°	44.7	2.5
50°-60°	43.5	2.4
60°-70°	37.2	2.0
70°-80°	24.9	1.4
80°-90°	7.4	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1392.7	76.7
0°-40°	1659.0	91.3
0°-60°	1747.2	96.2
0°-90°	1816.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1816.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2158	
5°	2202	210
15°	2059	569
25°	1378	613
35°	422	266
45°	58	45
55°	49	44
65°	38	37
75°	24	25
85°	6	7
90°	0	



TEST NUMBER: P744619

CATALOG NUMBER: LD4D20D010-EU4DR6020359040-4LBDP1MW

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	2157.6
2.5°	2218.3
5°	2202.3
7.5°	2207.4
10°	2203.4
12.5°	2157.9
15°	2058.8
17.5°	1925.7
20°	1765.9
22.5°	1594.9
25°	1377.6
27.5°	1101.8
30°	890.4
32.5°	686.3
35°	422.0
37.5°	180.5
40°	64.0
42.5°	59.0
45°	57.9
47.5°	55.9
50°	53.6
52.5°	51.1
55°	48.6
57.5°	46.1
60°	43.5
62.5°	40.7
65°	37.6
67.5°	34.5
70°	31.2
72.5°	27.5
75°	23.9
77.5°	19.7
80°	15.5
82.5°	10.9
85°	6.5
87.5°	2.2
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)