

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P739606

Luminaire Tested: LD4D02D010-EU4DR650210IC9024-4LBDP1LI

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P739606
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D02D010-EU4DR650210IC9024-4LBDP1LI
Description: 4 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 279.8 lumens
Efficiency: N/A
Efficacy: 54.9 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P739606

CATALOG NUMBER: LD4D02D010-EU4DR650210IC9024-4LBDP1LI

Luminous Intensity Polar Plot

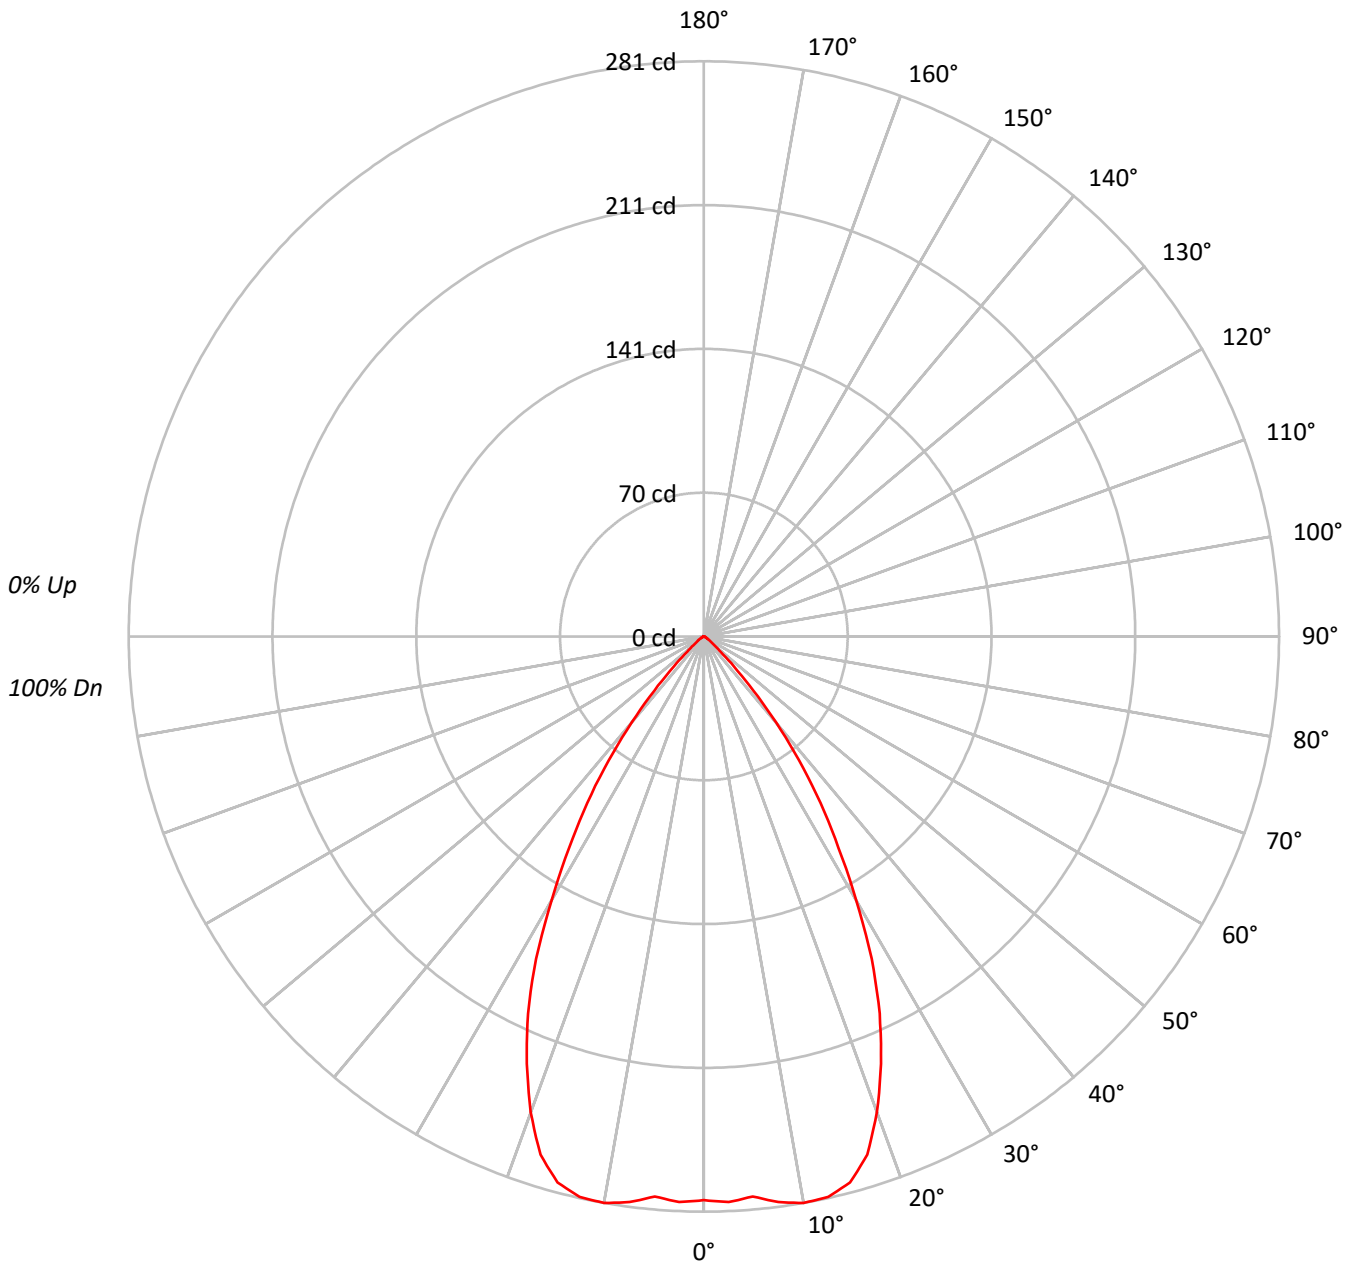



TEST NUMBER: P739606

CATALOG NUMBER: LD4D02D010-EU4DR650210IC9024-4LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	30090
5°	30118
10°	31176
15°	31231
20°	28754
25°	24497
30°	18761
35°	13245
40°	7816
45°	3183
50°	1156
55°	648
60°	371
65°	207
70°	224
75°	169
80°	189
85°	125

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 3183 cd/sqm



TEST NUMBER: P739606

CATALOG NUMBER: LD4D02D010-EU4DR650210IC9024-4LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	26.5	9.5
10°-20°	76.5	27.3
20°-30°	91.8	32.8
30°-40°	61.7	22.0
40°-50°	18.5	6.6
50°-60°	3.3	1.2
60°-70°	0.9	0.3
70°-80°	0.4	0.2
80°-90°	0.1	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	194.8	69.6
0°-40°	256.5	91.7
0°-60°	278.2	99.5
0°-90°	279.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	279.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	275	
5°	275	27
15°	276	77
25°	203	92
35°	99	62
45°	21	18
55°	3	3
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P739606

CATALOG NUMBER: LD4D02D010-EU4DR650210IC9024-4LBDP1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	275.4
2.5°	276.6
5°	274.6
7.5°	278.7
10°	281.0
12.5°	280.5
15°	276.1
17.5°	265.4
20°	247.3
22.5°	226.0
25°	203.2
27.5°	177.5
30°	148.7
32.5°	122.5
35°	99.3
37.5°	76.4
40°	54.8
42.5°	35.8
45°	20.6
47.5°	10.9
50°	6.8
52.5°	4.7
55°	3.4
57.5°	2.4
60°	1.7
62.5°	1.1
65°	0.8
67.5°	0.7
70°	0.7
72.5°	0.5
75°	0.4
77.5°	0.3
80°	0.3
82.5°	0.2
85°	0.1
87.5°	0.1
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)