

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P739673

Luminaire Tested: LD4D02D010-EU4DR650210IC9050-4LBS1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P739673
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D02D010-EU4DR650210IC9050-4LBS1B
Description: 4 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 320.0 lumens
Efficiency: N/A
Efficacy: 62.7 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P739673
CATALOG NUMBER: LD4D02D010-EU4DR650210IC9050-4LBS1B

Luminous Intensity Polar Plot

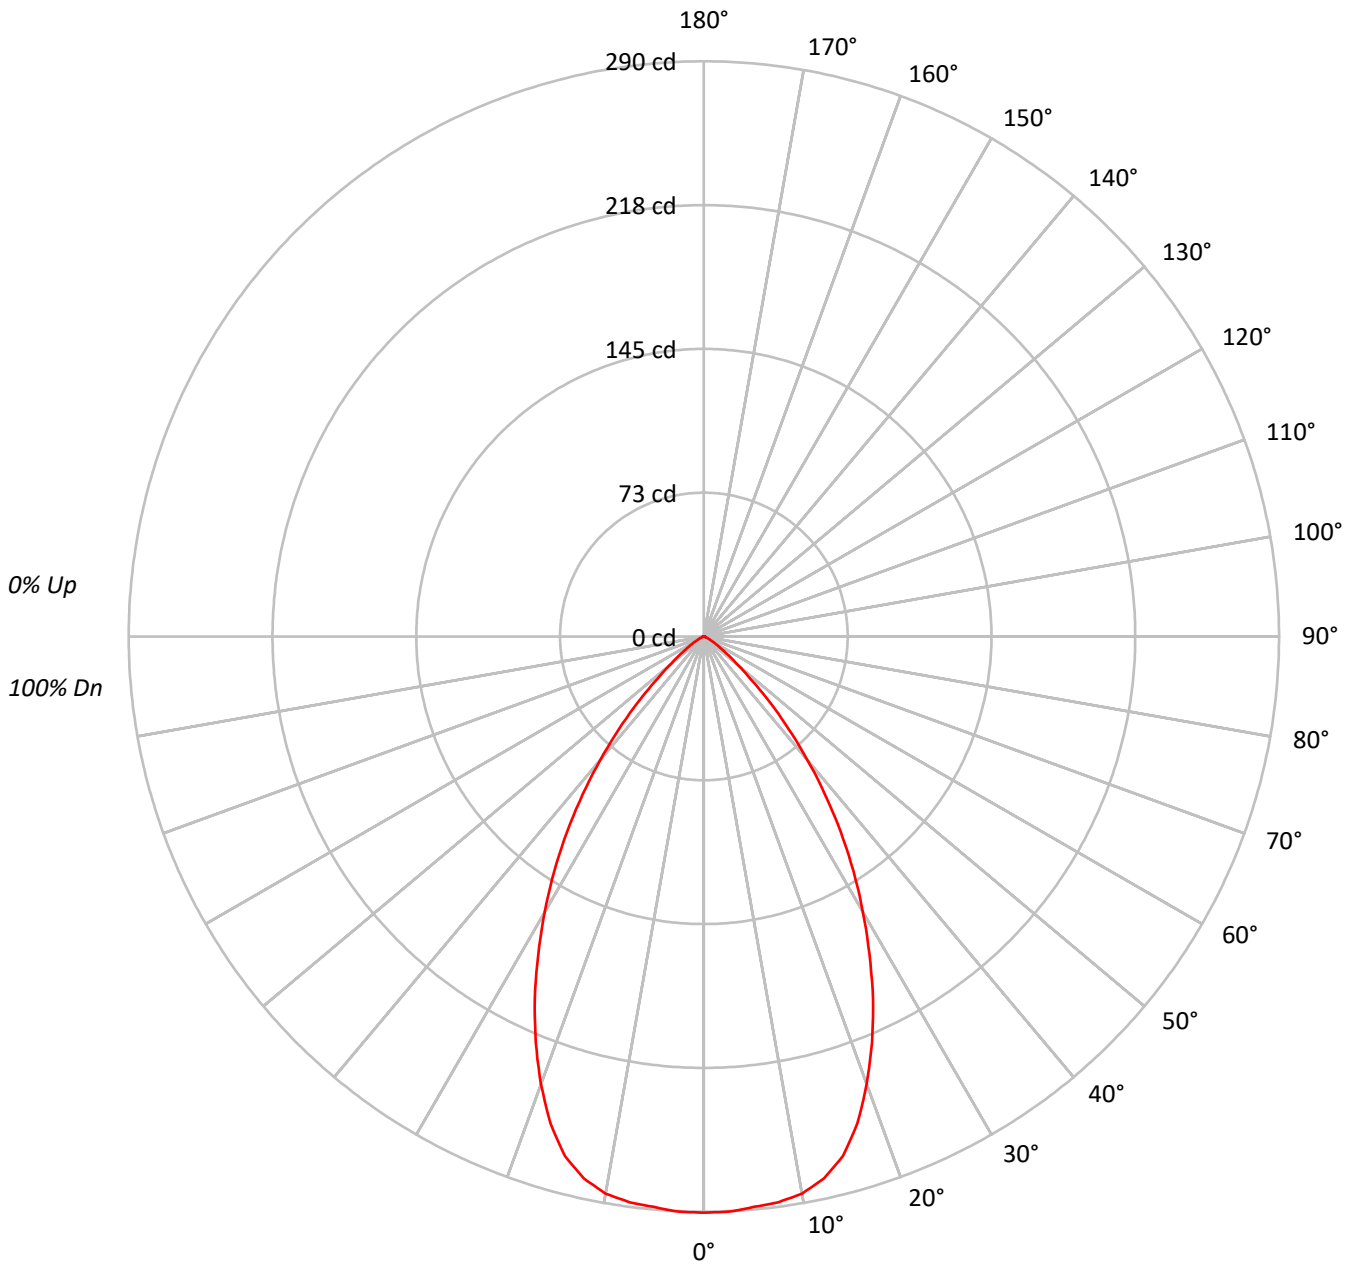



TEST NUMBER: P739673

CATALOG NUMBER: LD4D02D010-EU4DR650210IC9050-4LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	105	111	108	106	103	104	102	100	100	99	97	97	95	94	93	93	93	93
2	107	102	97	94	105	100	96	92	97	93	90	94	91	89	91	89	87	85	85	85	85
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78	78	78	78
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72	72	72	72
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66	66	66	66
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61	61	61	61
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56	56	56	56
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52	52	52	52
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49	49	49	49
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46	46	46	46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	16966
5°	16926
10°	16914
15°	16392
20°	14923
25°	13004
30°	10817
35°	8570
40°	6183
45°	3907
50°	2035
55°	1090
60°	572
65°	304
70°	120
75°	135
80°	101
85°	67

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 3907 cd/sqm



TEST NUMBER: P739673

CATALOG NUMBER: LD4D02D010-EU4DR650210IC9050-4LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	27.5	8.6
10°-20°	75.2	23.5
20°-30°	92.0	28.7
30°-40°	74.6	23.3
40°-50°	37.2	11.6
50°-60°	10.4	3.3
60°-70°	2.3	0.7
70°-80°	0.6	0.2
80°-90°	0.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	194.7	60.8
0°-40°	269.3	84.2
0°-60°	316.9	99.0
0°-90°	320.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	320.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	290	
5°	289	27
15°	271	75
25°	202	92
35°	120	75
45°	47	37
55°	11	10
65°	2	2
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P739673
CATALOG NUMBER: LD4D02D010-EU4DR650210IC9050-4LBS1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	290.5
2.5°	290.3
5°	288.7
7.5°	287.7
10°	285.2
12.5°	279.8
15°	271.1
17.5°	257.3
20°	240.1
22.5°	221.4
25°	201.8
27.5°	180.7
30°	160.4
32.5°	140.3
35°	120.2
37.5°	100.2
40°	81.1
42.5°	63.3
45°	47.3
47.5°	32.9
50°	22.4
52.5°	15.5
55°	10.7
57.5°	7.2
60°	4.9
62.5°	3.4
65°	2.2
67.5°	1.1
70°	0.7
72.5°	0.7
75°	0.6
77.5°	0.4
80°	0.3
82.5°	0.2
85°	0.1
87.5°	0.1
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)