

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P744879

Luminaire Tested: LD4D25D010-EU4DR2015309024-4LBDP1MW

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P744879  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD4D25D010-EU4DR2015309024-4LBDP1MW  
Description: 4 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 20° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2030.2 lumens  
Efficiency: N/A  
Efficacy: 80.9 lumens/watt  
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 25.1  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight



TEST NUMBER: P744879

CATALOG NUMBER: LD4D25D010-EU4DR2015309024-4LBDP1MW

### Luminous Intensity Polar Plot

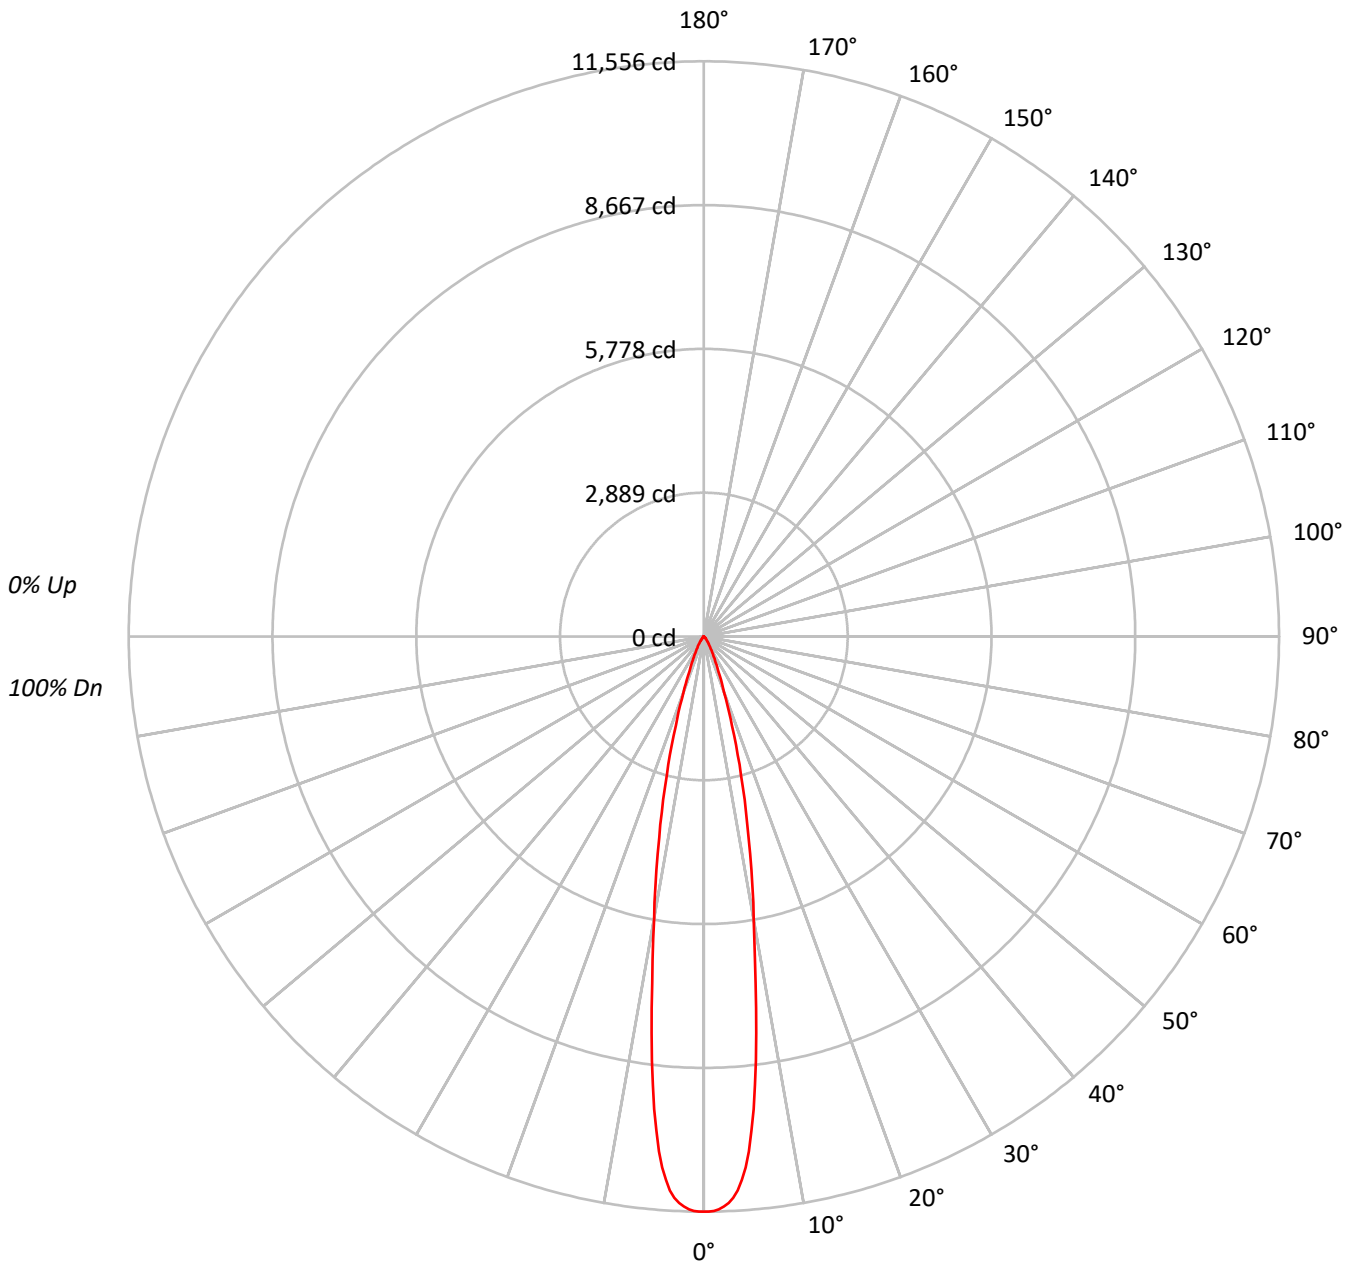



TEST NUMBER: P744879

CATALOG NUMBER: LD4D25D010-EU4DR2015309024-4LBDP1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	98	96	95	94															
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	98	96	95	94															
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	95	93	92	91															
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	93	91	89	88															
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	91	88	86	85															
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	88	86	84	83															
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	86	84	82	81															
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	84	82	80	79															
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	82	80	78	77															
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	81	78	76	75															

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1262563
5°	1139073
10°	639306
15°	324968
20°	137586
25°	63509
30°	33623
35°	18113
40°	9685
45°	5717
50°	3332
55°	1772
60°	1114
65°	801
70°	319
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 5717 cd/sqm



TEST NUMBER: P744879

CATALOG NUMBER: LD4D25D010-EU4DR2015309024-4LBDP1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	822.7	40.5
10°-20°	810.1	39.9
20°-30°	264.6	13.0
30°-40°	90.1	4.4
40°-50°	30.3	1.5
50°-60°	9.1	0.4
60°-70°	3.0	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1897.5	93.5
0°-40°	1987.6	97.9
0°-60°	2027.0	99.8
0°-90°	2030.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2030.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	11556	
5°	10386	823
15°	2873	810
25°	527	265
35°	136	90
45°	37	30
55°	9	9
65°	3	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P744879

CATALOG NUMBER: LD4D25D010-EU4DR2015309024-4LBDP1MW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	11555.5
0.5°	11555.5
1°	11541.1
1.5°	11512.3
2°	11459.8
2.5°	11389.9
3°	11291.1
3.5°	11153.2
4°	10948.4
4.5°	10699.4
5°	10385.6
5.5°	9972.9
6°	9550.0
6.5°	9065.4
7°	8591.0
7.5°	8035.4
8°	7539.4
8.5°	7040.3
9°	6579.3
9.5°	6156.4
10°	5762.3
12.5°	4137.6
15°	2872.9
17.5°	1876.9
20°	1183.3
22.5°	766.6
25°	526.8
27.5°	370.4
30°	266.5
32.5°	191.4
35°	135.8
37.5°	94.7
40°	67.9
42.5°	49.4
45°	37.0
47.5°	28.8
50°	19.6
52.5°	12.3
55°	9.3
57.5°	7.2
60°	5.1
62.5°	4.1
65°	3.1



TEST NUMBER: P744879

CATALOG NUMBER: LD4D25D010-EU4DR2015309024-4LBDP1MW

**CANDELA DISTRIBUTION (continued):**

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



67.5°		2.1
70°		1.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)