

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P744818

Luminaire Tested: LD4D25D010-EU4DR1515309027-4LBS1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P744818
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D25D010-EU4DR1515309027-4LBS1MW
Description: 4 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2330.6 lumens
Efficiency: N/A
Efficacy: 92.9 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 25.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P744818
CATALOG NUMBER: LD4D25D010-EU4DR1515309027-4LBS1MW

Luminous Intensity Polar Plot

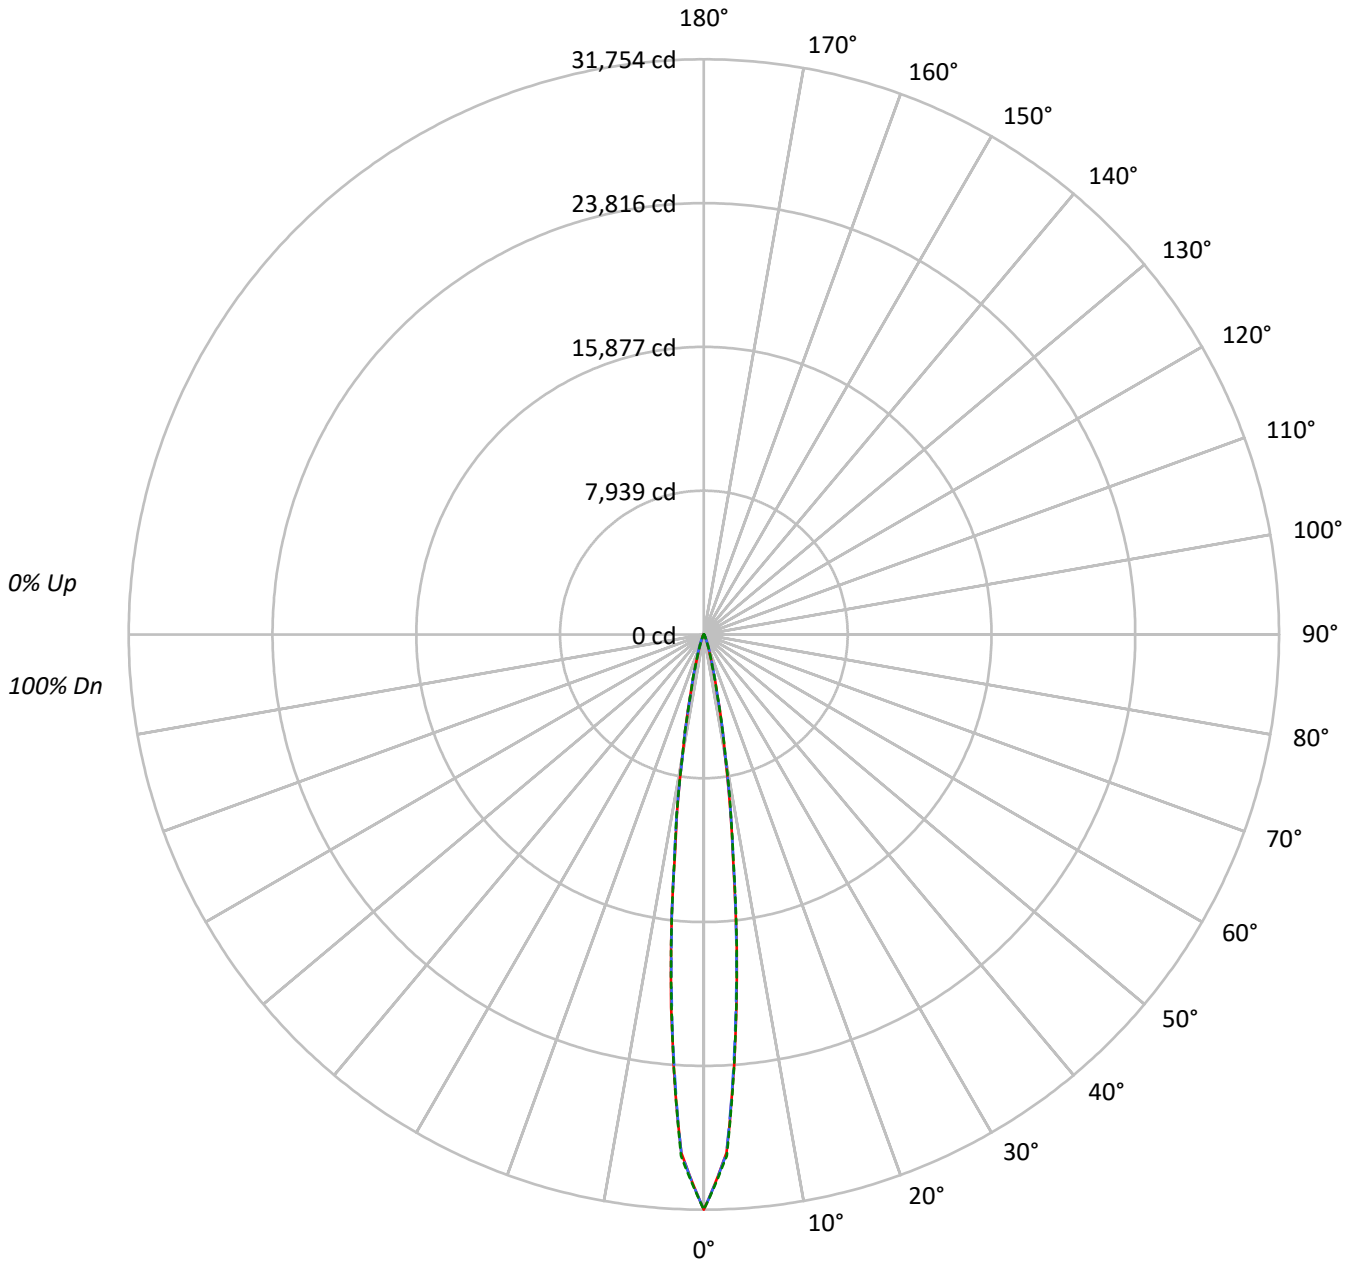



TEST NUMBER: P744818

CATALOG NUMBER: LD4D25D010-EU4DR1515309027-4LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98						98													
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96						96													
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94						94													
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93						93													
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92						92													
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90						90													
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89						89													
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88						88													
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	88	87						87													
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86						86													

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3572981	3572981	3572981
5°	2099653	2072467	2088860
10°	626644	631039	640697
15°	155873	158905	154006
20°	46639	54003	47629
25°	16437	20948	16647
30°	6043	7952	6140
35°	3028	3413	2927
40°	1910	2102	1910
45°	1414	1505	1414
50°	1120	1120	1120
55°	933	933	933
60°	758	758	758
65°	578	578	578
70°	490	490	490
75°	302	302	408
80°	213	213	213
85°	108	108	108

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°
 Vertical Angle: 45°
 Luminance: 1505 cd/sqm



TEST NUMBER: P744818

CATALOG NUMBER: LD4D25D010-EU4DR1515309027-4LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1511.6	64.9
10°-20°	621.8	26.7
20°-30°	123.5	5.3
30°-40°	30.8	1.3
40°-50°	16.2	0.7
50°-60°	12.0	0.5
60°-70°	8.5	0.4
70°-80°	4.8	0.2
80°-90°	1.5	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2256.8	96.8
0°-40°	2287.6	98.2
0°-60°	2315.9	99.4
0°-90°	2330.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2330.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	31754	31754	31754	31754	31754	
5°	20660	20448	20392	20534	20554	1509
15°	1795	1828	1830	1797	1773	615
25°	211	239	269	238	214	111
35°	42	44	47	44	40	28
45°	20	20	22	20	20	16
55°	13	13	13	13	13	12
65°	8	8	8	8	8	9
75°	4	4	4	4	5	5
85°	1	1	1	1	1	1
90°	0	0	0	0	0	



TEST NUMBER: P744818

CATALOG NUMBER: LD4D25D010-EU4DR1515309027-4LBS1MW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	31754.2	31754.2	31754.2	31754.2	31754.2
2.5°	28643.6	28667.8	28677.2	28705.4	28810.3
5°	20660.0	20447.6	20392.5	20533.6	20553.8
7.5°	12238.2	12281.2	12438.5	12473.4	12347.1
10°	6715.9	6771.1	6763.0	6811.4	6866.5
12.5°	3434.6	3391.6	3378.1	3433.3	3356.6
15°	1794.6	1828.2	1829.5	1797.3	1773.1
17.5°	965.2	1004.2	1068.7	1016.3	935.6
20°	570.0	604.9	660.0	617.0	582.1
22.5°	352.2	380.4	419.4	385.8	357.6
25°	211.0	239.3	268.9	237.9	213.7
27.5°	125.0	149.2	168.0	147.9	123.7
30°	80.7	94.1	106.2	92.8	82.0
32.5°	56.5	61.8	67.2	61.8	56.5
35°	41.7	44.4	47.0	44.4	40.3
37.5°	32.3	35.0	36.3	33.6	30.9
40°	26.9	28.2	29.6	28.2	26.9
42.5°	22.9	24.2	24.2	24.2	22.9
45°	20.2	20.2	21.5	20.2	20.2
47.5°	17.5	17.5	18.8	17.5	17.5
50°	16.1	16.1	16.1	16.1	16.1
52.5°	14.8	14.8	14.8	14.8	14.8
55°	13.4	13.4	13.4	13.4	13.4
57.5°	12.1	12.1	12.1	12.1	12.1
60°	10.8	10.8	10.8	10.8	10.8
62.5°	9.4	9.4	9.4	9.4	9.4
65°	8.1	8.1	8.1	8.1	8.1
67.5°	8.1	8.1	8.1	8.1	8.1
70°	6.7	6.7	6.7	6.7	6.7
72.5°	5.4	5.4	5.4	5.4	5.4
75°	4.0	4.0	4.0	4.0	5.4
77.5°	4.0	4.0	4.0	4.0	4.0
80°	2.7	2.7	2.7	2.7	2.7
82.5°	2.7	2.7	2.7	2.7	2.7
85°	1.3	1.3	1.3	1.3	1.3
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)