

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P745519

Luminaire Tested: LD4D25D010-EU4DR6020359027-4LBS1LI

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P745519
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-60)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D25D010-EU4DR6020359027-4LBS1LI
Description: 4 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2557.8 lumens
Efficiency: N/A
Efficacy: 101.9 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 25.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P745519
CATALOG NUMBER: LD4D25D010-EU4DR6020359027-4LBS1LI

Luminous Intensity Polar Plot

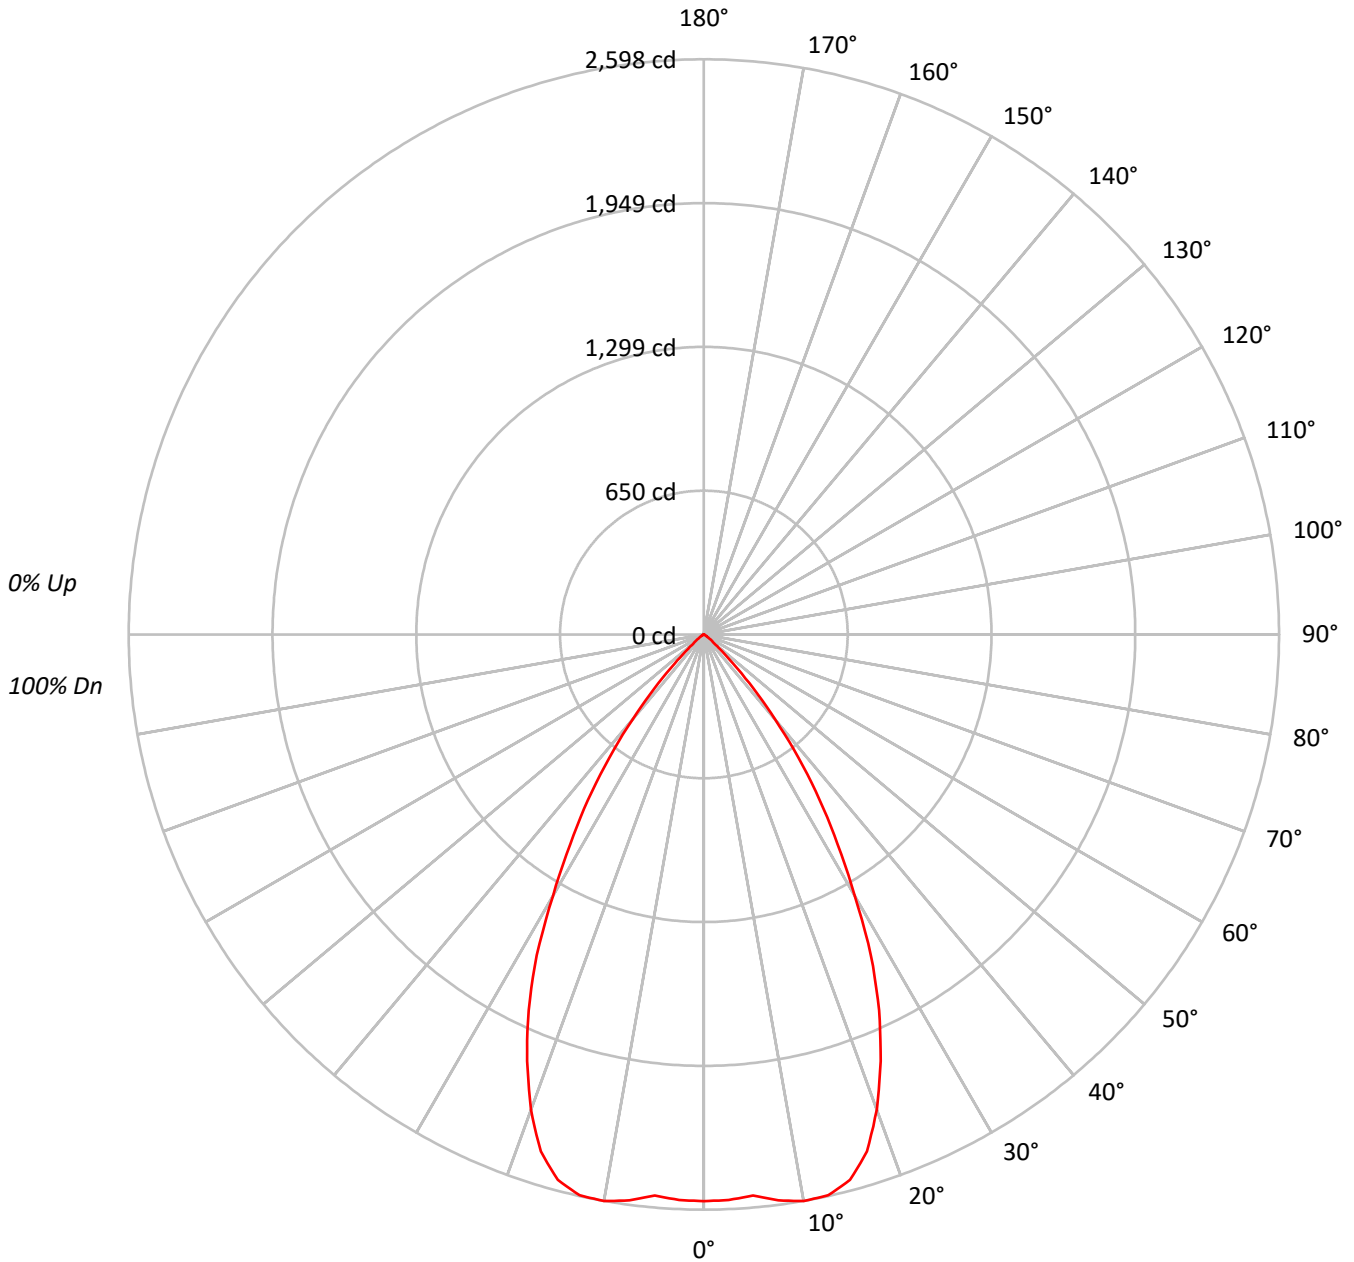



TEST NUMBER: P745519

CATALOG NUMBER: LD4D25D010-EU4DR6020359027-4LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94																			
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87																			
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81																			
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75																			
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70																			
6	87	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65																			
7	83	74	68	63	82	73	67	63	72	67	63	71	66	63	69	65	62	61																			
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	61	58	57																			
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53																			
10	72	62	56	52	71	61	56	52	61	55	52	60	55	52	59	55	52	50																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	279675
5°	278988
10°	288261
15°	288557
20°	265497
25°	225825
30°	172074
35°	121685
40°	71458
45°	28833
50°	9621
55°	4648
60°	1901
65°	284
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 28833 cd/sqm



TEST NUMBER: P745519

CATALOG NUMBER: LD4D25D010-EU4DR6020359027-4LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	245.4	9.6
10°-20°	706.7	27.6
20°-30°	845.8	33.1
30°-40°	565.7	22.1
40°-50°	167.7	6.6
50°-60°	24.1	0.9
60°-70°	2.3	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1797.9	70.3
0°-40°	2363.7	92.4
0°-60°	2555.5	99.9
0°-90°	2557.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2557.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2560	
5°	2544	245
15°	2551	707
25°	1873	846
35°	912	566
45°	187	168
55°	24	24
65°	1	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P745519

CATALOG NUMBER: LD4D25D010-EU4DR6020359027-4LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	2559.7
2.5°	2556.4
5°	2543.7
7.5°	2578.2
10°	2598.2
12.5°	2594.6
15°	2551.0
17.5°	2448.3
20°	2283.4
22.5°	2085.6
25°	1873.2
27.5°	1634.0
30°	1363.9
32.5°	1122.8
35°	912.3
37.5°	701.3
40°	501.0
42.5°	330.4
45°	186.6
47.5°	95.5
50°	56.6
52.5°	36.7
55°	24.4
57.5°	15.6
60°	8.7
62.5°	3.6
65°	1.1
67.5°	0.3
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)