

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P745319

Luminaire Tested: LD4D25D010-EU4DR4520359040-4LBDP1H

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P745319
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D25D010-EU4DR4520359040-4LBDP1H
Description: 4 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2647.6 lumens
Efficiency: N/A
Efficacy: 105.5 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 25.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P745319
CATALOG NUMBER: LD4D25D010-EU4DR4520359040-4LBDP1H

Luminous Intensity Polar Plot

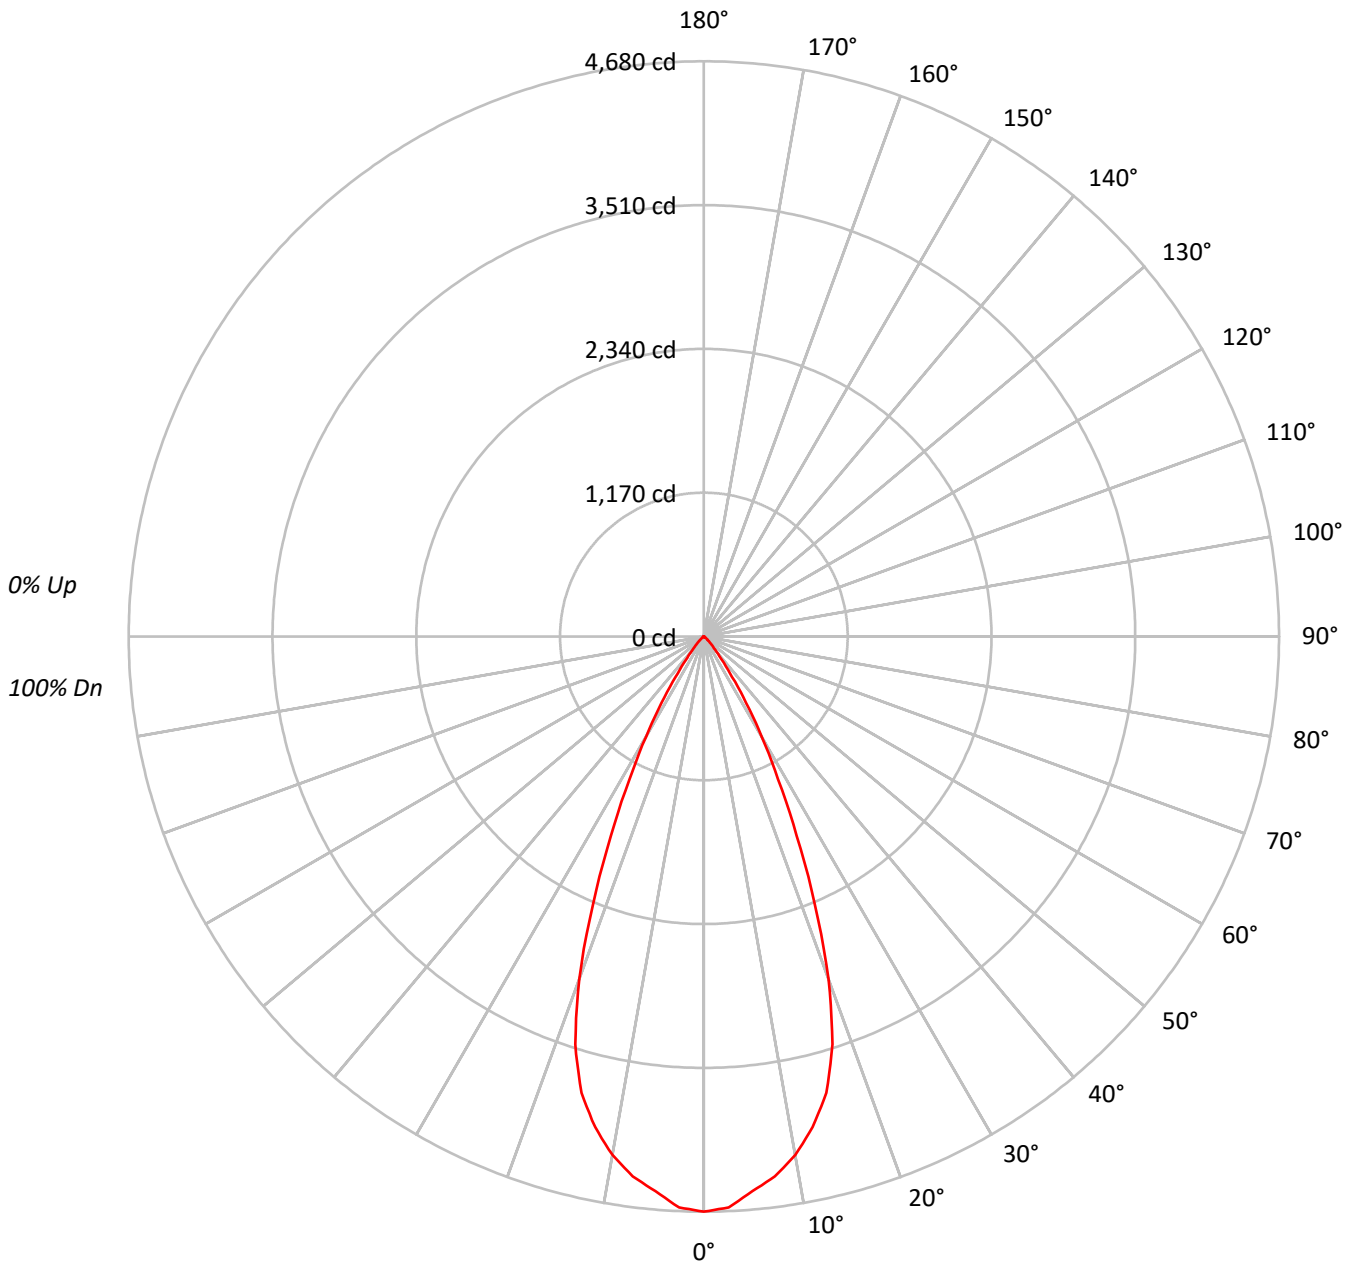



TEST NUMBER: P745319

CATALOG NUMBER: LD4D25D010-EU4DR4520359040-4LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95		
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90		
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85		
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81		
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77		
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73		
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69		
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66		
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63		
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	511308
5°	496743
10°	475249
15°	434950
20°	345075
25°	215433
30°	118745
35°	53313
40°	20995
45°	9905
50°	4691
55°	2457
60°	1202
65°	284
70°	96
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 9905 cd/sqm



TEST NUMBER: P745319

CATALOG NUMBER: LD4D25D010-EU4DR4520359040-4LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	425.6	16.1
10°-20°	1047.3	39.6
20°-30°	829.4	31.3
30°-40°	276.2	10.4
40°-50°	54.8	2.1
50°-60°	12.5	0.5
60°-70°	1.8	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2302.3	87.0
0°-40°	2578.5	97.4
0°-60°	2645.8	99.9
0°-90°	2647.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2647.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4680	
5°	4529	426
15°	3845	1047
25°	1787	829
35°	400	276
45°	64	55
55°	13	12
65°	1	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P745319
CATALOG NUMBER: LD4D25D010-EU4DR4520359040-4LBDP1H

CANDELA DISTRIBUTION (FULL):

0°	
0°	4679.7
2.5°	4649.2
5°	4529.1
7.5°	4430.1
10°	4283.6
12.5°	4088.6
15°	3845.2
17.5°	3479.4
20°	2967.8
22.5°	2358.3
25°	1787.0
27.5°	1308.5
30°	941.2
32.5°	640.1
35°	399.7
37.5°	237.0
40°	147.2
42.5°	96.8
45°	64.1
47.5°	41.3
50°	27.6
52.5°	18.4
55°	12.9
57.5°	8.5
60°	5.5
62.5°	2.9
65°	1.1
67.5°	0.3
70°	0.3
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)