

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P745175

Luminaire Tested: LD4D25D010-EU4DR3520359050-4LBDP1B

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P745175
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D25D010-EU4DR3520359050-4LBDP1B
Description: 4 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2112.0 lumens
Efficiency: N/A
Efficacy: 84.1 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 25.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P745175
CATALOG NUMBER: LD4D25D010-EU4DR3520359050-4LBDP1B

Luminous Intensity Polar Plot

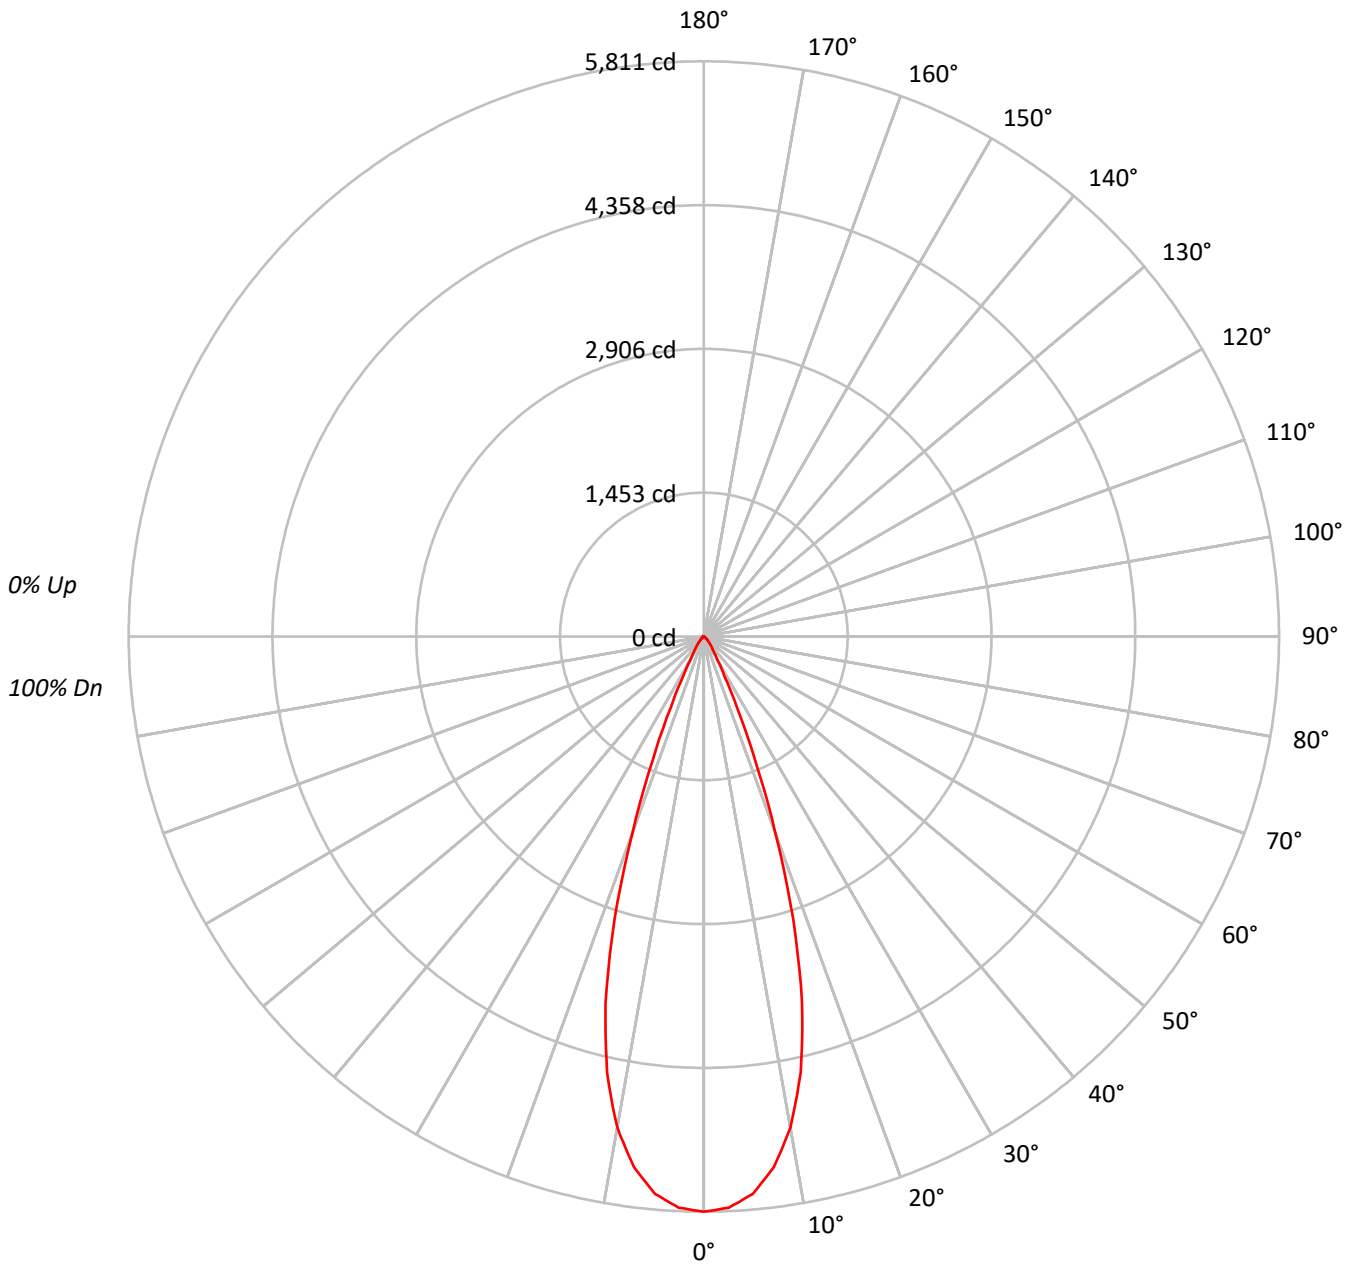



TEST NUMBER: P745175

CATALOG NUMBER: LD4D25D010-EU4DR3520359050-4LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96			96																
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92			92																
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88			88																
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84			84																
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81			81																
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78			78																
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75			75																
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72			72																
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70			70																
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68			68																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	634936
5°	620010
10°	558792
15°	433717
20°	245999
25°	95709
30°	35704
35°	19567
40°	12794
45°	7788
50°	4963
55°	3505
60°	2557
65°	1396
70°	96
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 7788 cd/sqm



TEST NUMBER: P745175

CATALOG NUMBER: LD4D25D010-EU4DR3520359050-4LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	519.9	24.6
10°-20°	1015.1	48.1
20°-30°	414.0	19.6
30°-40°	99.1	4.7
40°-50°	41.3	2.0
50°-60°	17.1	0.8
60°-70°	5.3	0.3
70°-80°	0.1	0.0
80°-90°	0.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1949.0	92.3
0°-40°	2048.1	97.0
0°-60°	2106.4	99.7
0°-90°	2112.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2112.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5811	
5°	5653	520
15°	3834	1015
25°	794	414
35°	147	99
45°	50	41
55°	18	17
65°	5	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P745175

CATALOG NUMBER: LD4D25D010-EU4DR3520359050-4LBDP1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	5811.2
2.5°	5776.3
5°	5653.0
7.5°	5407.1
10°	5036.6
12.5°	4515.0
15°	3834.3
17.5°	3001.7
20°	2115.7
22.5°	1349.1
25°	793.9
27.5°	448.7
30°	283.0
32.5°	198.7
35°	146.7
37.5°	113.4
40°	89.7
42.5°	69.1
45°	50.4
47.5°	37.7
50°	29.2
52.5°	23.1
55°	18.4
57.5°	14.9
60°	11.7
62.5°	8.5
65°	5.4
67.5°	1.9
70°	0.3
72.5°	0.3
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.3
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)