

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P745332

Luminaire Tested: LD4D25D010-EU4DR4520359050-4LBDP1H

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P745332
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D25D010-EU4DR4520359050-4LBDP1H
Description: 4 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2616.3 lumens
Efficiency: N/A
Efficacy: 104.2 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 25.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P745332
CATALOG NUMBER: LD4D25D010-EU4DR4520359050-4LBDP1H

Luminous Intensity Polar Plot

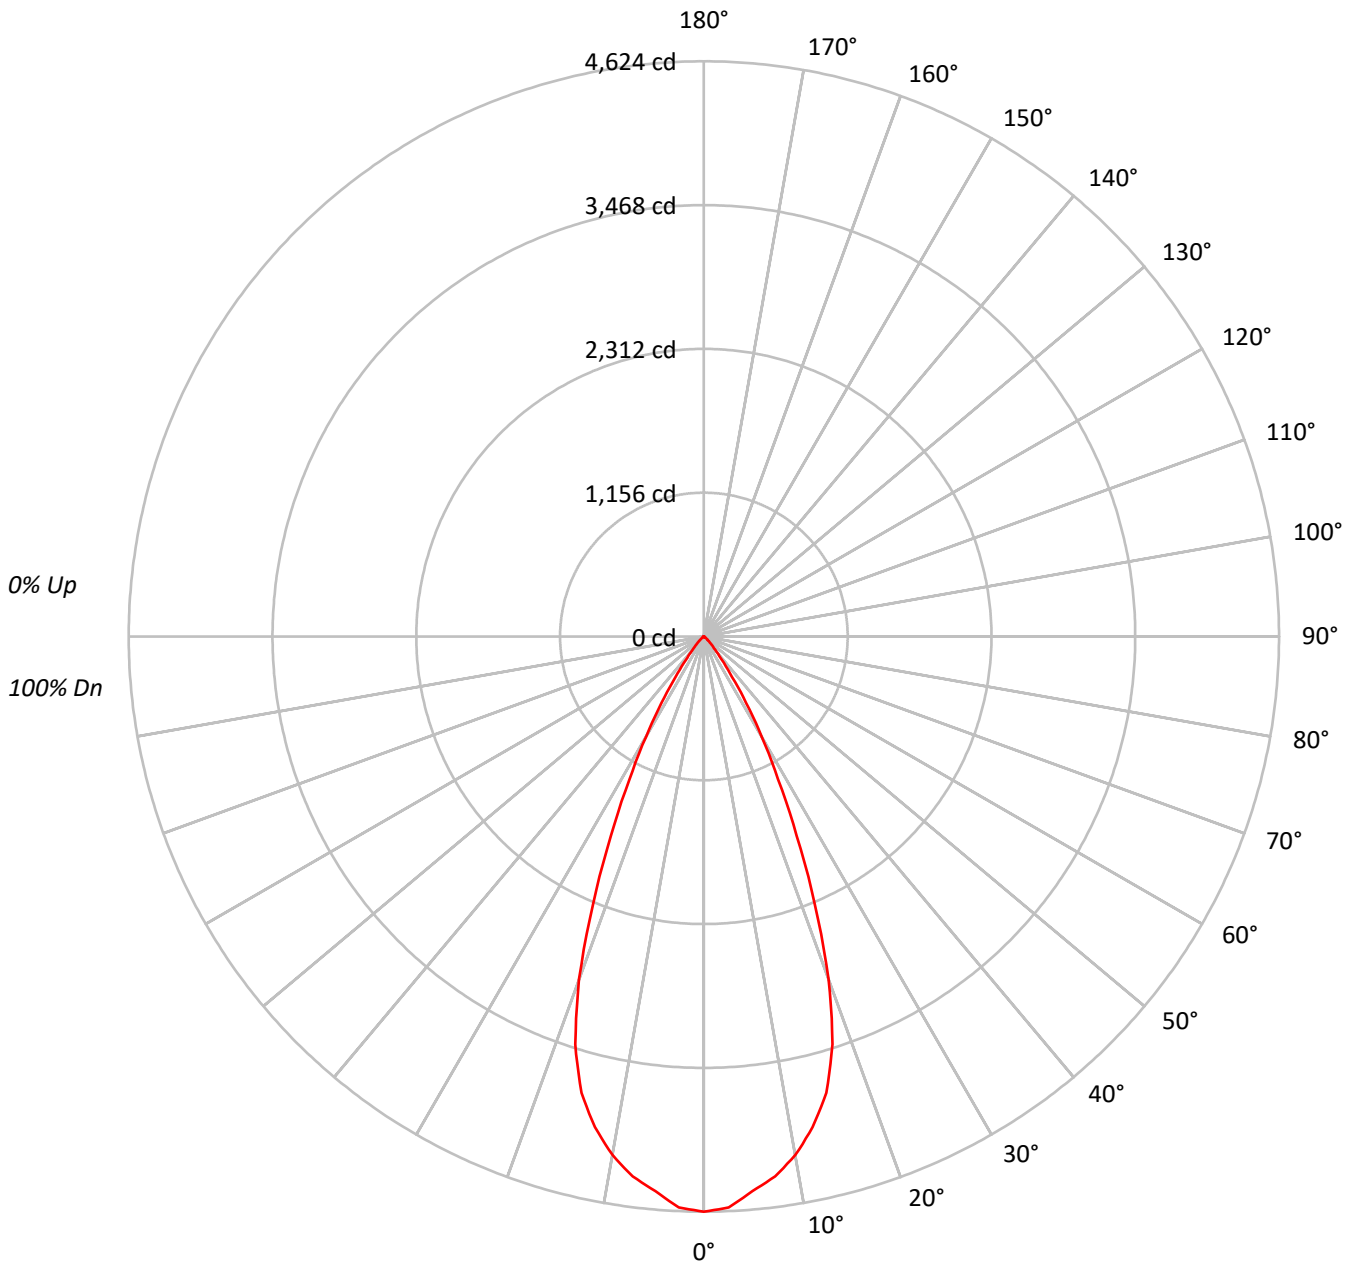



TEST NUMBER: P745332

CATALOG NUMBER: LD4D25D010-EU4DR4520359050-4LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95		
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90		
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85		
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81		
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77		
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73		
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69		
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66		
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63		
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	505276
5°	490886
10°	469647
15°	429826
20°	341005
25°	212890
30°	117345
35°	52686
40°	20753
45°	9781
50°	4640
55°	2419
60°	1180
65°	284
70°	96
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 9781 cd/sqm



TEST NUMBER: P745332

CATALOG NUMBER: LD4D25D010-EU4DR4520359050-4LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	420.5	16.1
10°-20°	1035.0	39.6
20°-30°	819.6	31.3
30°-40°	272.9	10.4
40°-50°	54.2	2.1
50°-60°	12.3	0.5
60°-70°	1.7	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2275.1	87.0
0°-40°	2548.1	97.4
0°-60°	2614.5	99.9
0°-90°	2616.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2616.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4624	
5°	4476	421
15°	3800	1035
25°	1766	820
35°	395	273
45°	63	54
55°	13	12
65°	1	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P745332

CATALOG NUMBER: LD4D25D010-EU4DR4520359050-4LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	4624.5
2.5°	4594.3
5°	4475.7
7.5°	4377.9
10°	4233.1
12.5°	4040.3
15°	3799.9
17.5°	3438.4
20°	2932.8
22.5°	2330.4
25°	1765.9
27.5°	1293.1
30°	930.1
32.5°	632.5
35°	395.0
37.5°	234.2
40°	145.5
42.5°	95.7
45°	63.3
47.5°	40.7
50°	27.3
52.5°	18.2
55°	12.7
57.5°	8.4
60°	5.4
62.5°	2.9
65°	1.1
67.5°	0.3
70°	0.3
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)