

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P745565

Luminaire Tested: LD4D25D010-EU4DR6020359050-4LBDP1B

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P745565
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D25D010-EU4DR6020359050-4LBDP1B
Description: 4 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2017.3 lumens
Efficiency: N/A
Efficacy: 80.4 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.83
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 25.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P745565
CATALOG NUMBER: LD4D25D010-EU4DR6020359050-4LBDP1B

Luminous Intensity Polar Plot

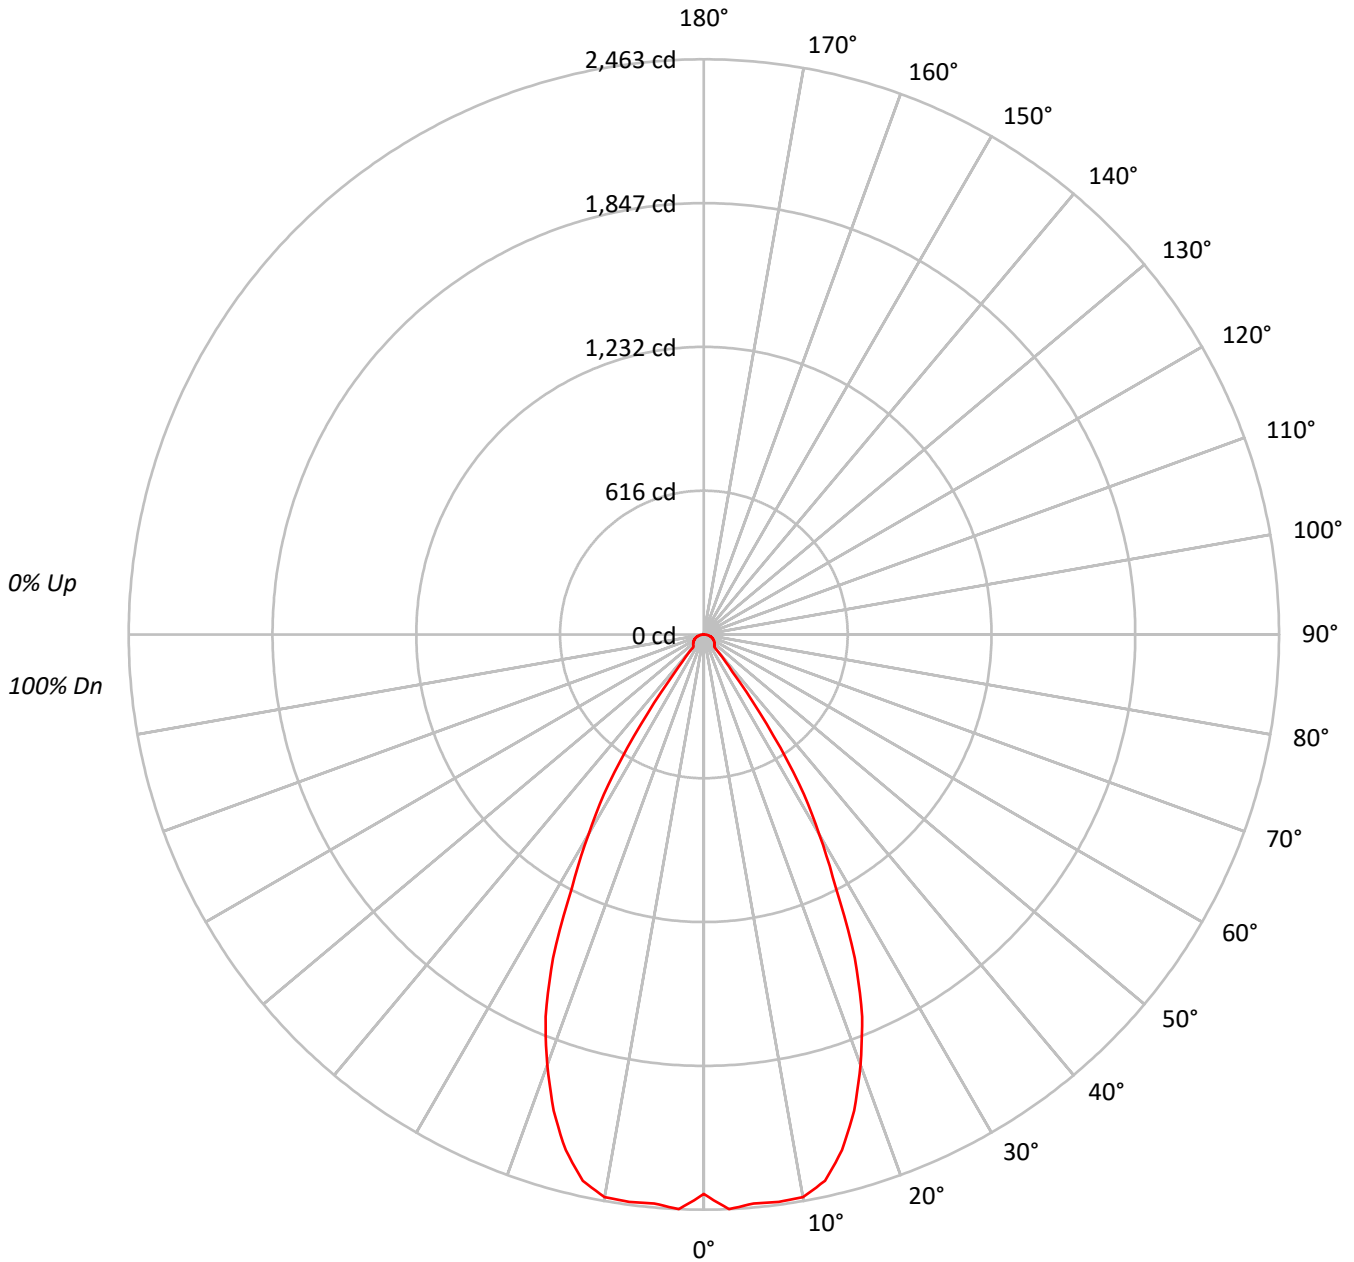



TEST NUMBER: P745565

CATALOG NUMBER: LD4D25D010-EU4DR6020359050-4LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93	93	93	93
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86	86	86	86
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80	80	80	80
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75	75	75	75
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70	70	70	70
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66	66	66	66
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62	62	62	62
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59	59	59	59
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55	55	55	55
10	73	64	58	54	72	63	58	54	62	58	54	62	57	54	61	57	54	53	53	53	53

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	261778
5°	268207
10°	271452
15°	258592
20°	227999
25°	184414
30°	124738
35°	62503
40°	10141
45°	9920
50°	10114
55°	10267
60°	10576
65°	10807
70°	11053
75°	11187
80°	10759
85°	9026

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 75°
 Luminance: 11187 cd/sqm



TEST NUMBER: P745565

CATALOG NUMBER: LD4D25D010-EU4DR6020359050-4LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	233.7	11.6
10°-20°	632.3	31.3
20°-30°	680.4	33.7
30°-40°	295.7	14.7
40°-50°	49.7	2.5
50°-60°	48.3	2.4
60°-70°	41.3	2.0
70°-80°	27.6	1.4
80°-90°	8.3	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1546.4	76.7
0°-40°	1842.1	91.3
0°-60°	1940.1	96.2
0°-90°	2017.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2017.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2396	
5°	2445	234
15°	2286	632
25°	1530	680
35°	469	296
45°	64	50
55°	54	48
65°	42	41
75°	26	28
85°	7	8
90°	0	



TEST NUMBER: P745565

CATALOG NUMBER: LD4D25D010-EU4DR6020359050-4LBDP1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	2395.9
2.5°	2463.2
5°	2445.4
7.5°	2451.0
10°	2446.7
12.5°	2396.1
15°	2286.1
17.5°	2138.3
20°	1960.9
22.5°	1771.0
25°	1529.7
27.5°	1223.5
30°	988.7
32.5°	762.0
35°	468.6
37.5°	200.5
40°	71.1
42.5°	65.5
45°	64.2
47.5°	62.1
50°	59.5
52.5°	56.7
55°	53.9
57.5°	51.1
60°	48.4
62.5°	45.2
65°	41.8
67.5°	38.3
70°	34.6
72.5°	30.5
75°	26.5
77.5°	21.8
80°	17.1
82.5°	12.1
85°	7.2
87.5°	2.5
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)