

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P746294

Luminaire Tested: LD4D30D010-EU4DR5020359027-4LBDP1H

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P746294
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D30D010-EU4DR5020359027-4LBDP1H
Description: 4 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 50° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2690.6 lumens
Efficiency: N/A
Efficacy: 92.8 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 29
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P746294

CATALOG NUMBER: LD4D30D010-EU4DR5020359027-4LBDP1H

Luminous Intensity Polar Plot

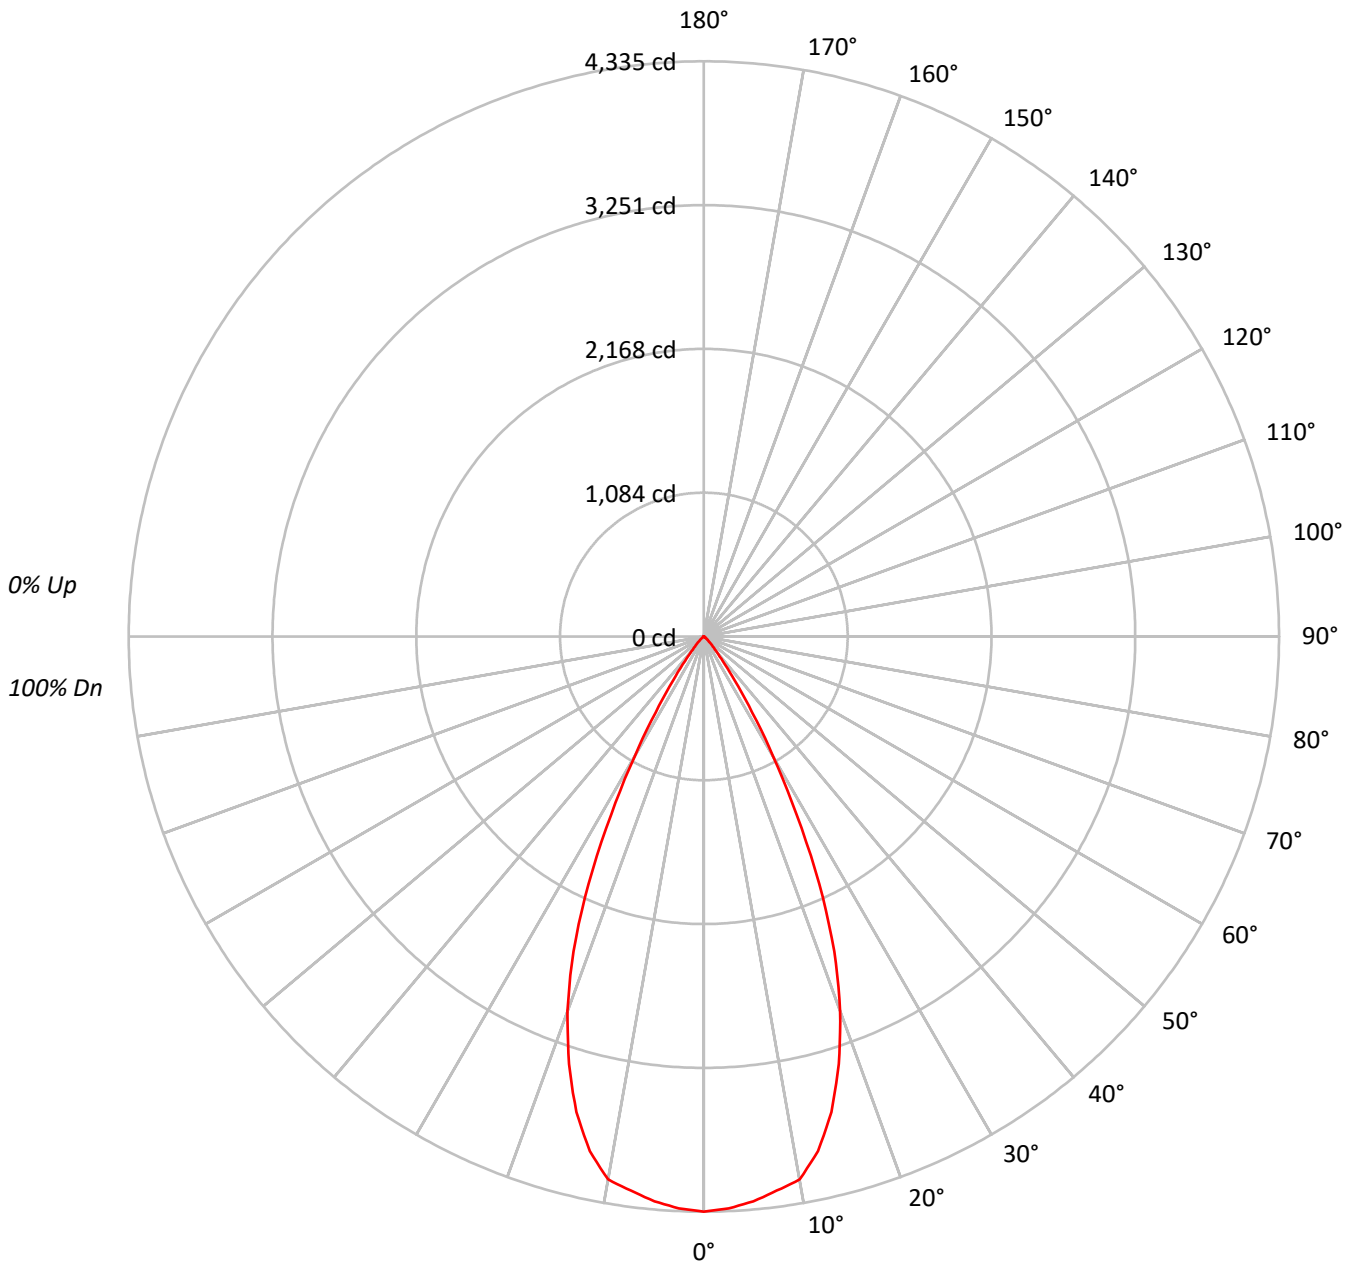



TEST NUMBER: P746294

CATALOG NUMBER: LD4D30D010-EU4DR5020359027-4LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95			
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90			
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85			
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80			
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76			
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72			
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69			
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65			
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62			
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	473678
5°	468709
10°	460993
15°	419770
20°	349295
25°	247947
30°	131235
35°	53486
40°	19868
45°	9086
50°	3723
55°	1962
60°	961
65°	284
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 9086 cd/sqm



TEST NUMBER: P746294

CATALOG NUMBER: LD4D30D010-EU4DR5020359027-4LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	403.9	15.0
10°-20°	1020.8	37.9
20°-30°	917.0	34.1
30°-40°	287.1	10.7
40°-50°	50.3	1.9
50°-60°	10.0	0.4
60°-70°	1.5	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2341.7	87.0
0°-40°	2628.8	97.7
0°-60°	2689.1	99.9
0°-90°	2690.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2690.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4335	
5°	4274	404
15°	3711	1021
25°	2057	917
35°	401	287
45°	59	50
55°	10	10
65°	1	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P746294

CATALOG NUMBER: LD4D30D010-EU4DR5020359027-4LBDP1H

CANDELA DISTRIBUTION (FULL):

0°	
0°	4335.3
2.5°	4313.7
5°	4273.5
7.5°	4212.1
10°	4155.1
12.5°	3972.3
15°	3711.0
17.5°	3379.1
20°	3004.1
22.5°	2570.3
25°	2056.7
27.5°	1512.1
30°	1040.2
32.5°	677.3
35°	401.0
37.5°	230.3
40°	139.3
42.5°	90.6
45°	58.8
47.5°	35.8
50°	21.9
52.5°	15.0
55°	10.3
57.5°	6.9
60°	4.4
62.5°	2.6
65°	1.1
67.5°	0.3
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)