

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P746242

Luminaire Tested: LD4D30D010-EU4DR4520359035-4LBDP1H

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P746242
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D30D010-EU4DR4520359035-4LBDP1H
Description: 4 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2895.7 lumens
Efficiency: N/A
Efficacy: 99.9 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 29
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P746242
CATALOG NUMBER: LD4D30D010-EU4DR4520359035-4LBDP1H

Luminous Intensity Polar Plot

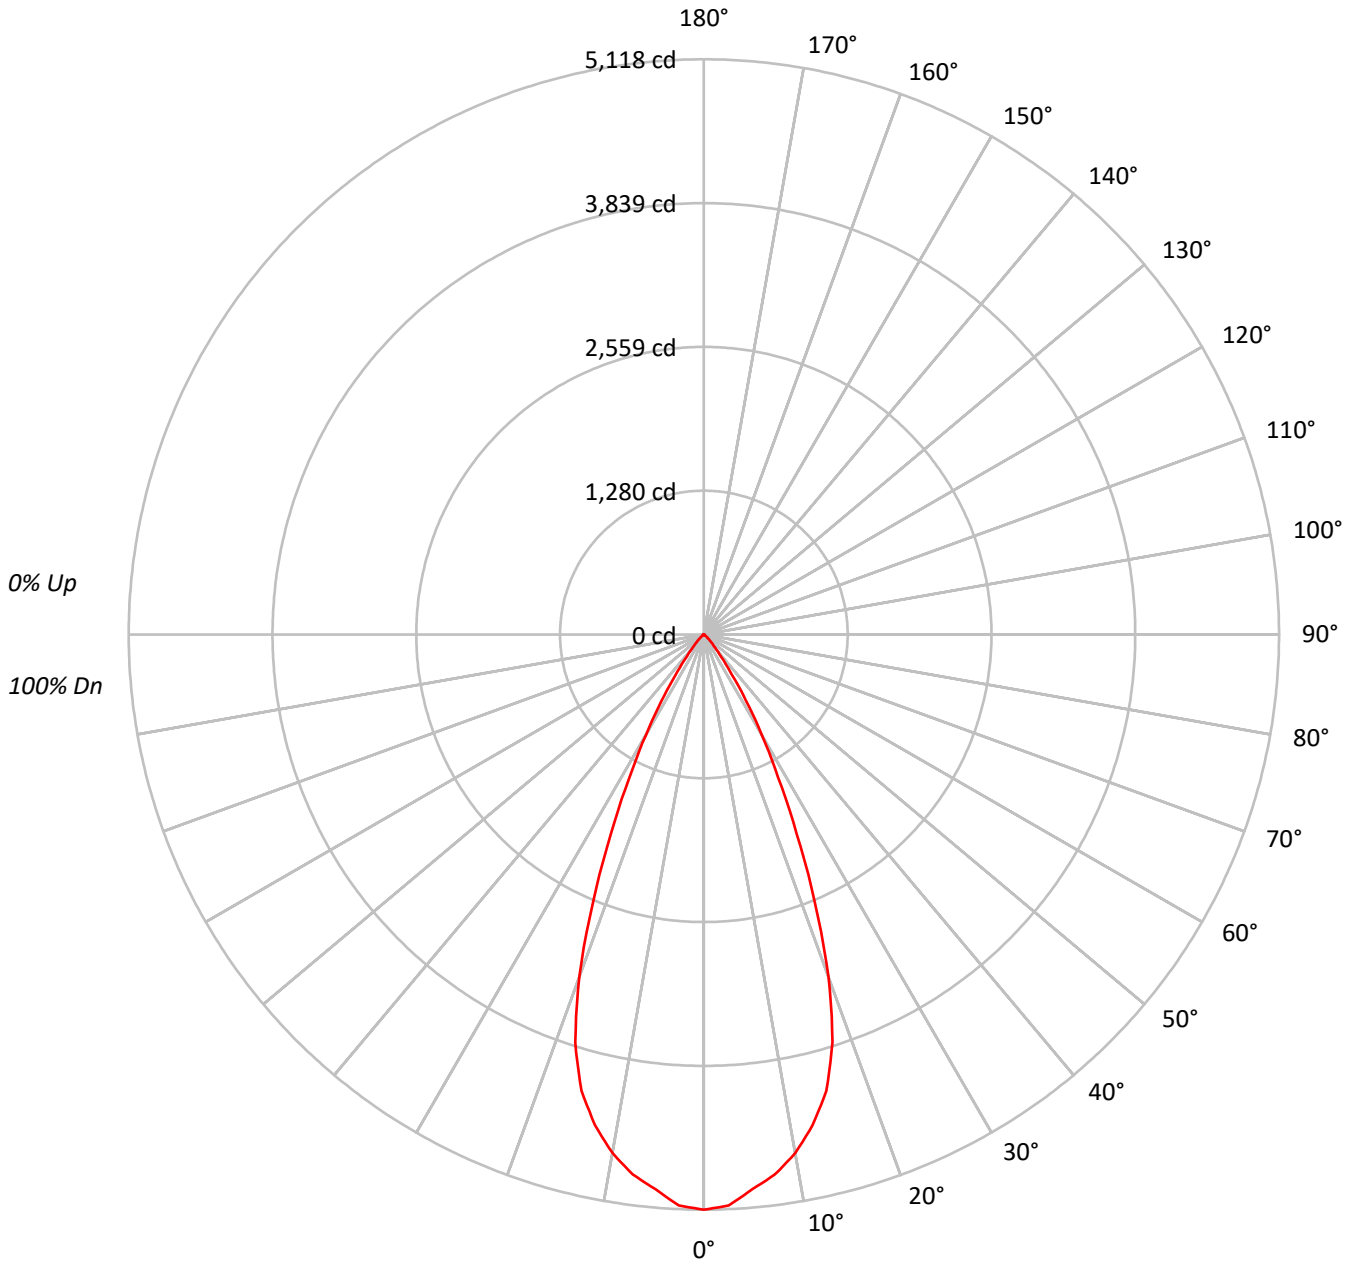



TEST NUMBER: P746242

CATALOG NUMBER: LD4D30D010-EU4DR4520359035-4LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	559229
5°	543301
10°	519794
15°	475717
20°	377410
25°	235614
30°	129873
35°	58315
40°	22963
45°	10832
50°	5133
55°	2686
60°	1311
65°	310
70°	128
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 10832 cd/sqm



TEST NUMBER: P746242

CATALOG NUMBER: LD4D30D010-EU4DR4520359035-4LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	465.4	16.1
10°-20°	1145.5	39.6
20°-30°	907.1	31.3
30°-40°	302.1	10.4
40°-50°	60.0	2.1
50°-60°	13.6	0.5
60°-70°	1.9	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2518.1	87.0
0°-40°	2820.1	97.4
0°-60°	2893.7	99.9
0°-90°	2895.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2895.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5118	
5°	4954	465
15°	4206	1145
25°	1954	907
35°	437	302
45°	70	60
55°	14	14
65°	1	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P746242

CATALOG NUMBER: LD4D30D010-EU4DR4520359035-4LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	5118.3
2.5°	5084.8
5°	4953.6
7.5°	4845.3
10°	4685.1
12.5°	4471.7
15°	4205.6
17.5°	3805.5
20°	3245.9
22.5°	2579.3
25°	1954.4
27.5°	1431.1
30°	1029.4
32.5°	700.1
35°	437.2
37.5°	259.3
40°	161.0
42.5°	105.9
45°	70.1
47.5°	45.1
50°	30.2
52.5°	20.1
55°	14.1
57.5°	9.3
60°	6.0
62.5°	3.2
65°	1.2
67.5°	0.4
70°	0.4
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)