

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P747334

Luminaire Tested: LD4D35BD010-EU4DR6520359035-4LBDP1H

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P747334
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D35BD010-EU4DR6520359035-4LBDP1H
Description: 4 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2829.7 lumens
Efficiency: N/A
Efficacy: 91.9 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 30.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P747334

CATALOG NUMBER: LD4D35BD010-EU4DR6520359035-4LBDP1H

Luminous Intensity Polar Plot

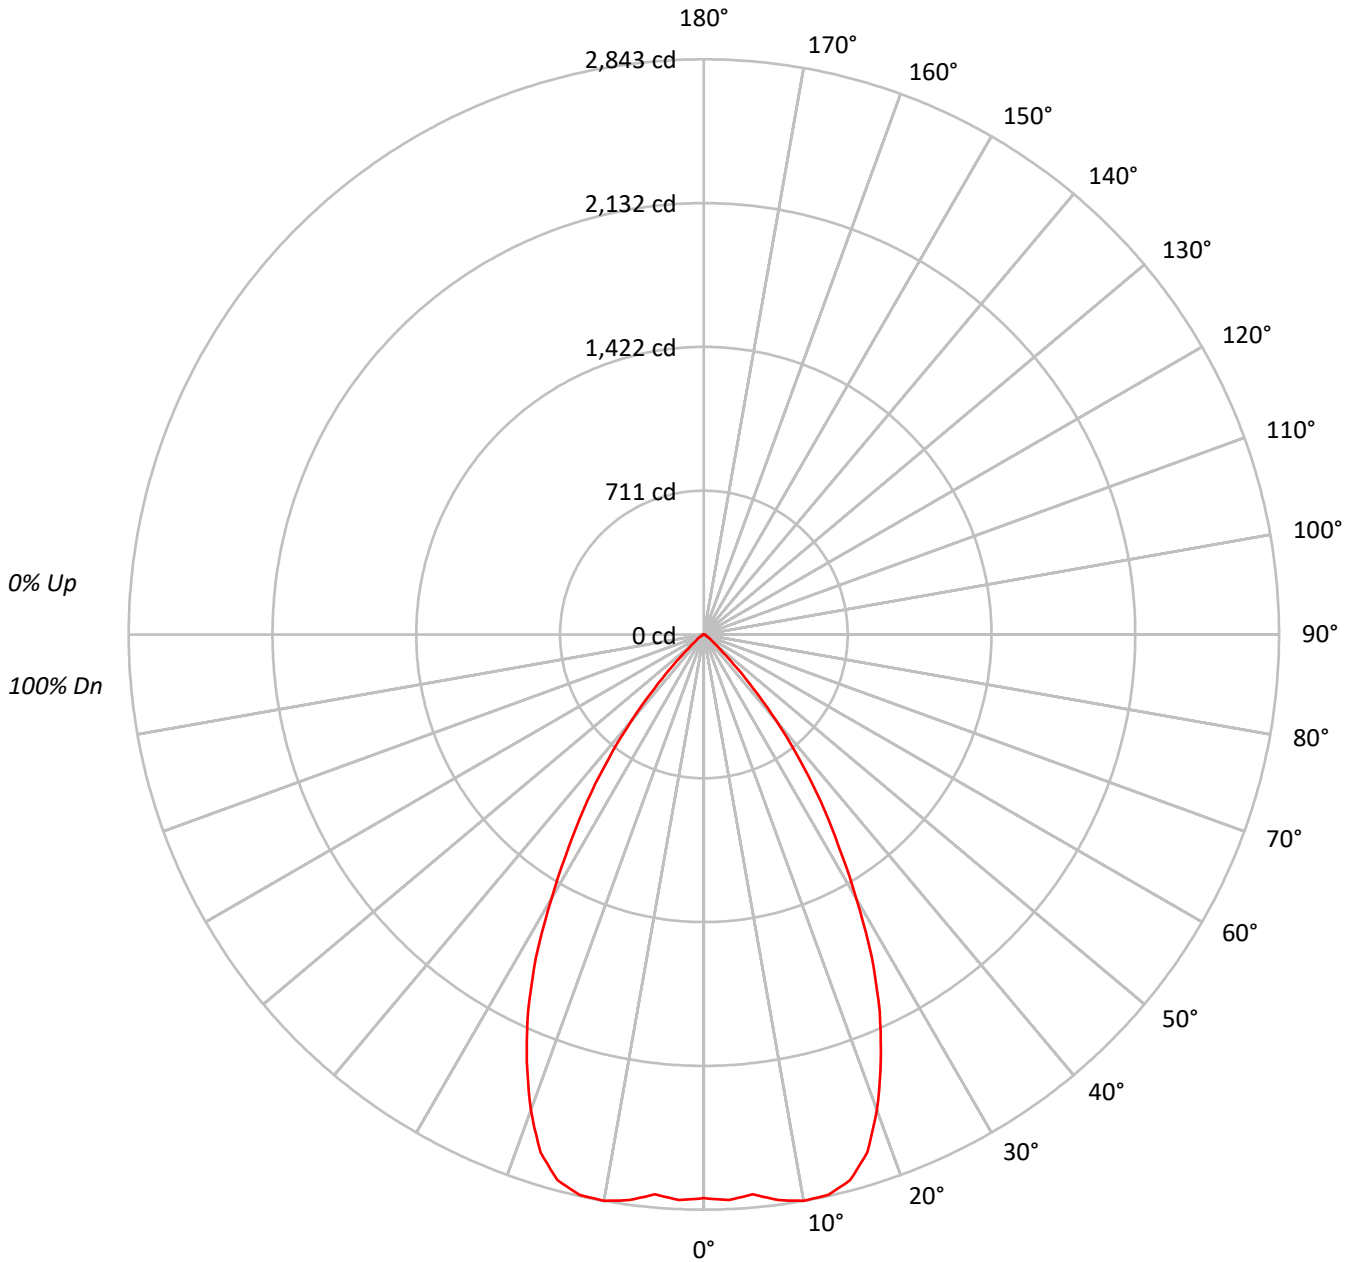



TEST NUMBER: P747334

CATALOG NUMBER: LD4D35BD010-EU4DR6520359035-4LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93		
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87		
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80		
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75		
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69		
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65		
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60		
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57		
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53		
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	304400
5°	304653
10°	315376
15°	315896
20°	290845
25°	247815
30°	189712
35°	134023
40°	79117
45°	32124
50°	11644
55°	6477
60°	3715
65°	2042
70°	2140
75°	1689
80°	1762
85°	1504

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 32124 cd/sqm



TEST NUMBER: P747334

CATALOG NUMBER: LD4D35BD010-EU4DR6520359035-4LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	268.3	9.5
10°-20°	773.8	27.3
20°-30°	928.5	32.8
30°-40°	624.0	22.1
40°-50°	186.8	6.6
50°-60°	32.9	1.2
60°-70°	9.4	0.3
70°-80°	4.6	0.2
80°-90°	1.5	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1970.6	69.6
0°-40°	2594.5	91.7
0°-60°	2814.3	99.5
0°-90°	2829.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2829.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2786	
5°	2778	268
15°	2793	774
25°	2056	928
35°	1005	624
45°	208	187
55°	34	33
65°	8	9
75°	4	5
85°	1	1
90°	0	



TEST NUMBER: P747334

CATALOG NUMBER: LD4D35BD010-EU4DR6520359035-4LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	2786.0
2.5°	2797.9
5°	2777.7
7.5°	2819.7
10°	2842.6
12.5°	2837.1
15°	2792.7
17.5°	2684.3
20°	2501.4
22.5°	2286.0
25°	2055.6
27.5°	1795.4
30°	1503.7
32.5°	1239.2
35°	1004.8
37.5°	773.2
40°	554.7
42.5°	362.3
45°	207.9
47.5°	110.1
50°	68.5
52.5°	47.5
55°	34.0
57.5°	24.5
60°	17.0
62.5°	11.1
65°	7.9
67.5°	7.1
70°	6.7
72.5°	5.1
75°	4.0
77.5°	3.6
80°	2.8
82.5°	2.0
85°	1.2
87.5°	0.8
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)