

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P747340

Luminaire Tested: LD4D35BD010-EU4DR6520359035-4LBS1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P747340
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D35BD010-EU4DR6520359035-4LBS1MW
Description: 4 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2830.3 lumens
Efficiency: N/A
Efficacy: 91.9 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct

Input Watts (W): 30.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P747340

CATALOG NUMBER: LD4D35BD010-EU4DR6520359035-4LBS1MW

Luminous Intensity Polar Plot

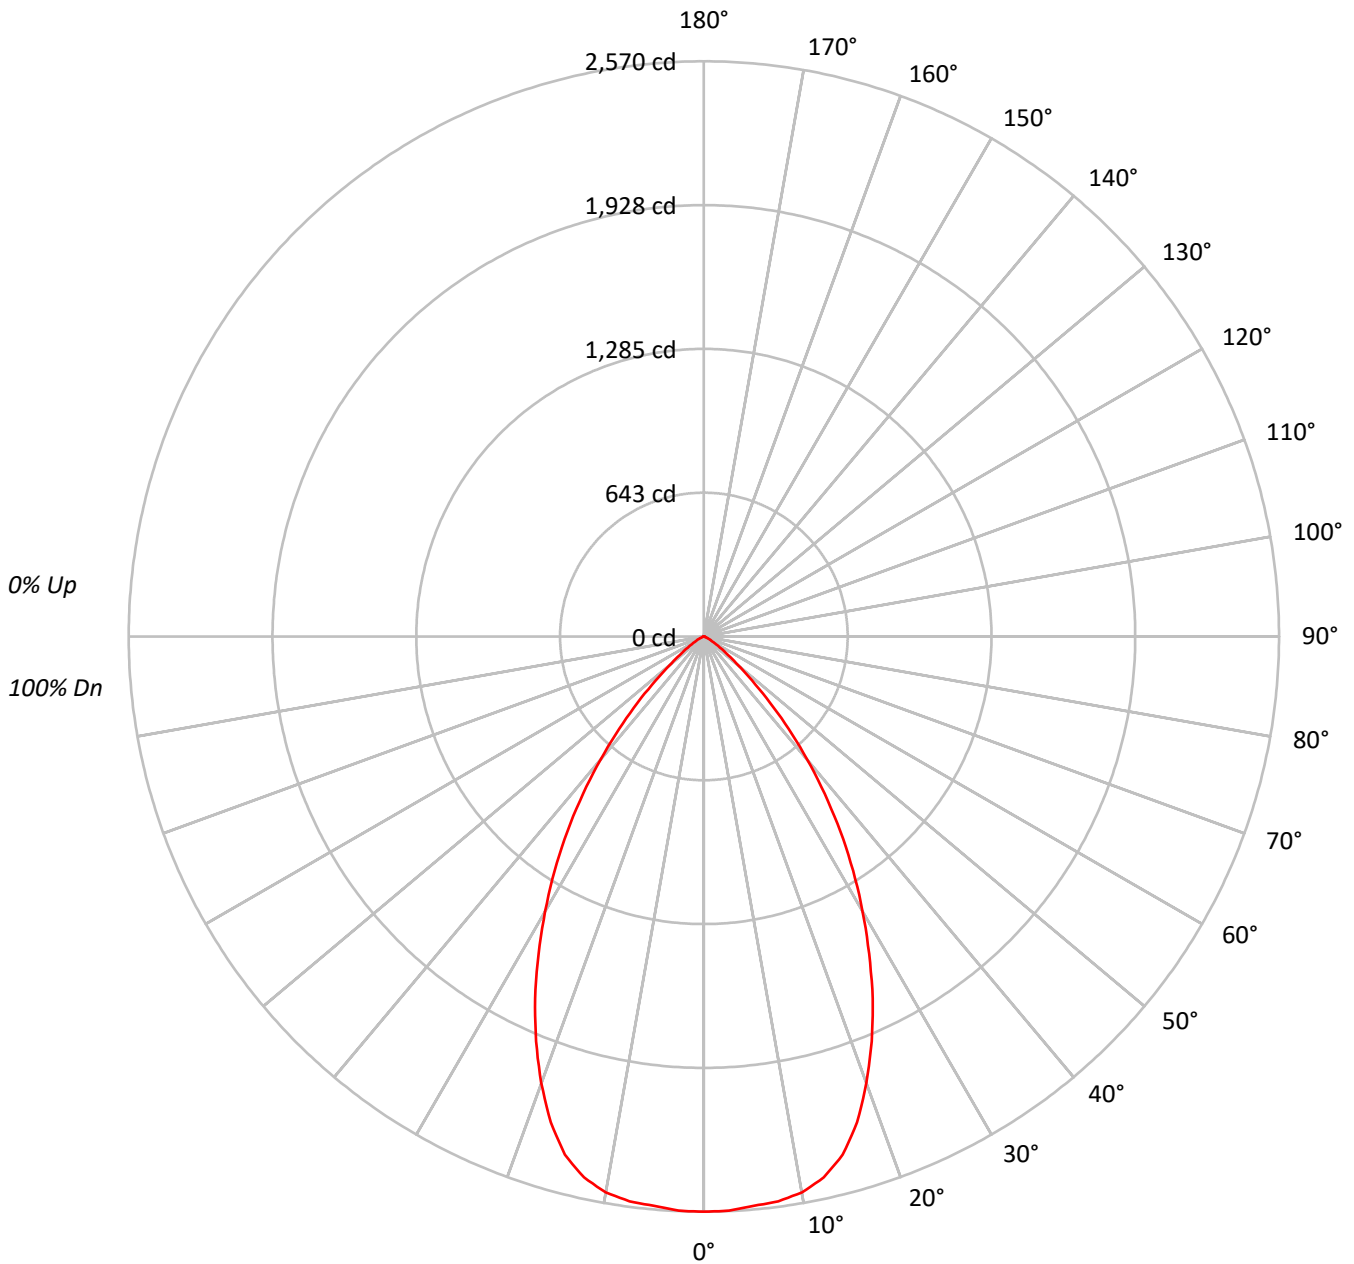



TEST NUMBER: P747340

CATALOG NUMBER: LD4D35BD010-EU4DR6520359035-4LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93	93	93	93
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85	85	85	85
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78	78	78	78
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72	72	72	72
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66	66	66	66
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61	61	61	61
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56	56	56	56
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52	52	52	52
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49	49	49	49
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46	46	46	46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	150092
5°	149710
10°	149585
15°	144975
20°	131980
25°	115009
30°	95655
35°	75797
40°	54703
45°	34558
50°	18018
55°	9571
60°	5034
65°	2764
70°	1161
75°	1286
80°	874
85°	737

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 34558 cd/sqm



TEST NUMBER: P747340

CATALOG NUMBER: LD4D35BD010-EU4DR6520359035-4LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	243.0	8.6
10°-20°	665.5	23.5
20°-30°	813.5	28.7
30°-40°	660.0	23.3
40°-50°	328.9	11.6
50°-60°	91.7	3.2
60°-70°	20.8	0.7
70°-80°	5.4	0.2
80°-90°	1.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1722.0	60.8
0°-40°	2382.0	84.2
0°-60°	2802.7	99.0
0°-90°	2830.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2830.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2570	
5°	2554	243
15°	2398	666
25°	1785	813
35°	1063	660
45°	418	329
55°	94	92
65°	20	21
75°	6	5
85°	1	1
90°	0	



TEST NUMBER: P747340

CATALOG NUMBER: LD4D35BD010-EU4DR6520359035-4LBS1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	2569.9
2.5°	2568.0
5°	2553.6
7.5°	2545.3
10°	2522.3
12.5°	2475.5
15°	2397.7
17.5°	2276.1
20°	2123.5
22.5°	1958.8
25°	1784.7
27.5°	1598.6
30°	1418.4
32.5°	1240.6
35°	1063.1
37.5°	886.0
40°	717.5
42.5°	559.7
45°	418.4
47.5°	291.5
50°	198.3
52.5°	136.7
55°	94.0
57.5°	63.4
60°	43.1
62.5°	29.8
65°	20.0
67.5°	10.2
70°	6.8
72.5°	6.4
75°	5.7
77.5°	3.8
80°	2.6
82.5°	1.9
85°	1.1
87.5°	0.8
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)