

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P747127

Luminaire Tested: LD4D35BD010-EU4DR5020359050-4LBDP1LI

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P747127
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D35BD010-EU4DR5020359050-4LBDP1LI
Description: 4 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 50° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3708.2 lumens
Efficiency: N/A
Efficacy: 120.4 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 30.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P747127

CATALOG NUMBER: LD4D35BD010-EU4DR5020359050-4LBDP1LI

Luminous Intensity Polar Plot

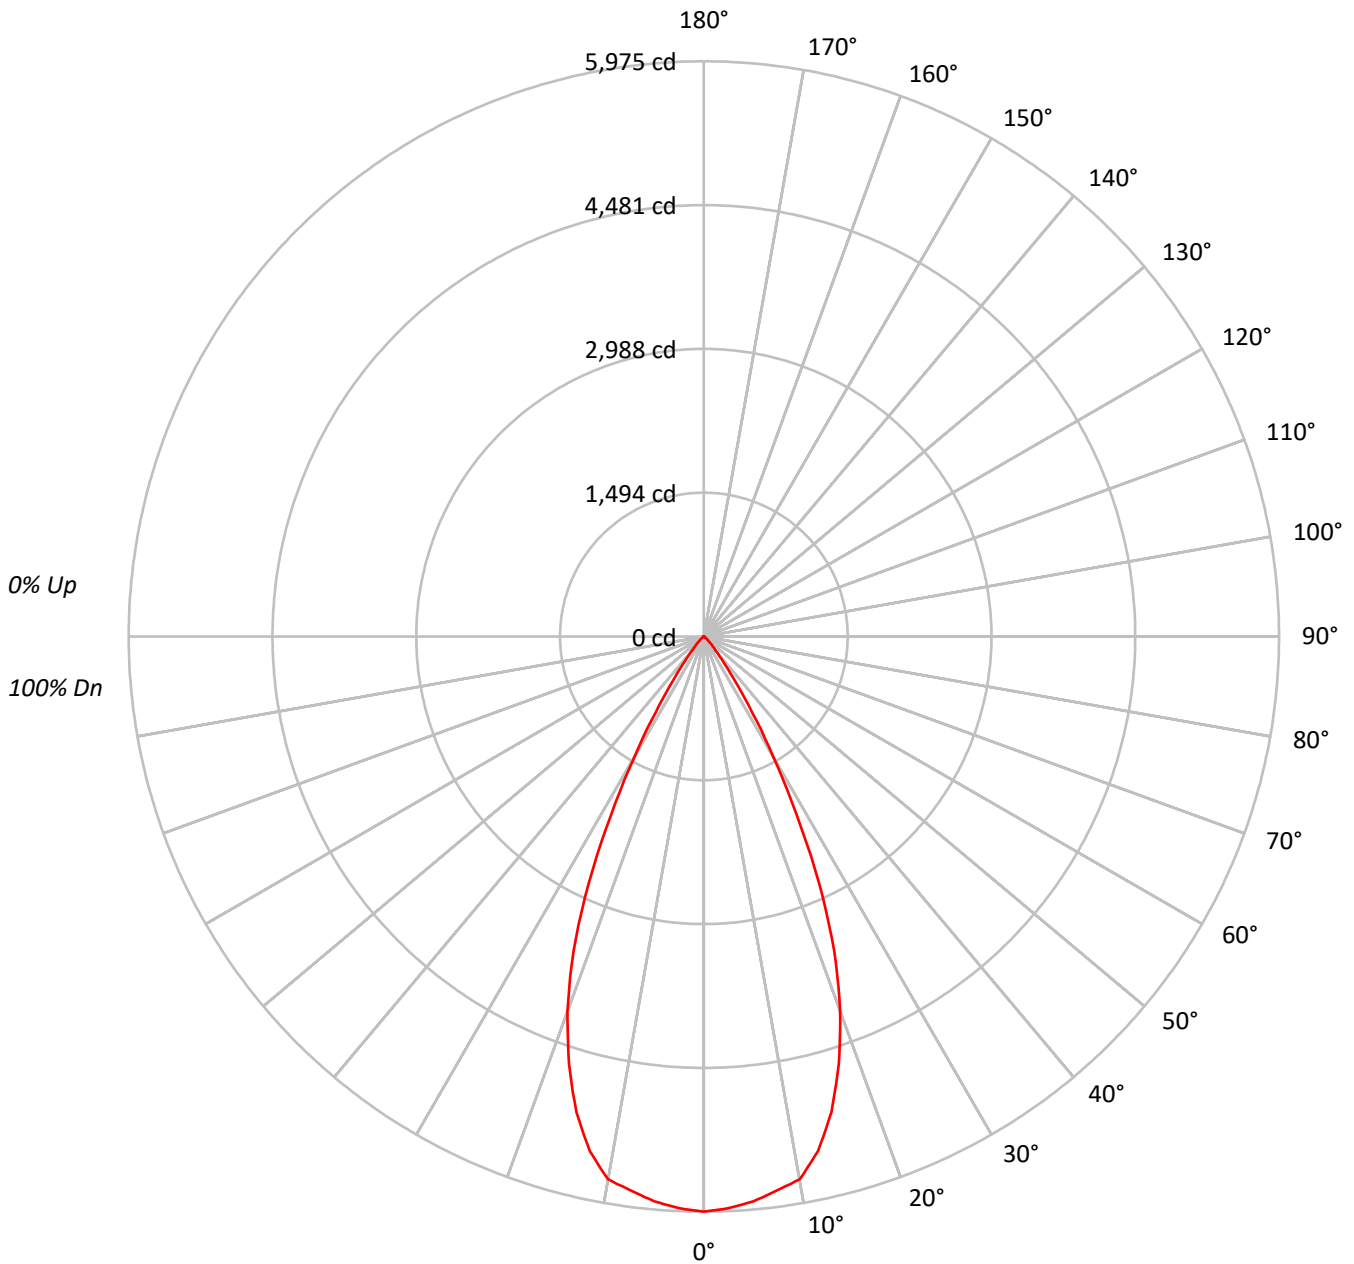



TEST NUMBER: P747127

CATALOG NUMBER: LD4D35BD010-EU4DR5020359050-4LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95																			
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90																			
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85																			
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80																			
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76																			
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72																			
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69																			
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65																			
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62																			
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	652811
5°	645971
10°	635334
15°	578516
20°	481393
25°	341716
30°	180868
35°	73707
40°	27371
45°	12531
50°	5133
55°	2686
60°	1311
65°	388
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 12531 cd/sqm



TEST NUMBER: P747127

CATALOG NUMBER: LD4D35BD010-EU4DR5020359050-4LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	556.7	15.0
10°-20°	1406.9	37.9
20°-30°	1263.8	34.1
30°-40°	395.7	10.7
40°-50°	69.3	1.9
50°-60°	13.8	0.4
60°-70°	2.1	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3227.3	87.0
0°-40°	3623.0	97.7
0°-60°	3706.1	99.9
0°-90°	3708.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3708.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5975	
5°	5890	557
15°	5114	1407
25°	2834	1264
35°	553	396
45°	81	69
55°	14	14
65°	2	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P747127

CATALOG NUMBER: LD4D35BD010-EU4DR5020359050-4LBDP1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	5974.8
2.5°	5945.1
5°	5889.7
7.5°	5805.1
10°	5726.5
12.5°	5474.6
15°	5114.4
17.5°	4657.1
20°	4140.2
22.5°	3542.3
25°	2834.5
27.5°	2084.0
30°	1433.6
32.5°	933.4
35°	552.6
37.5°	317.4
40°	191.9
42.5°	124.9
45°	81.1
47.5°	49.4
50°	30.2
52.5°	20.7
55°	14.1
57.5°	9.6
60°	6.0
62.5°	3.5
65°	1.5
67.5°	0.5
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)