

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P748074

Luminaire Tested: LD4D40BD010-EU4DR6540509024-4LBDP1B

Issue Date: 2/5/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P748074  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/5/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD4D40BD010-EU4DR6540509024-4LBDP1B  
Description: 4 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 65° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2104.0 lumens  
Efficiency: N/A  
Efficacy: 59.8 lumens/watt  
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct


Input Watts (W): 35.2  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P748074  
CATALOG NUMBER: LD4D40BD010-EU4DR6540509024-4LBDP1B

### Luminous Intensity Polar Plot

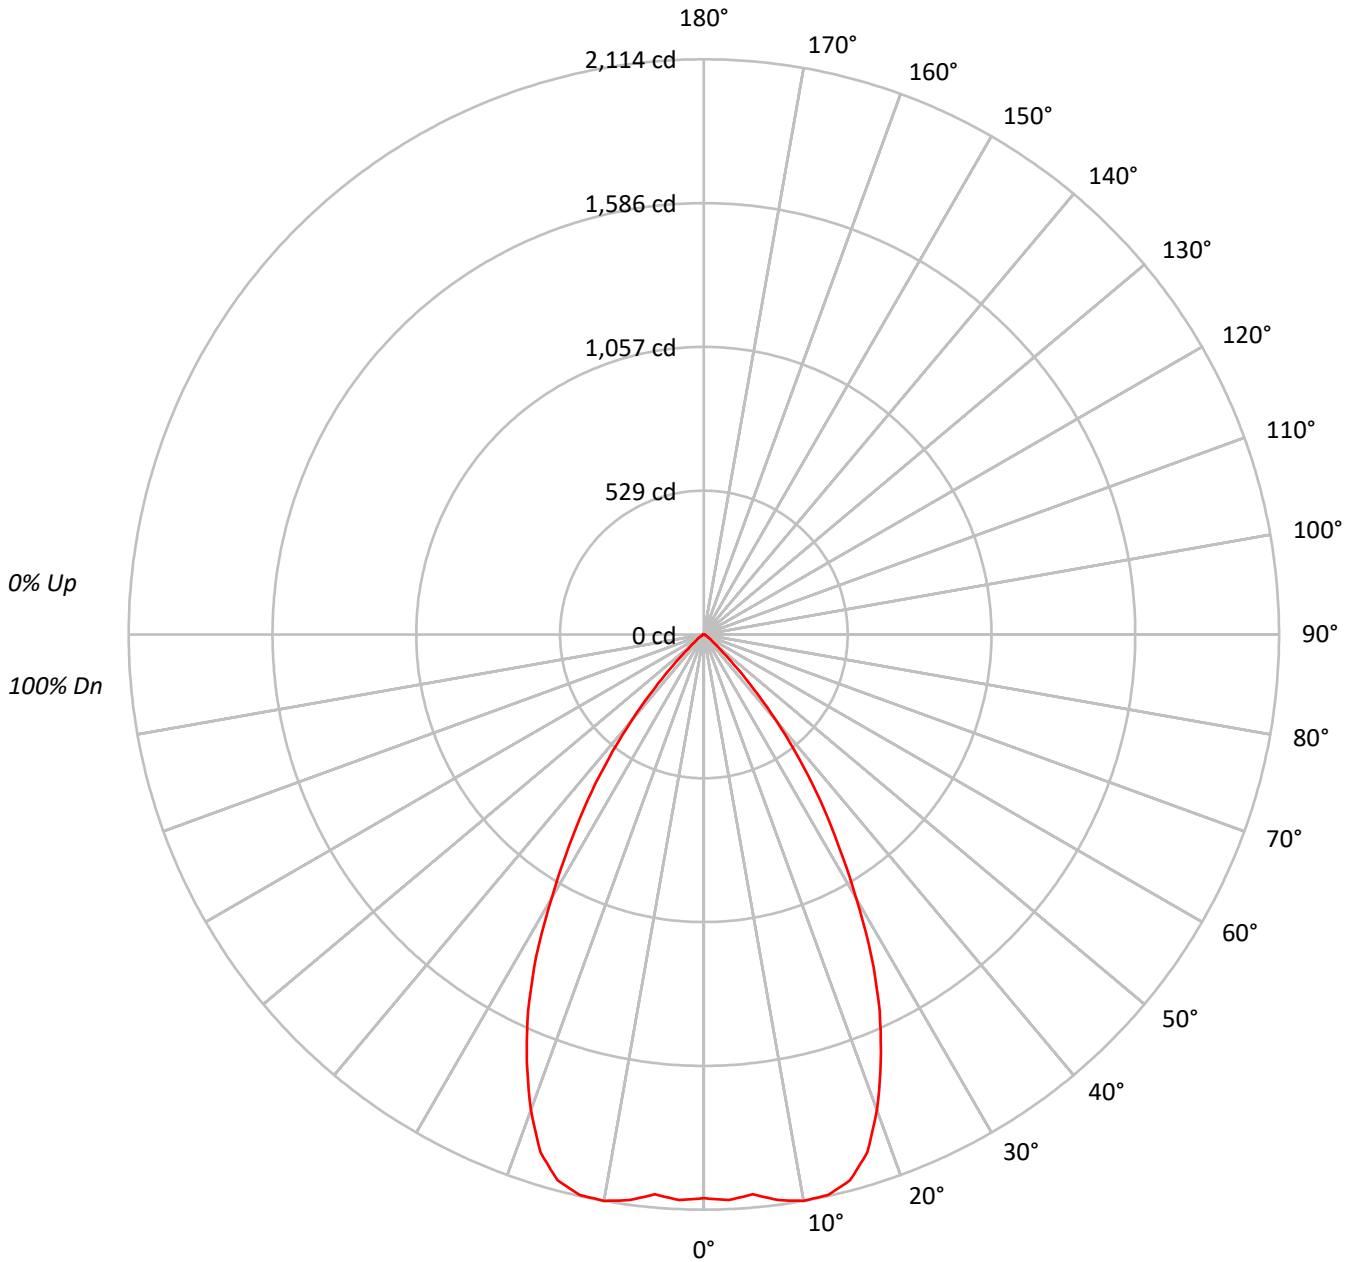



TEST NUMBER: P748074

CATALOG NUMBER: LD4D40BD010-EU4DR6540509024-4LBDP1B

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	226345
5°	226529
10°	234507
15°	234895
20°	216256
25°	184258
30°	141063
35°	99650
40°	58821
45°	23888
50°	8652
55°	4819
60°	2775
65°	1525
70°	1597
75°	1224
80°	1321
85°	1128

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 23888 cd/sqm



TEST NUMBER: P748074

CATALOG NUMBER: LD4D40BD010-EU4DR6540509024-4LBDP1B

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	199.5	9.5
10°-20°	575.4	27.3
20°-30°	690.4	32.8
30°-40°	463.9	22.0
40°-50°	138.9	6.6
50°-60°	24.5	1.2
60°-70°	7.0	0.3
70°-80°	3.4	0.2
80°-90°	1.1	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1465.2	69.6
0°-40°	1929.2	91.7
0°-60°	2092.6	99.5
0°-90°	2104.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2104.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2072	
5°	2065	199
15°	2077	575
25°	1528	690
35°	747	464
45°	155	139
55°	25	25
65°	6	7
75°	3	3
85°	1	1
90°	0	



TEST NUMBER: P748074

CATALOG NUMBER: LD4D40BD010-EU4DR6540509024-4LBDP1B

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2071.6
2.5°	2080.4
5°	2065.4
7.5°	2096.6
10°	2113.7
12.5°	2109.6
15°	2076.6
17.5°	1995.9
20°	1859.9
22.5°	1699.8
25°	1528.4
27.5°	1335.0
30°	1118.1
32.5°	921.4
35°	747.1
37.5°	574.9
40°	412.4
42.5°	269.4
45°	154.6
47.5°	81.8
50°	50.9
52.5°	35.3
55°	25.3
57.5°	18.3
60°	12.7
62.5°	8.2
65°	5.9
67.5°	5.3
70°	5.0
72.5°	3.8
75°	2.9
77.5°	2.6
80°	2.1
82.5°	1.5
85°	0.9
87.5°	0.6
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)