

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P747934

Luminaire Tested: LD4D40BD010-EU4DR5540509027-4LBDP1MW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P747934
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-52)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D40BD010-EU4DR5540509027-4LBDP1MW
Description: 4 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 55° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3418.3 lumens
Efficiency: N/A
Efficacy: 97.1 lumens/watt
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.87
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 35.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P747934
CATALOG NUMBER: LD4D40BD010-EU4DR5540509027-4LBDP1MW

Luminous Intensity Polar Plot

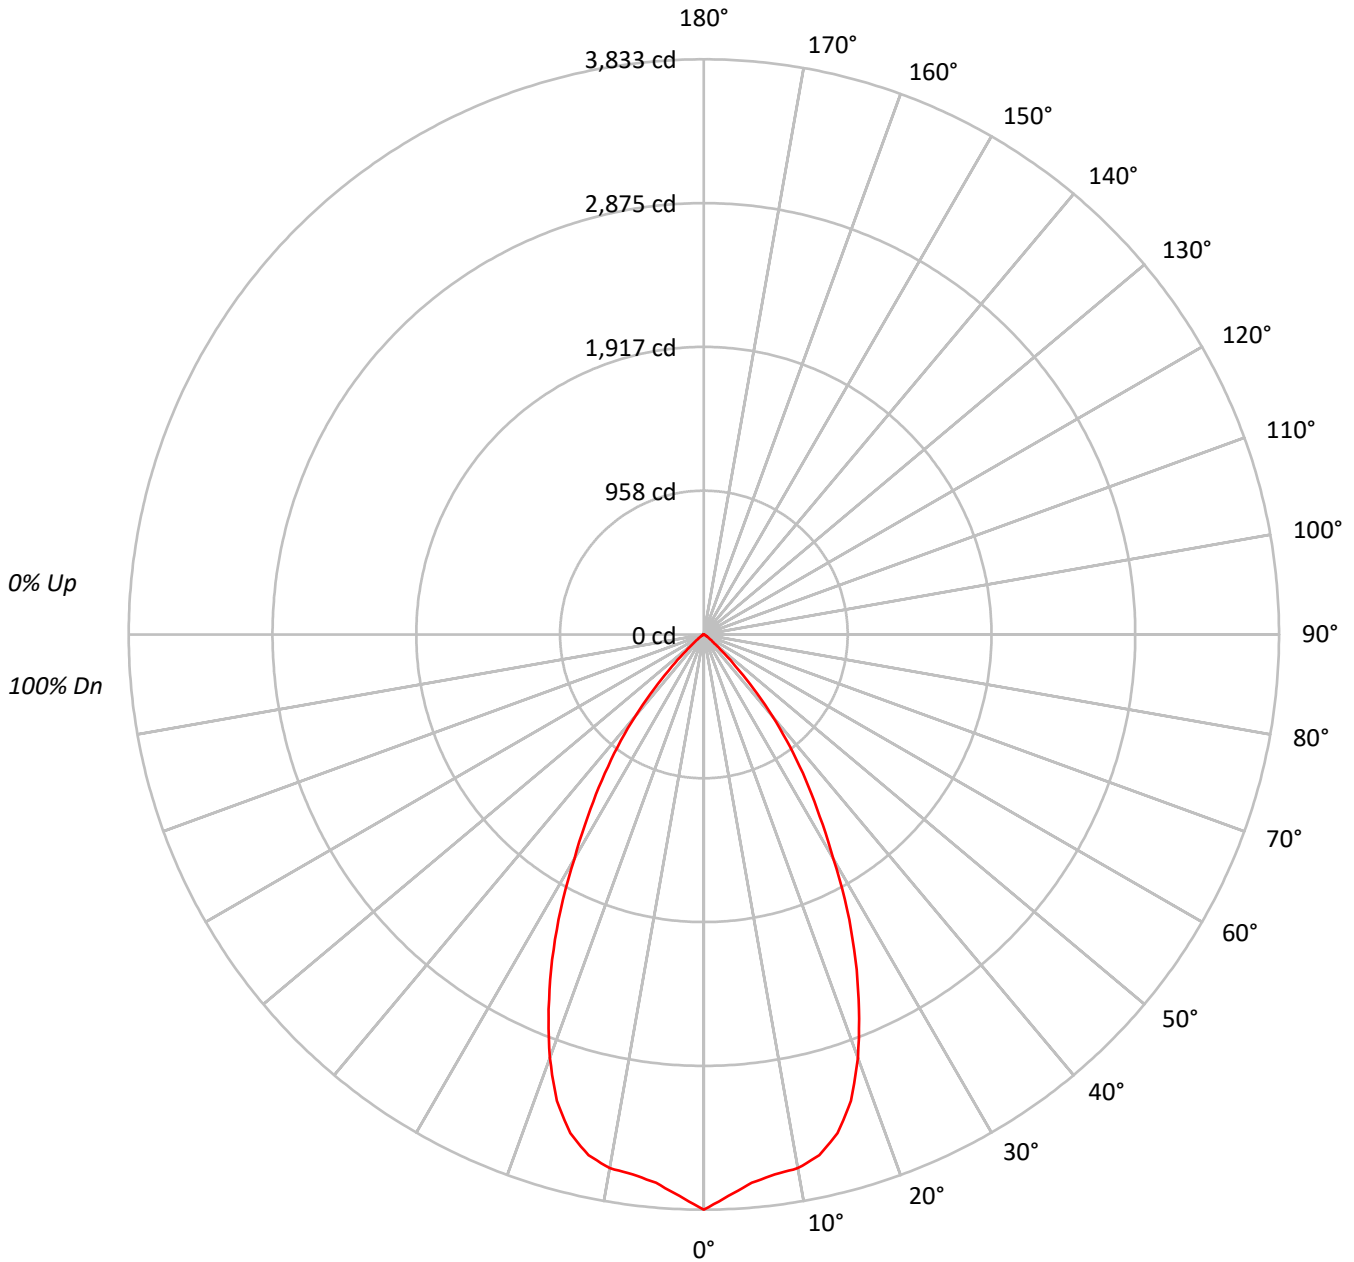



TEST NUMBER: P747934

CATALOG NUMBER: LD4D40BD010-EU4DR5540509027-4LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	114	111	108	106	111	109	106	104	105	103	101		101	99	98		97	96	95	94
2	108	103	99	96	106	101	98	95	98	95	92		95	93	90		92	90	89	87
3	102	96	91	87	100	95	90	86	92	88	85		90	86	84		87	85	82	81
4	97	90	84	80	95	88	83	79	86	82	78		84	81	78		82	79	77	75
5	92	84	78	74	91	83	77	73	81	76	73		79	75	72		78	74	71	70
6	88	79	73	68	86	78	72	68	76	71	68		75	70	67		74	70	67	65
7	83	74	68	64	82	73	67	63	72	67	63		71	66	63		70	65	62	61
8	79	69	63	59	78	69	63	59	68	63	59		67	62	59		66	62	58	57
9	75	66	60	56	74	65	59	55	64	59	55		63	58	55		62	58	55	54
10	72	62	56	52	71	61	56	52	61	56	52		60	55	52		59	55	52	50

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	418807
5°	402168
10°	400660
15°	389150
20°	348923
25°	288370
30°	217821
35°	157939
40°	101082
45°	46170
50°	15094
55°	6515
60°	2797
65°	362
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 46170 cd/sqm



TEST NUMBER: P747934

CATALOG NUMBER: LD4D40BD010-EU4DR5540509027-4LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	348.9	10.2
10°-20°	952.3	27.9
20°-30°	1085.2	31.7
30°-40°	738.8	21.6
40°-50°	254.6	7.4
50°-60°	35.2	1.0
60°-70°	3.4	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2386.4	69.8
0°-40°	3125.1	91.4
0°-60°	3414.9	99.9
0°-90°	3418.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3418.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3833	
5°	3667	349
15°	3440	952
25°	2392	1085
35°	1184	739
45°	299	255
55°	34	35
65°	1	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P747934

CATALOG NUMBER: LD4D40BD010-EU4DR5540509027-4LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	3833.1
2.5°	3745.2
5°	3666.8
7.5°	3628.4
10°	3611.3
12.5°	3554.3
15°	3440.3
17.5°	3259.3
20°	3000.9
22.5°	2702.6
25°	2392.0
27.5°	2068.5
30°	1726.5
32.5°	1436.8
35°	1184.1
37.5°	943.8
40°	708.7
42.5°	491.1
45°	298.8
47.5°	161.0
50°	88.8
52.5°	52.7
55°	34.2
57.5°	21.8
60°	12.8
62.5°	5.7
65°	1.4
67.5°	0.5
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)