

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P748101

Luminaire Tested: LD4D40BD010-EU4DR6540509030-4LBDP1H

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P748101
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D40BD010-EU4DR6540509030-4LBDP1H
Description: 4 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3296.4 lumens
Efficiency: N/A
Efficacy: 93.6 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 35.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P748101
CATALOG NUMBER: LD4D40BD010-EU4DR6540509030-4LBDP1H

Luminous Intensity Polar Plot

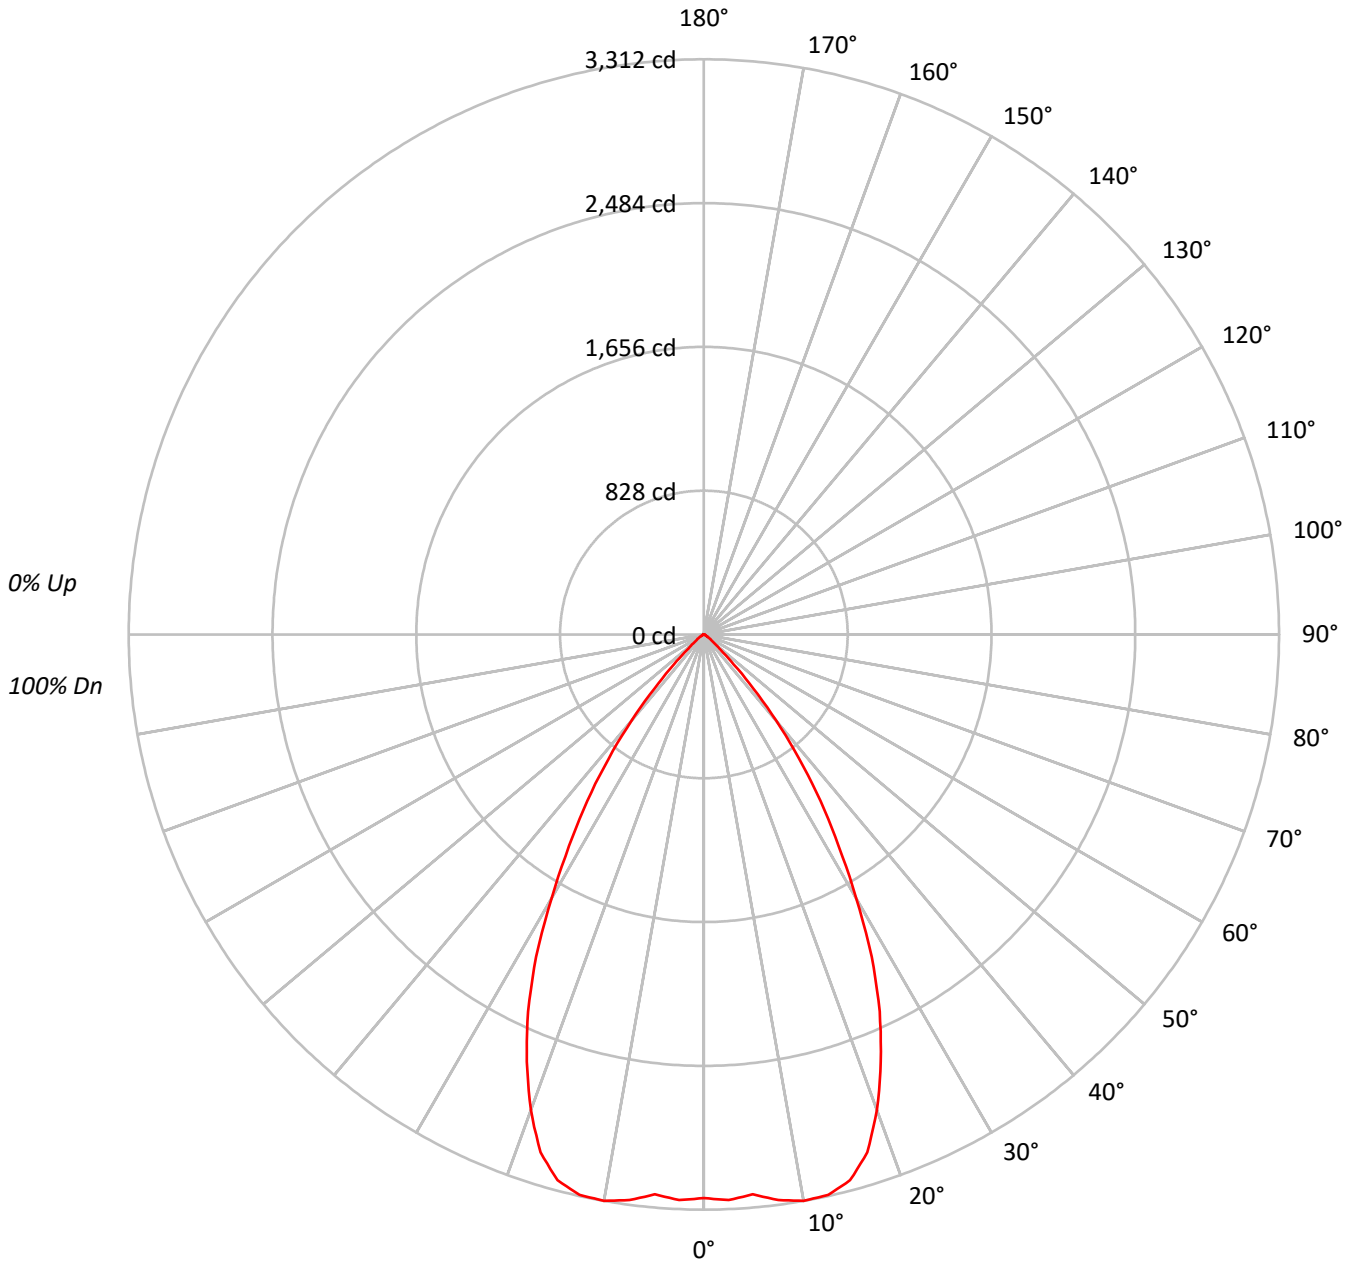



TEST NUMBER: P748101

CATALOG NUMBER: LD4D40BD010-EU4DR6540509030-4LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	354606
5°	354896
10°	367399
15°	368009
20°	338808
25°	288683
30°	221001
35°	156125
40°	92167
45°	37409
50°	13564
55°	7562
60°	4327
65°	2379
70°	2492
75°	1942
80°	2013
85°	1755

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 37409 cd/sqm



TEST NUMBER: P748101

CATALOG NUMBER: LD4D40BD010-EU4DR6540509030-4LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	312.5	9.5
10°-20°	901.5	27.3
20°-30°	1081.6	32.8
30°-40°	726.9	22.1
40°-50°	217.6	6.6
50°-60°	38.4	1.2
60°-70°	10.9	0.3
70°-80°	5.4	0.2
80°-90°	1.7	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2295.6	69.6
0°-40°	3022.4	91.7
0°-60°	3278.4	99.5
0°-90°	3296.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3296.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3246	
5°	3236	313
15°	3253	901
25°	2395	1082
35°	1170	727
45°	242	218
55°	40	38
65°	9	11
75°	5	5
85°	1	2
90°	0	



TEST NUMBER: P748101

CATALOG NUMBER: LD4D40BD010-EU4DR6540509030-4LBDP1H

CANDELA DISTRIBUTION (FULL):

0°	
0°	3245.5
2.5°	3259.4
5°	3235.8
7.5°	3284.7
10°	3311.5
12.5°	3305.0
15°	3253.4
17.5°	3127.0
20°	2913.9
22.5°	2663.0
25°	2394.6
27.5°	2091.6
30°	1751.7
32.5°	1443.6
35°	1170.5
37.5°	900.7
40°	646.2
42.5°	422.0
45°	242.1
47.5°	128.2
50°	79.8
52.5°	55.3
55°	39.7
57.5°	28.6
60°	19.8
62.5°	12.9
65°	9.2
67.5°	8.3
70°	7.8
72.5°	6.0
75°	4.6
77.5°	4.2
80°	3.2
82.5°	2.3
85°	1.4
87.5°	0.9
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)