

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P747885

Luminaire Tested: LD4D40BD010-EU4DR5040509035-4LBS1LI

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P747885
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D40BD010-EU4DR5040509035-4LBS1LI
Description: 4 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 50° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4358.7 lumens
Efficiency: N/A
Efficacy: 123.8 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 35.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P747885
CATALOG NUMBER: LD4D40BD010-EU4DR5040509035-4LBS1LI

Luminous Intensity Polar Plot

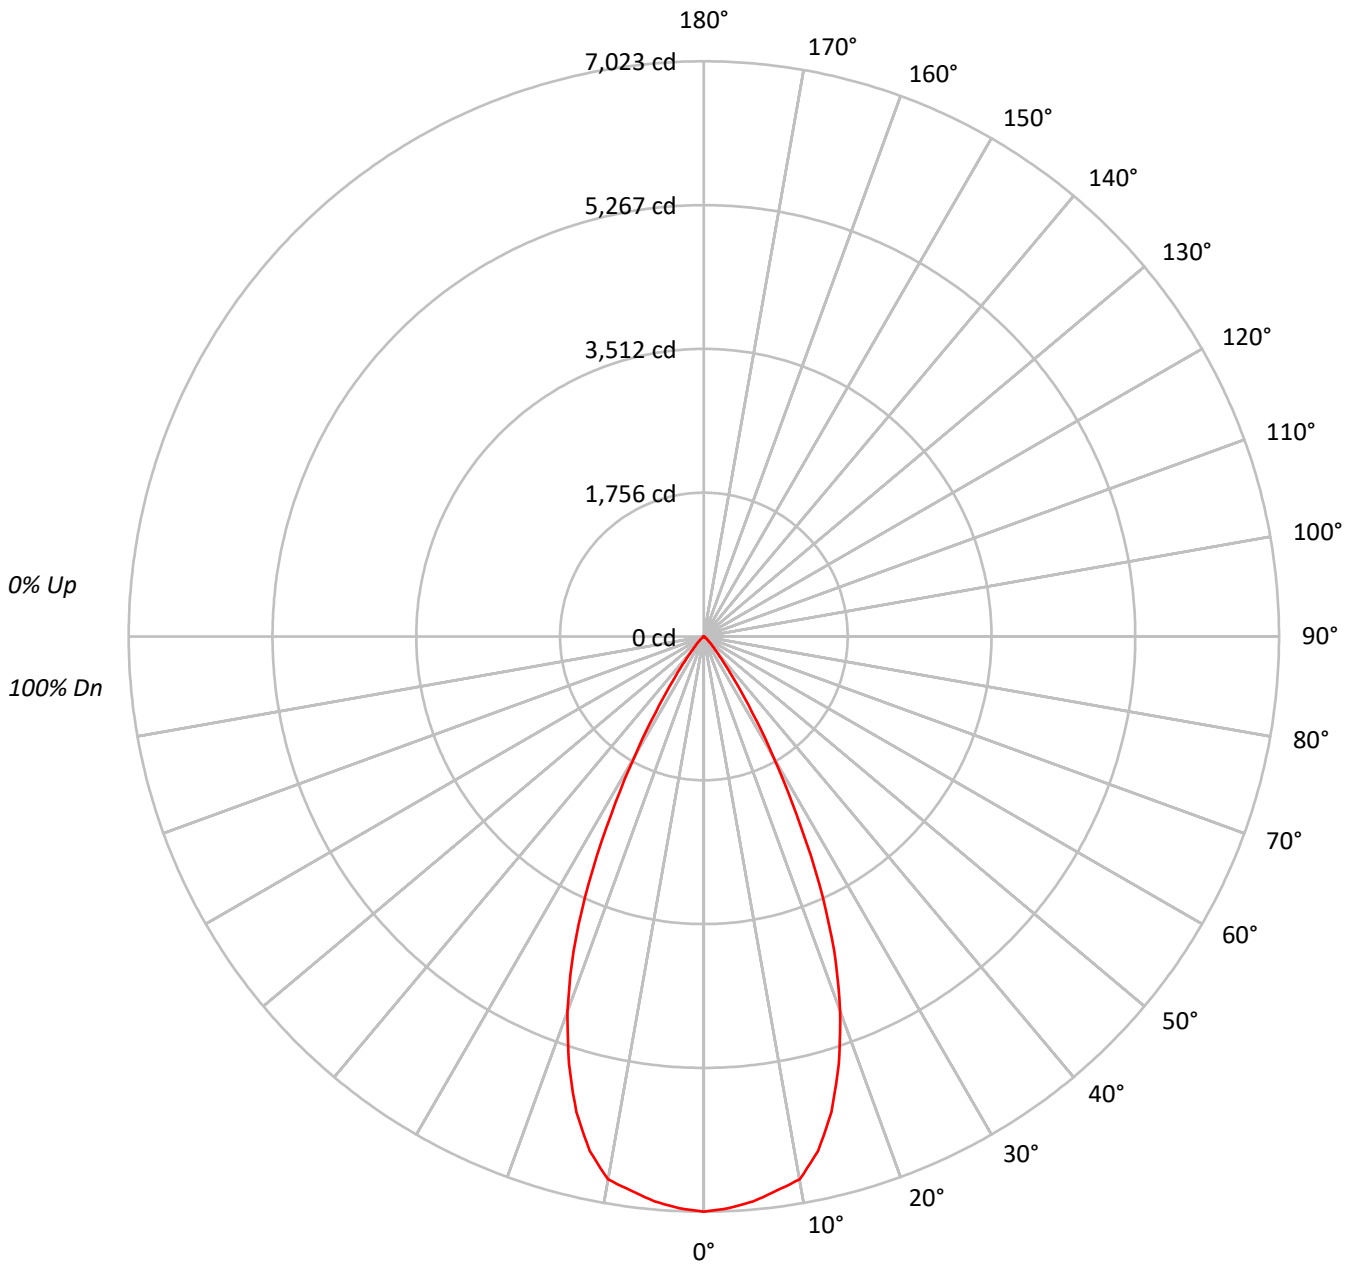



TEST NUMBER: P747885

CATALOG NUMBER: LD4D40BD010-EU4DR5040509035-4LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95																			
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90																			
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85																			
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80																			
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76																			
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72																			
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69																			
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65																			
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62																			
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	767338
5°	759291
10°	746790
15°	680002
20°	565842
25°	401668
30°	212598
35°	86632
40°	32177
45°	14726
50°	6034
55°	3162
60°	1552
65°	465
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 14726 cd/sqm



TEST NUMBER: P747885

CATALOG NUMBER: LD4D40BD010-EU4DR5040509035-4LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	654.3	15.0
10°-20°	1653.7	37.9
20°-30°	1485.4	34.1
30°-40°	465.1	10.7
40°-50°	81.4	1.9
50°-60°	16.2	0.4
60°-70°	2.4	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3793.5	87.0
0°-40°	4258.6	97.7
0°-60°	4356.2	99.9
0°-90°	4358.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4358.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7023	
5°	6923	654
15°	6012	1654
25°	3332	1485
35°	650	465
45°	95	81
55°	17	16
65°	2	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P747885

CATALOG NUMBER: LD4D40BD010-EU4DR5040509035-4LBS1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	7023.0
2.5°	6988.0
5°	6922.9
7.5°	6823.4
10°	6731.1
12.5°	6435.0
15°	6011.6
17.5°	5474.0
20°	4866.5
22.5°	4163.7
25°	3331.8
27.5°	2449.5
30°	1685.1
32.5°	1097.2
35°	649.5
37.5°	373.0
40°	225.6
42.5°	146.8
45°	95.3
47.5°	58.0
50°	35.5
52.5°	24.3
55°	16.6
57.5°	11.3
60°	7.1
62.5°	4.1
65°	1.8
67.5°	0.6
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)