

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P748143

Luminaire Tested: LD4D40BD010-EU4DR6540509050-4LBS1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P748143
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D40BD010-EU4DR6540509050-4LBS1B
Description: 4 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3432.1 lumens
Efficiency: N/A
Efficacy: 97.5 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct


Input Watts (W): 35.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P748143
CATALOG NUMBER: LD4D40BD010-EU4DR6540509050-4LBS1B

Luminous Intensity Polar Plot

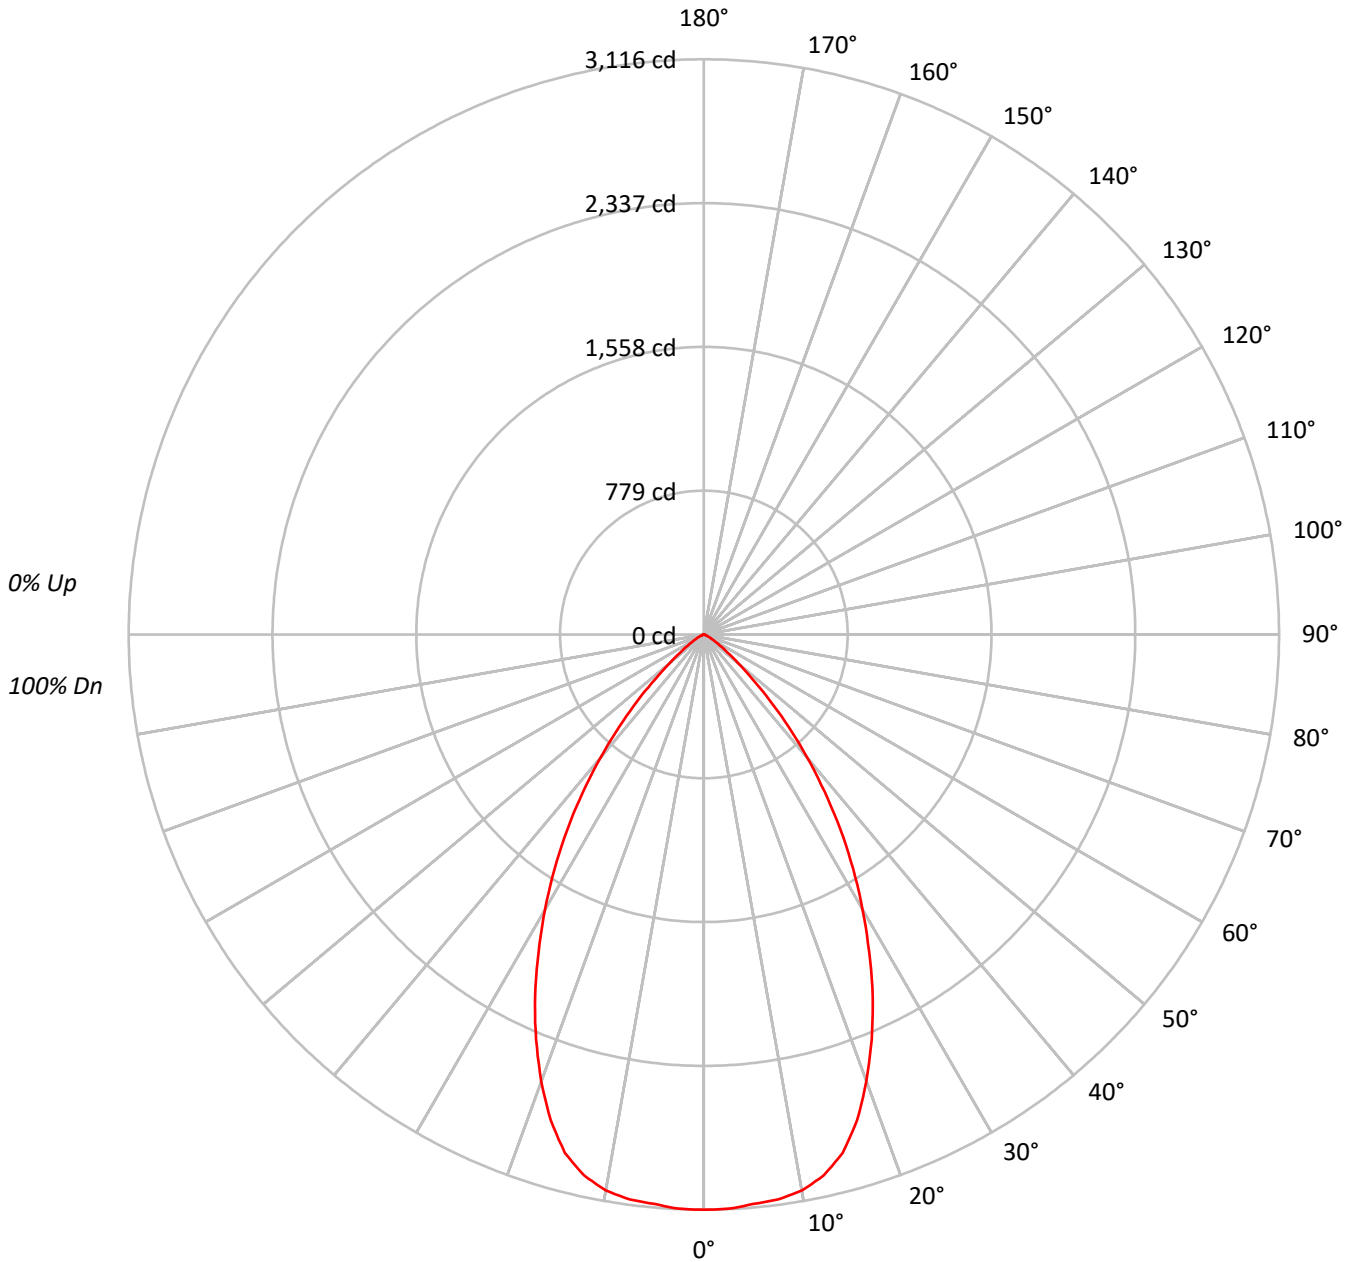



TEST NUMBER: P748143

CATALOG NUMBER: LD4D40BD010-EU4DR6540509050-4LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93			93
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85			85
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78			78
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72			72
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66			66
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61			61
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56			56
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52			52
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49			49
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46			46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	182004
5°	181544
10°	181390
15°	175799
20°	160042
25°	139464
30°	115995
35°	91910
40°	66337
45°	41909
50°	21843
55°	11608
60°	6097
65°	3358
70°	1400
75°	1557
80°	1076
85°	938

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 41909 cd/sqm



TEST NUMBER: P748143

CATALOG NUMBER: LD4D40BD010-EU4DR6540509050-4LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	294.7	8.6
10°-20°	807.0	23.5
20°-30°	986.4	28.7
30°-40°	800.4	23.3
40°-50°	398.8	11.6
50°-60°	111.2	3.2
60°-70°	25.3	0.7
70°-80°	6.6	0.2
80°-90°	1.7	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2088.1	60.8
0°-40°	2888.5	84.2
0°-60°	3398.6	99.0
0°-90°	3432.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3432.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3116	
5°	3097	295
15°	2908	807
25°	2164	986
35°	1289	800
45°	507	399
55°	114	111
65°	24	25
75°	7	7
85°	1	2
90°	0	



TEST NUMBER: P748143

CATALOG NUMBER: LD4D40BD010-EU4DR6540509050-4LBS1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	3116.3
2.5°	3114.0
5°	3096.6
7.5°	3086.5
10°	3058.6
12.5°	3001.8
15°	2907.5
17.5°	2760.0
20°	2575.0
22.5°	2375.3
25°	2164.2
27.5°	1938.5
30°	1720.0
32.5°	1504.3
35°	1289.1
37.5°	1074.3
40°	870.1
42.5°	678.7
45°	507.4
47.5°	353.5
50°	240.4
52.5°	165.8
55°	114.0
57.5°	76.9
60°	52.2
62.5°	36.2
65°	24.3
67.5°	12.4
70°	8.2
72.5°	7.8
75°	6.9
77.5°	4.6
80°	3.2
82.5°	2.3
85°	1.4
87.5°	0.9
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)