

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P748782

Luminaire Tested: LD4D45BD010-EU4DR6040509024-4LBS1LI

Issue Date: 1/30/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P748782  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-60)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 1/30/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD4D45BD010-EU4DR6040509024-4LBS1LI  
Description: 4 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 60° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 3913.8 lumens  
Efficiency: N/A  
Efficacy: 101.1 lumens/watt  
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct


Input Watts (W): 38.7  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P748782  
CATALOG NUMBER: LD4D45BD010-EU4DR6040509024-4LBS1LI

### Luminous Intensity Polar Plot

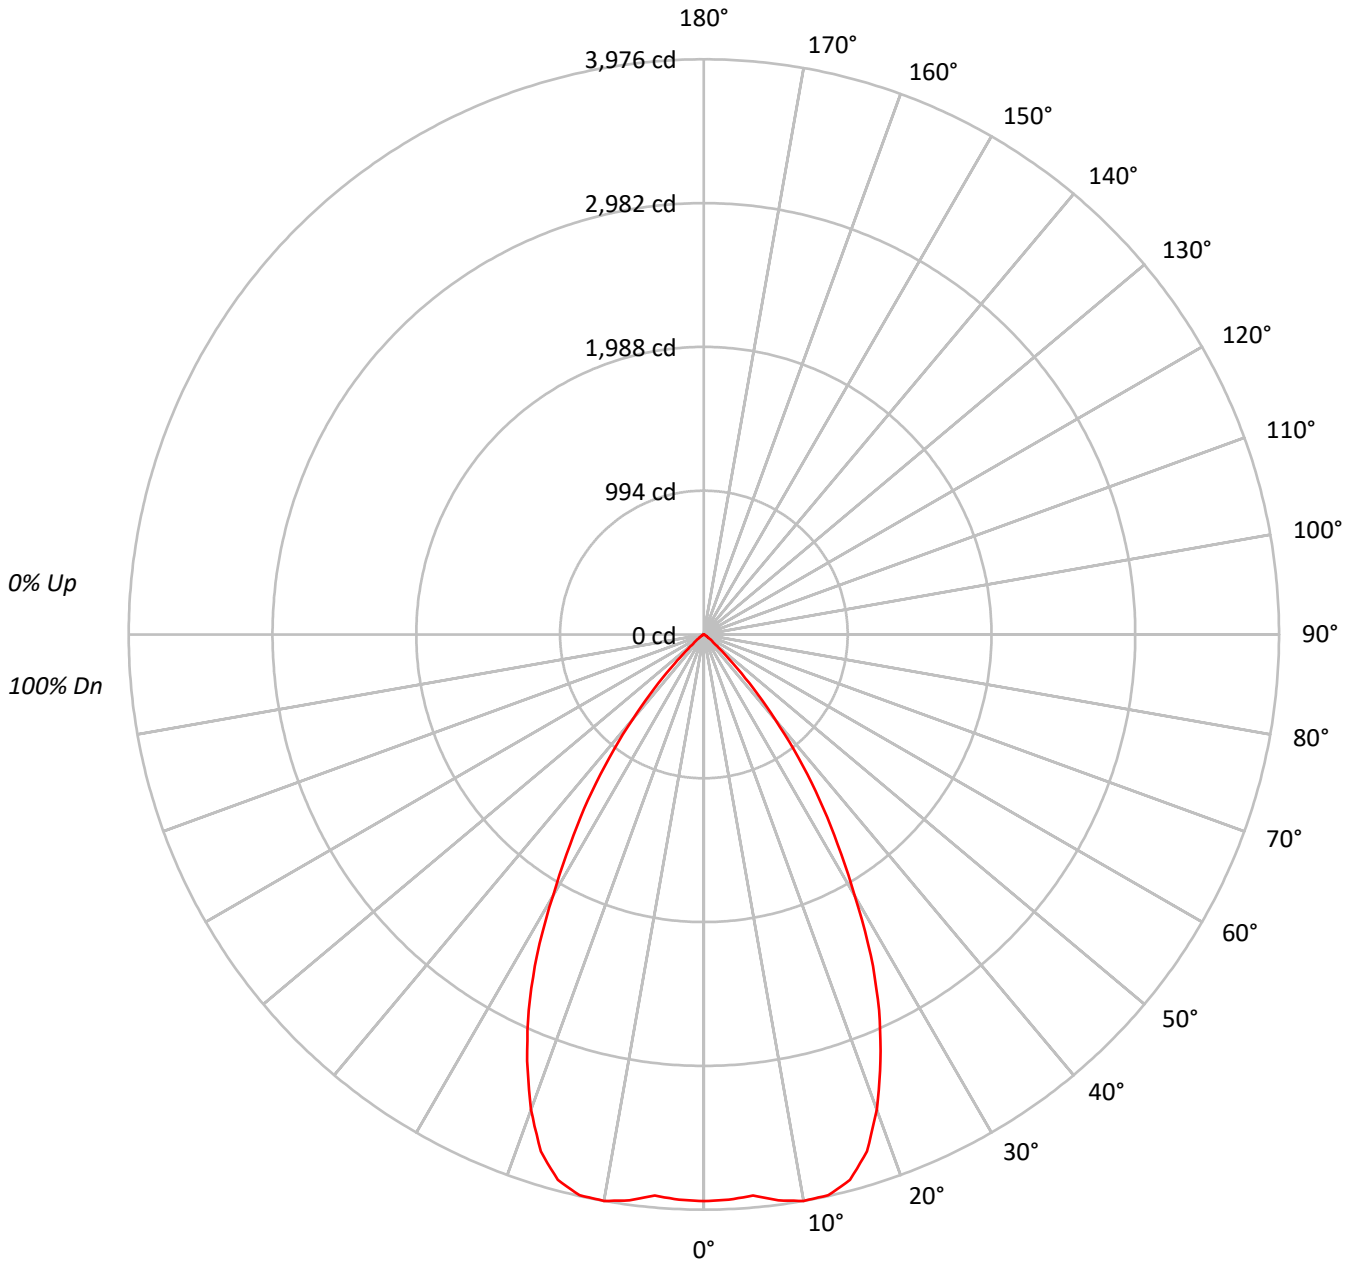



TEST NUMBER: P748782

CATALOG NUMBER: LD4D45BD010-EU4DR6040509024-4LBS1LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94																			
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87																			
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81																			
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75																			
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70																			
6	87	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65																			
7	83	74	68	63	82	73	67	63	72	67	63	71	66	63	69	65	62	61																			
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	61	58	57																			
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53																			
10	72	62	56	52	71	61	56	52	61	55	52	60	55	52	59	55	52	50																			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	427942
5°	426900
10°	441078
15°	441533
20°	406257
25°	345549
30°	263291
35°	186189
40°	109340
45°	44115
50°	14737
55°	7086
60°	2906
65°	440
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 44115 cd/sqm



TEST NUMBER: P748782

CATALOG NUMBER: LD4D45BD010-EU4DR6040509024-4LBS1LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	375.5	9.6
10°-20°	1081.4	27.6
20°-30°	1294.3	33.1
30°-40°	865.7	22.1
40°-50°	256.7	6.6
50°-60°	36.9	0.9
60°-70°	3.5	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2751.1	70.3
0°-40°	3616.7	92.4
0°-60°	3910.3	99.9
0°-90°	3913.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3913.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	3917	
5°	3892	375
15°	3903	1081
25°	2866	1294
35°	1396	866
45°	286	257
55°	37	37
65°	2	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P748782

CATALOG NUMBER: LD4D45BD010-EU4DR6040509024-4LBS1LI

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	3916.7
2.5°	3911.7
5°	3892.3
7.5°	3945.0
10°	3975.6
12.5°	3970.0
15°	3903.4
17.5°	3746.2
20°	3494.0
22.5°	3191.2
25°	2866.3
27.5°	2500.2
30°	2086.9
32.5°	1718.1
35°	1395.9
37.5°	1073.2
40°	766.6
42.5°	505.5
45°	285.5
47.5°	146.1
50°	86.7
52.5°	56.1
55°	37.2
57.5°	23.9
60°	13.3
62.5°	5.6
65°	1.7
67.5°	0.6
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)