

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P748244

Luminaire Tested: LD4D45BD010-EU4DR2540509027-4LBDP1H

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P748244
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-4)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D45BD010-EU4DR2540509027-4LBDP1H
Description: 4 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 25° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3574.0 lumens
Efficiency: N/A
Efficacy: 92.4 lumens/watt
Spacing Criteria (0/90/45): 0.42 / 0.42 / 0.45
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 38.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P748244
CATALOG NUMBER: LD4D45BD010-EU4DR2540509027-4LBDP1H

Luminous Intensity Polar Plot

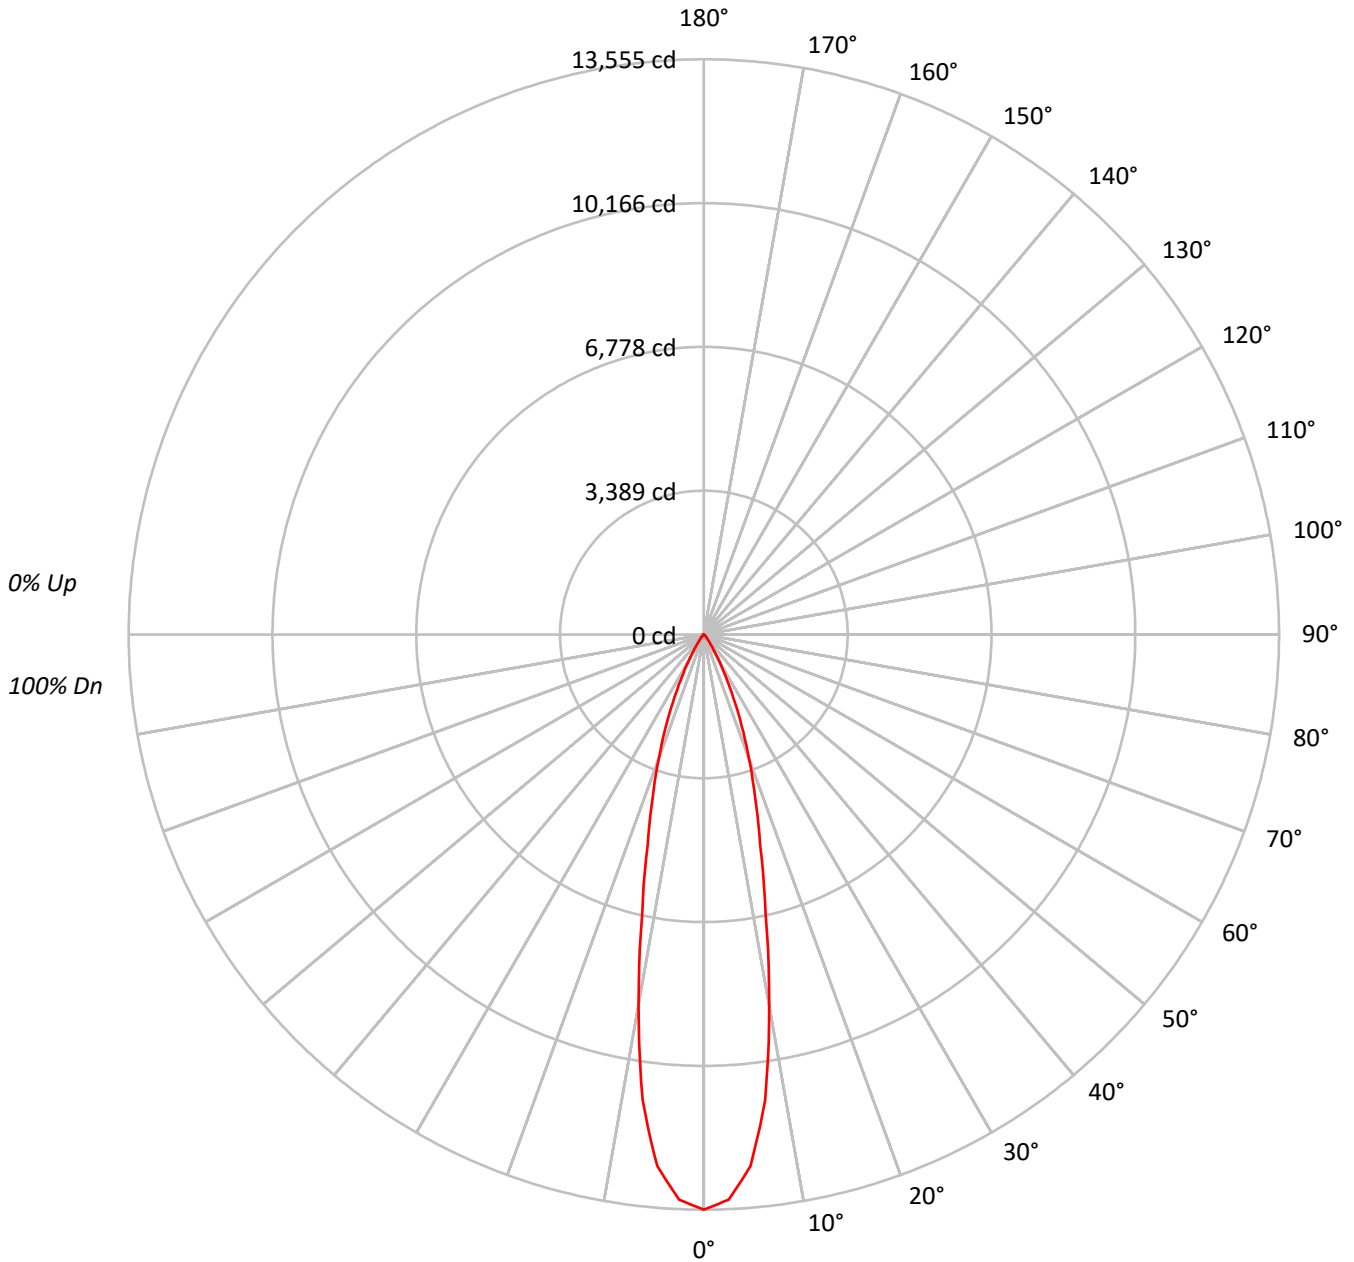



TEST NUMBER: P748244

CATALOG NUMBER: LD4D45BD010-EU4DR2540509027-4LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96		
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92		
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89		
4	103	97	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85		
5	100	93	89	86	98	93	89	86	91	87	85	89	86	84	88	85	83	82		
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79		
7	93	87	82	79	92	86	82	79	85	81	78	84	80	78	83	80	78	77		
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74		
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72		
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1481051
5°	1379411
10°	983971
15°	579522
20°	360585
25°	197893
30°	90497
35°	34279
40°	15518
45°	9333
50°	3876
55°	2495
60°	1748
65°	1189
70°	192
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 9333 cd/sqm



TEST NUMBER: P748244

CATALOG NUMBER: LD4D45BD010-EU4DR2540509027-4LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1080.9	30.2
10°-20°	1464.0	41.0
20°-30°	774.7	21.7
30°-40°	191.2	5.4
40°-50°	46.7	1.3
50°-60°	12.3	0.3
60°-70°	4.1	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3319.6	92.9
0°-40°	3510.8	98.2
0°-60°	3569.8	99.9
0°-90°	3574.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3574.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	13555	
5°	12577	###
15°	5123	1464
25°	1642	775
35°	257	191
45°	60	47
55°	13	12
65°	5	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P748244

CATALOG NUMBER: LD4D45BD010-EU4DR2540509027-4LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	13555.2
2.5°	13332.5
5°	12576.9
7.5°	11059.1
10°	8868.9
12.5°	6704.4
15°	5123.3
17.5°	3992.9
20°	3101.2
22.5°	2325.8
25°	1641.5
27.5°	1100.8
30°	717.3
32.5°	436.4
35°	257.0
37.5°	157.3
40°	108.8
42.5°	83.2
45°	60.4
47.5°	36.5
50°	22.8
52.5°	16.5
55°	13.1
57.5°	10.3
60°	8.0
62.5°	6.3
65°	4.6
67.5°	1.7
70°	0.6
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)