

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P748796

Luminaire Tested: LD4D45BD010-EU4DR6040509027-4LBS1MW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P748796
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-60)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D45BD010-EU4DR6040509027-4LBS1MW
Description: 4 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4012.7 lumens
Efficiency: N/A
Efficacy: 103.7 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 38.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P748796

CATALOG NUMBER: LD4D45BD010-EU4DR6040509027-4LBS1MW

Luminous Intensity Polar Plot

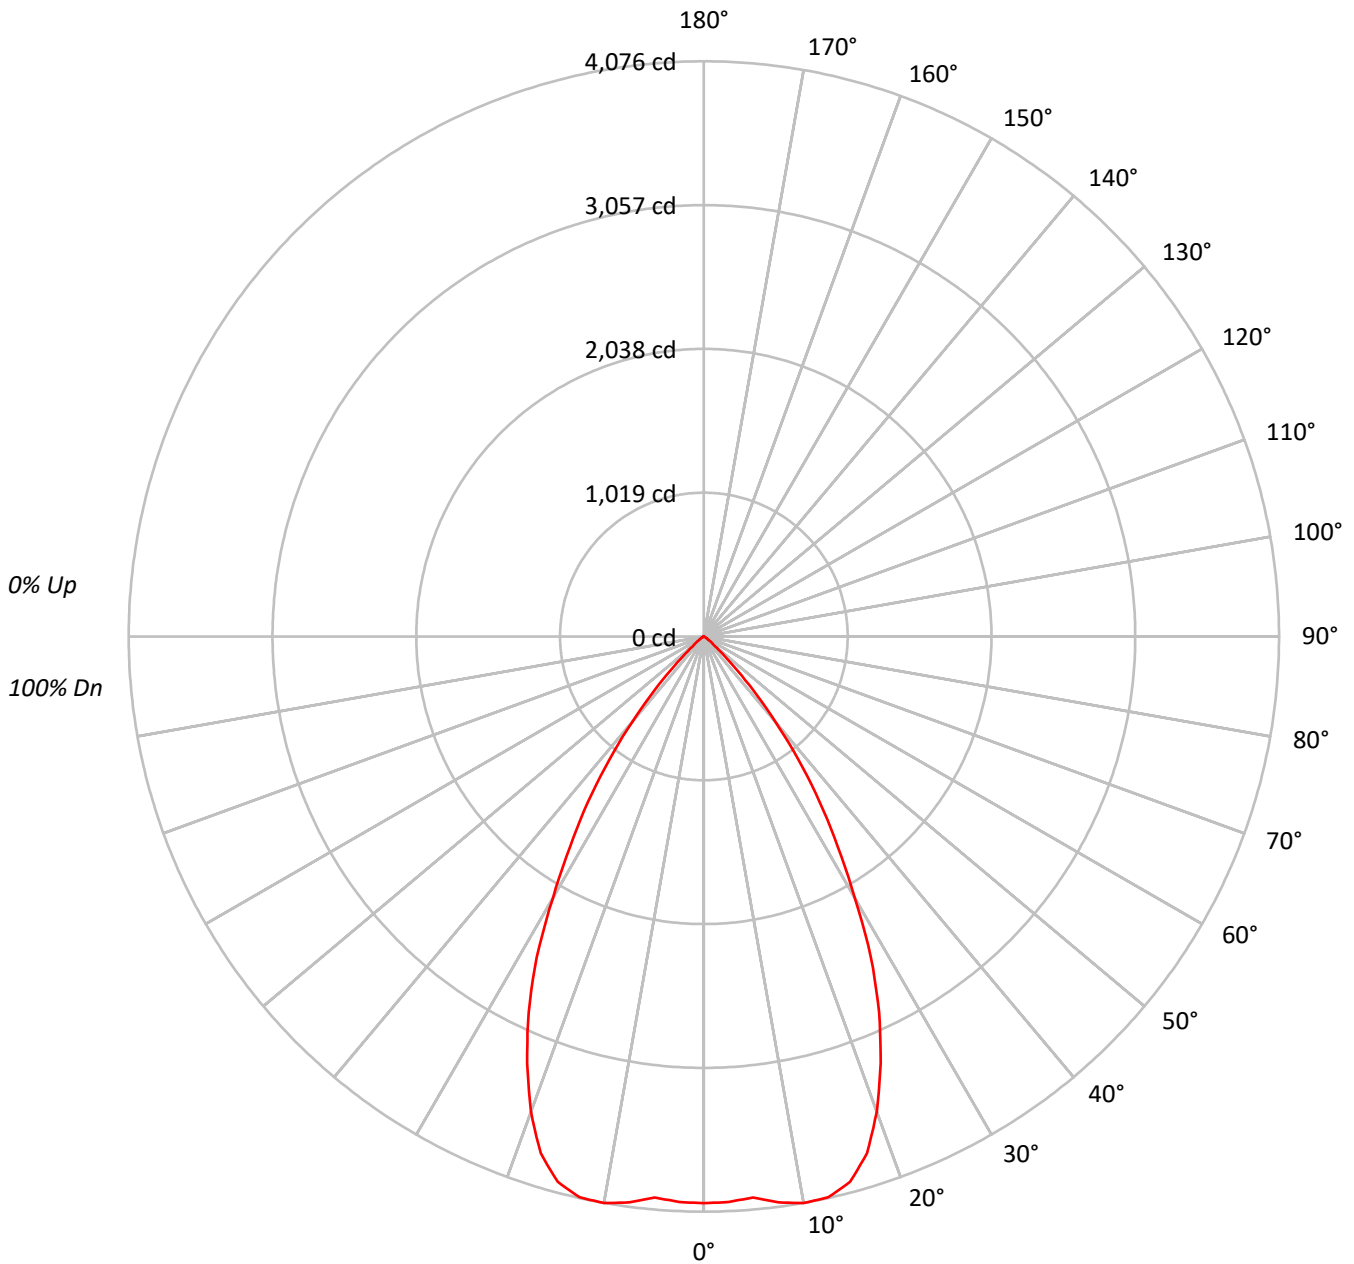



TEST NUMBER: P748796

CATALOG NUMBER: LD4D45BD010-EU4DR6040509027-4LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94			
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87			
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81			
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75			
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70			
6	87	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65			
7	83	74	68	63	82	73	67	63	72	67	63	71	66	63	69	65	62	61			
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	61	58	57			
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53			
10	72	62	56	52	71	61	56	52	61	55	52	60	55	52	59	55	52	50			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	438758
5°	437681
10°	452228
15°	452686
20°	416524
25°	354278
30°	269952
35°	190897
40°	112093
45°	45227
50°	15094
55°	7277
60°	2994
65°	440
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 45227 cd/sqm



TEST NUMBER: P748796

CATALOG NUMBER: LD4D45BD010-EU4DR6040509027-4LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	385.0	9.6
10°-20°	1108.7	27.6
20°-30°	1327.0	33.1
30°-40°	887.5	22.1
40°-50°	263.1	6.6
50°-60°	37.8	0.9
60°-70°	3.6	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2820.6	70.3
0°-40°	3708.1	92.4
0°-60°	4009.1	99.9
0°-90°	4012.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4012.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4016	
5°	3991	385
15°	4002	1109
25°	2939	1327
35°	1431	888
45°	293	263
55°	38	38
65°	2	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P748796

CATALOG NUMBER: LD4D45BD010-EU4DR6040509027-4LBS1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	4015.7
2.5°	4010.6
5°	3990.6
7.5°	4044.7
10°	4076.1
12.5°	4070.4
15°	4002.0
17.5°	3840.8
20°	3582.3
22.5°	3271.9
25°	2938.7
27.5°	2563.4
30°	2139.7
32.5°	1761.5
35°	1431.2
37.5°	1100.3
40°	785.9
42.5°	518.3
45°	292.7
47.5°	149.8
50°	88.8
52.5°	57.5
55°	38.2
57.5°	24.5
60°	13.7
62.5°	5.7
65°	1.7
67.5°	0.6
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)