

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P748432

Luminaire Tested: LD4D45BD010-EU4DR3540509035-4LBS1MW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P748432
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D45BD010-EU4DR3540509035-4LBS1MW
Description: 4 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3980.0 lumens
Efficiency: N/A
Efficacy: 102.8 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 38.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P748432

CATALOG NUMBER: LD4D45BD010-EU4DR3540509035-4LBS1MW

Luminous Intensity Polar Plot

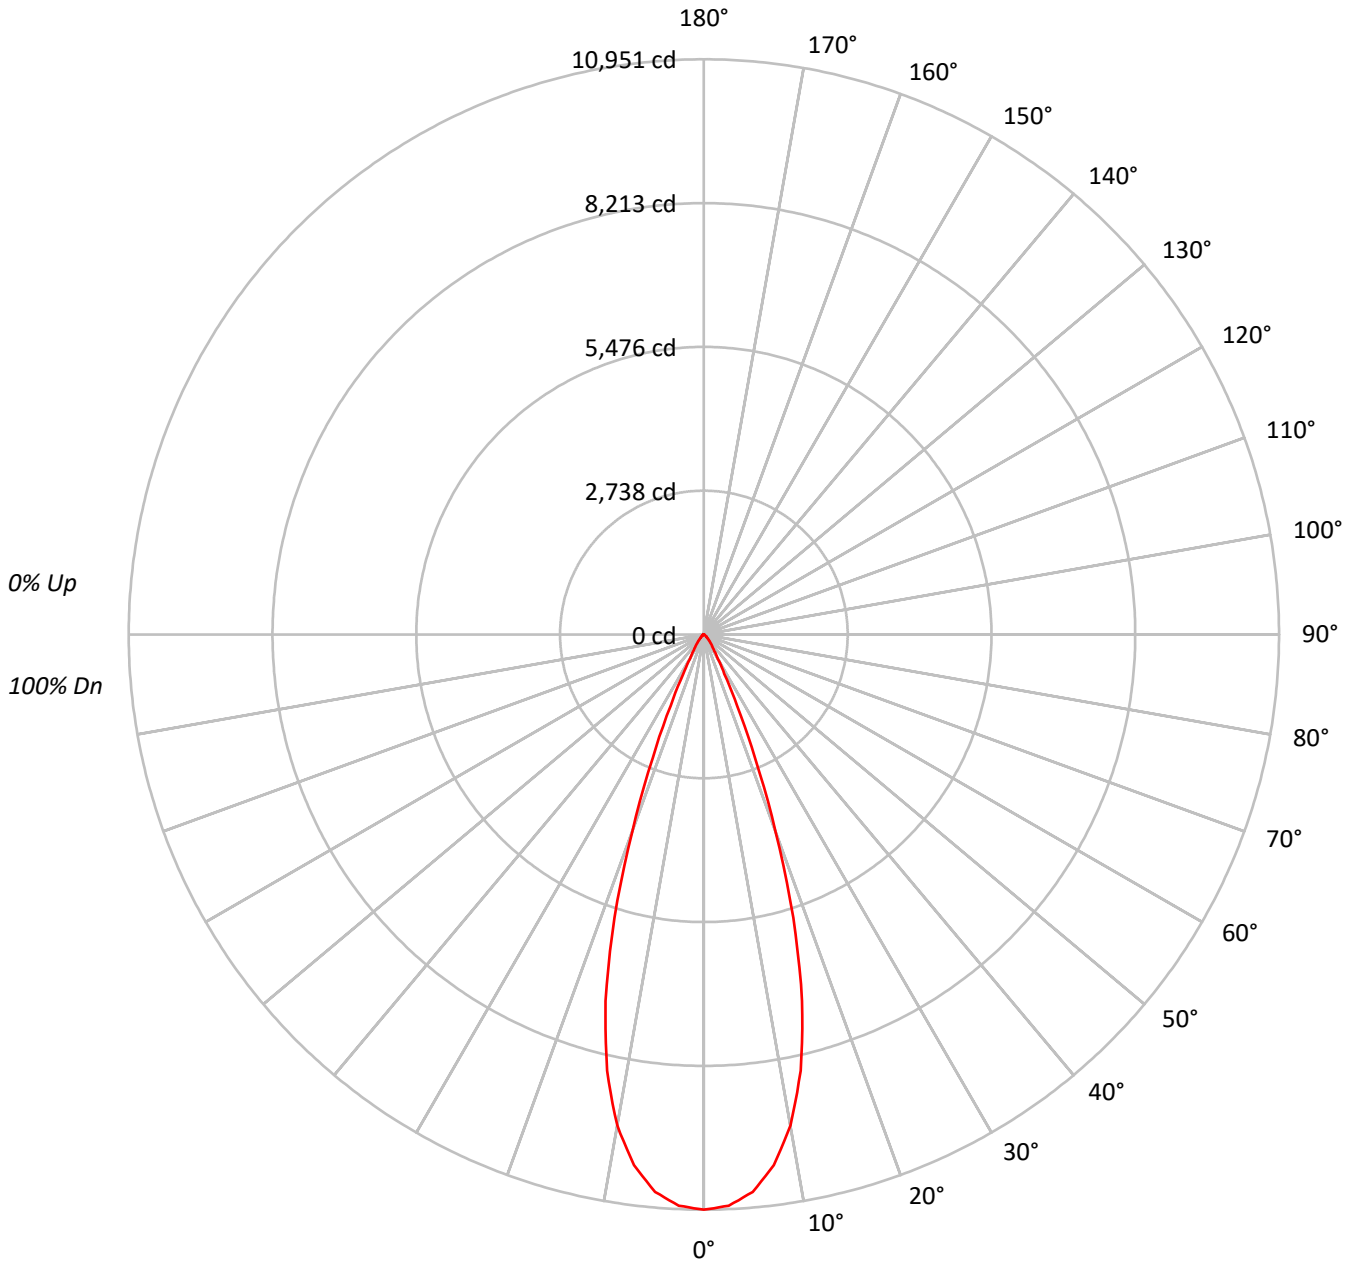



TEST NUMBER: P748432

CATALOG NUMBER: LD4D45BD010-EU4DR3540509035-4LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96		
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92		
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88		
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84		
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81		
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78		
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75		
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72		
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70		
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1196504
5°	1168390
10°	1053024
15°	817313
20°	463568
25°	180352
30°	67283
35°	36880
40°	24104
45°	14679
50°	9332
55°	6591
60°	4829
65°	2637
70°	192
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 14679 cd/sqm



TEST NUMBER: P748432

CATALOG NUMBER: LD4D45BD010-EU4DR3540509035-4LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	979.7	24.6
10°-20°	1912.9	48.1
20°-30°	780.1	19.6
30°-40°	186.7	4.7
40°-50°	77.8	2.0
50°-60°	32.2	0.8
60°-70°	10.1	0.3
70°-80°	0.2	0.0
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3672.8	92.3
0°-40°	3859.5	97.0
0°-60°	3969.5	99.7
0°-90°	3980.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3980.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	10951	
5°	10653	980
15°	7226	1913
25°	1496	780
35°	276	187
45°	95	78
55°	35	32
65°	10	10
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P748432

CATALOG NUMBER: LD4D45BD010-EU4DR3540509035-4LBS1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	10950.9
2.5°	10885.2
5°	10652.9
7.5°	10189.4
10°	9491.3
12.5°	8508.3
15°	7225.5
17.5°	5656.7
20°	3986.9
22.5°	2542.3
25°	1496.0
27.5°	845.6
30°	533.3
32.5°	374.4
35°	276.5
37.5°	213.8
40°	169.0
42.5°	130.2
45°	95.0
47.5°	71.1
50°	54.9
52.5°	43.6
55°	34.6
57.5°	28.1
60°	22.1
62.5°	16.1
65°	10.2
67.5°	3.6
70°	0.6
72.5°	0.6
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.6
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)