

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P748612

Luminaire Tested: LD4D45BD010-EU4DR4540509050-4LBS1H

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P748612
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D45BD010-EU4DR4540509050-4LBS1H
Description: 4 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4732.9 lumens
Efficiency: N/A
Efficacy: 122.3 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 38.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P748612
CATALOG NUMBER: LD4D45BD010-EU4DR4540509050-4LBS1H

Luminous Intensity Polar Plot

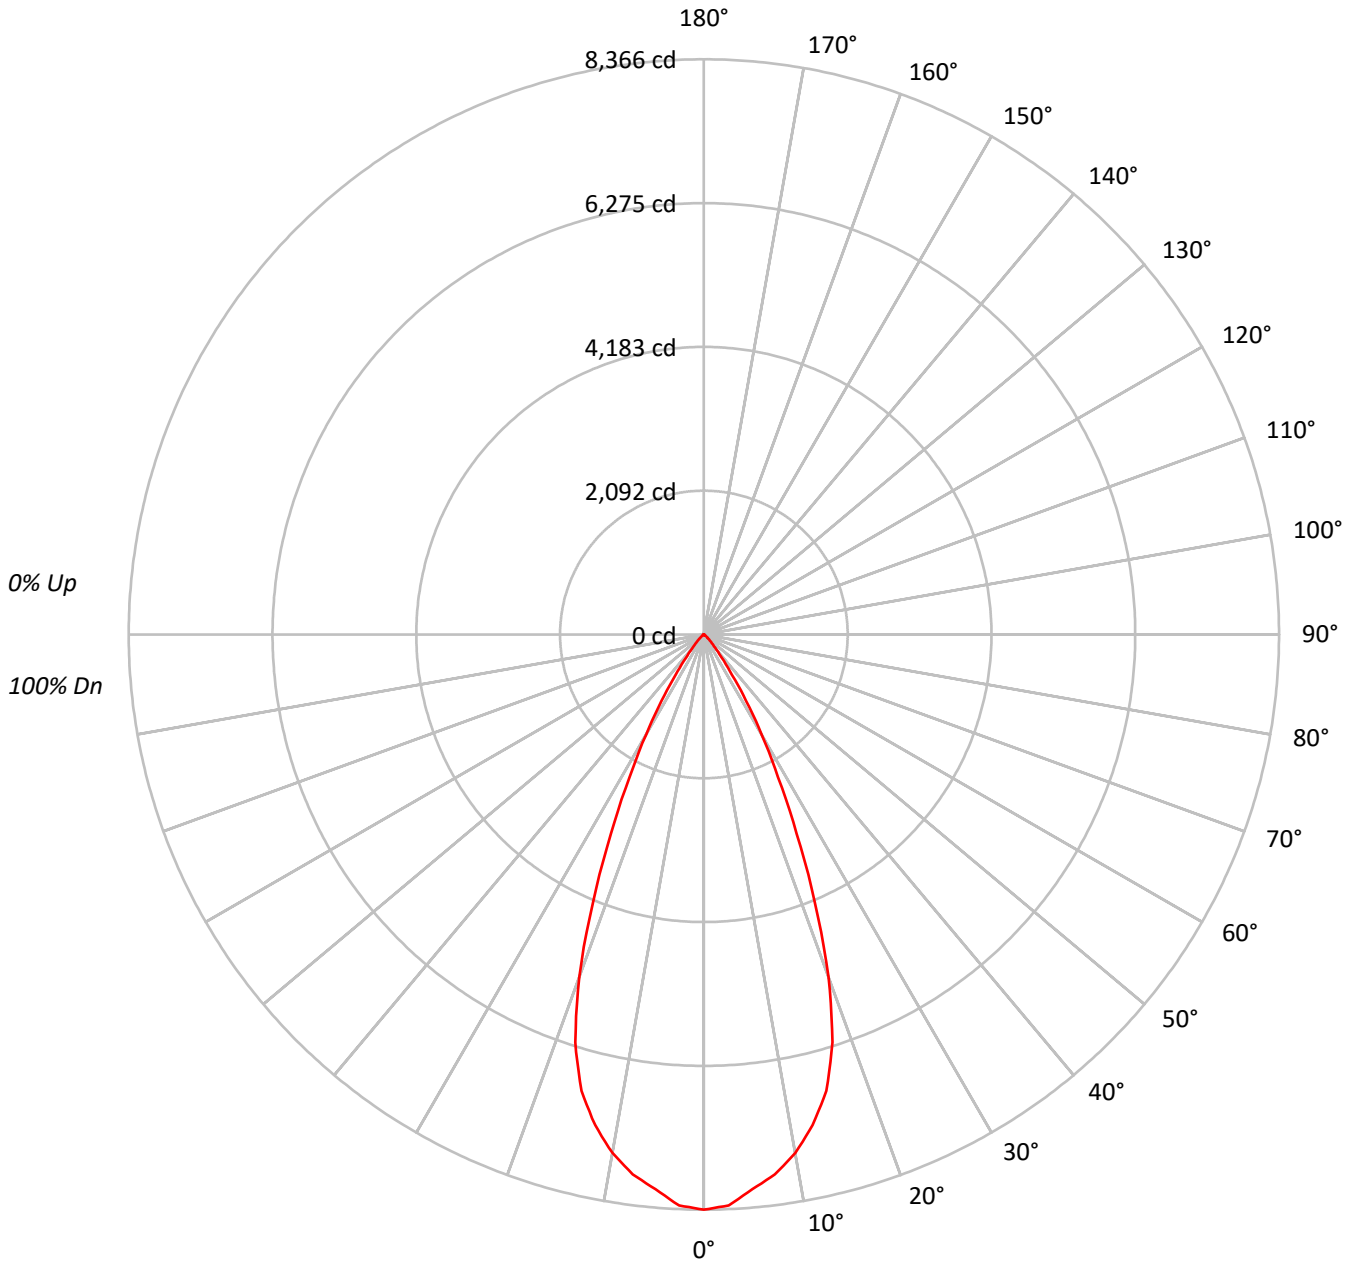



TEST NUMBER: P748612

CATALOG NUMBER: LD4D45BD010-EU4DR4540509050-4LBS1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95			95
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90			90
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85			85
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81			81
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77			77
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73			73
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69			69
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66			66
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63			63
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60			60

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	914032
5°	887998
10°	849582
15°	777542
20°	616862
25°	385116
30°	212270
35°	95315
40°	37540
45°	17692
50°	8380
55°	4381
60°	2163
65°	517
70°	224
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 17692 cd/sqm



TEST NUMBER: P748612

CATALOG NUMBER: LD4D45BD010-EU4DR4540509050-4LBS1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	760.7	16.1
10°-20°	1872.3	39.6
20°-30°	1482.7	31.3
30°-40°	493.7	10.4
40°-50°	98.0	2.1
50°-60°	22.2	0.5
60°-70°	3.2	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4115.7	87.0
0°-40°	4609.4	97.4
0°-60°	4729.6	99.9
0°-90°	4732.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4732.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	8366	
5°	8096	761
15°	6874	1872
25°	3194	1483
35°	715	494
45°	114	98
55°	23	22
65°	2	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P748612

CATALOG NUMBER: LD4D45BD010-EU4DR4540509050-4LBS1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	8365.6
2.5°	8310.9
5°	8096.4
7.5°	7919.4
10°	7657.6
12.5°	7308.8
15°	6873.9
17.5°	6219.9
20°	5305.3
22.5°	4215.7
25°	3194.5
27.5°	2339.1
30°	1682.5
32.5°	1144.2
35°	714.6
37.5°	423.7
40°	263.2
42.5°	173.0
45°	114.5
47.5°	73.7
50°	49.3
52.5°	32.9
55°	23.0
57.5°	15.1
60°	9.9
62.5°	5.3
65°	2.0
67.5°	0.7
70°	0.7
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)