

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P740645

Luminaire Tested: LD4D05D010-EU4DR650210IC9030-4LBDP1H

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P740645
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D05D010-EU4DR650210IC9030-4LBDP1H
Description: 4 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 556.7 lumens
Efficiency: N/A
Efficacy: 74.2 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 7.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P740645

CATALOG NUMBER: LD4D05D010-EU4DR650210IC9030-4LBDP1H

Luminous Intensity Polar Plot

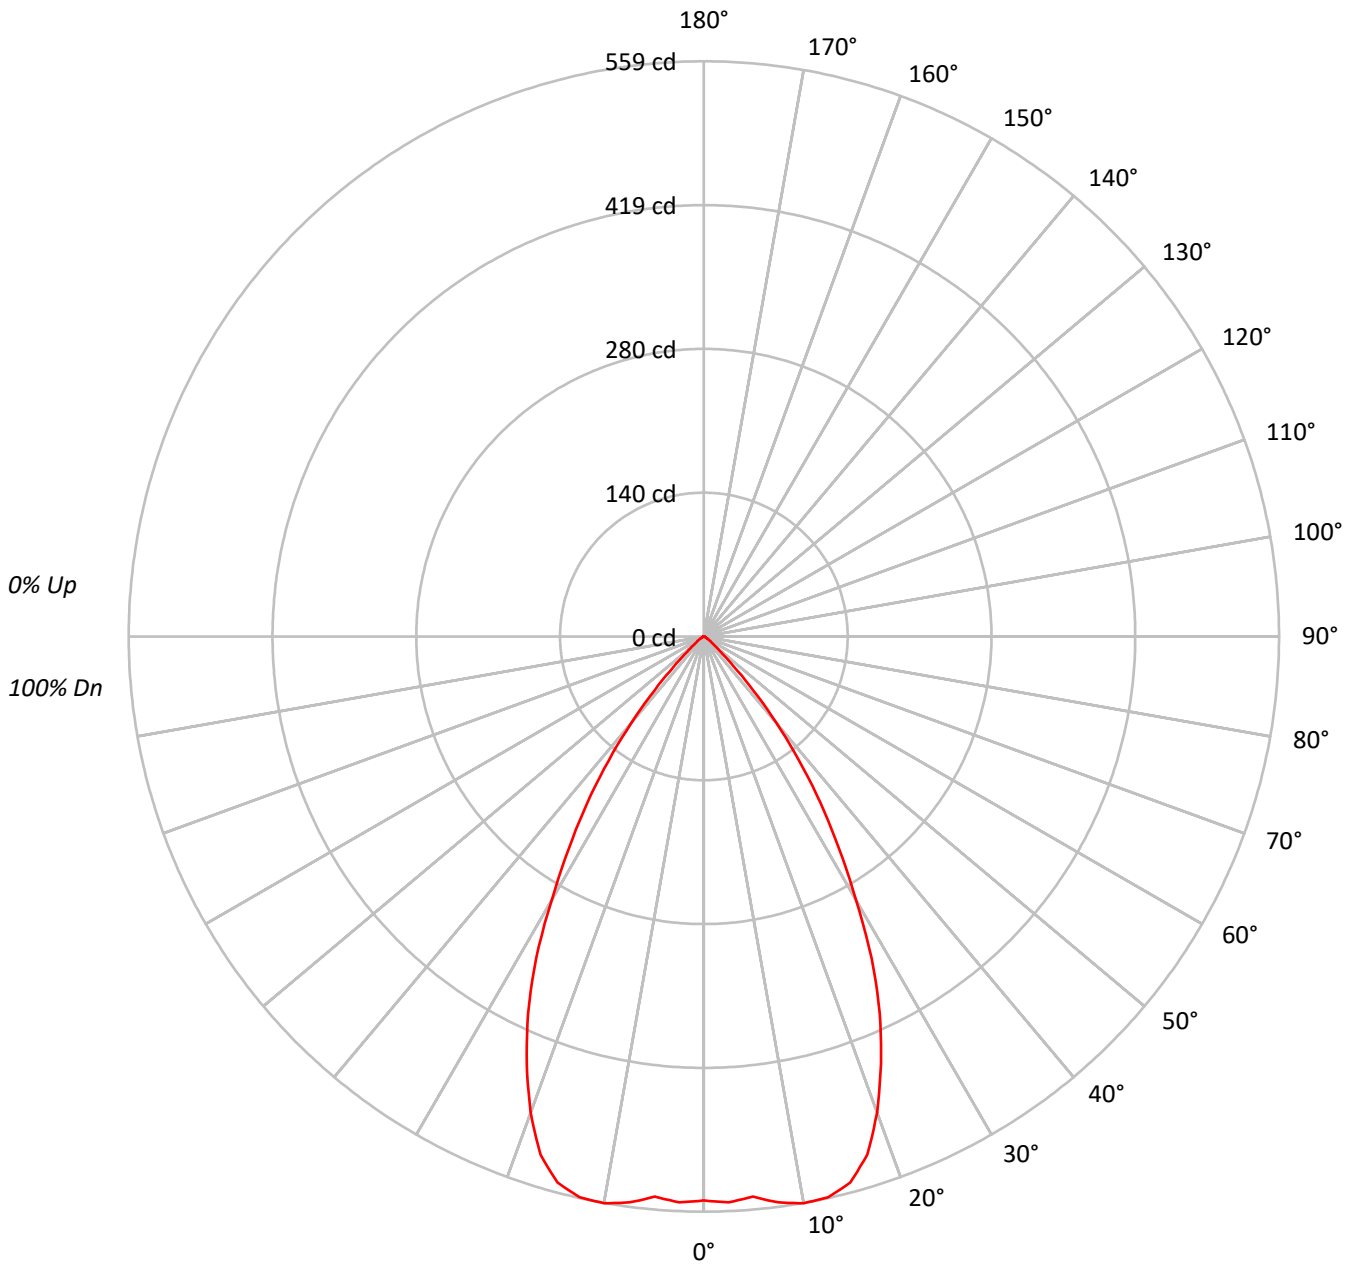



TEST NUMBER: P740645

CATALOG NUMBER: LD4D05D010-EU4DR650210IC9030-4LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	59897
5°	59939
10°	62052
15°	62157
20°	57230
25°	48753
30°	37332
35°	26370
40°	15561
45°	6320
50°	2295
55°	1276
60°	721
65°	388
70°	415
75°	338
80°	378
85°	251

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 6320 cd/sqm



TEST NUMBER: P740645

CATALOG NUMBER: LD4D05D010-EU4DR650210IC9030-4LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	52.8	9.5
10°-20°	152.3	27.3
20°-30°	182.7	32.8
30°-40°	122.8	22.0
40°-50°	36.8	6.6
50°-60°	6.5	1.2
60°-70°	1.8	0.3
70°-80°	0.9	0.2
80°-90°	0.3	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	387.7	69.6
0°-40°	510.5	91.7
0°-60°	553.7	99.5
0°-90°	556.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	556.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	548	
5°	546	53
15°	550	152
25°	404	183
35°	198	123
45°	41	37
55°	7	6
65°	2	2
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P740645

CATALOG NUMBER: LD4D05D010-EU4DR650210IC9030-4LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	548.2
2.5°	550.5
5°	546.5
7.5°	554.8
10°	559.3
12.5°	558.2
15°	549.5
17.5°	528.1
20°	492.2
22.5°	449.8
25°	404.4
27.5°	353.3
30°	295.9
32.5°	243.8
35°	197.7
37.5°	152.1
40°	109.1
42.5°	71.3
45°	40.9
47.5°	21.7
50°	13.5
52.5°	9.3
55°	6.7
57.5°	4.8
60°	3.3
62.5°	2.2
65°	1.5
67.5°	1.4
70°	1.3
72.5°	1.0
75°	0.8
77.5°	0.7
80°	0.6
82.5°	0.4
85°	0.2
87.5°	0.2
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)