

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P749429

Luminaire Tested: LD4D50D010-EU4DR5040509030-4LBDP1MW

Issue Date: 1/30/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P749429  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 1/30/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD4D50D010-EU4DR5040509030-4LBDP1MW  
Description: 4 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 50° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 4774.8 lumens  
Efficiency: N/A  
Efficacy: 101.6 lumens/watt  
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct


Input Watts (W): 47  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P749429  
CATALOG NUMBER: LD4D50D010-EU4DR5040509030-4LBDP1MW

### Luminous Intensity Polar Plot

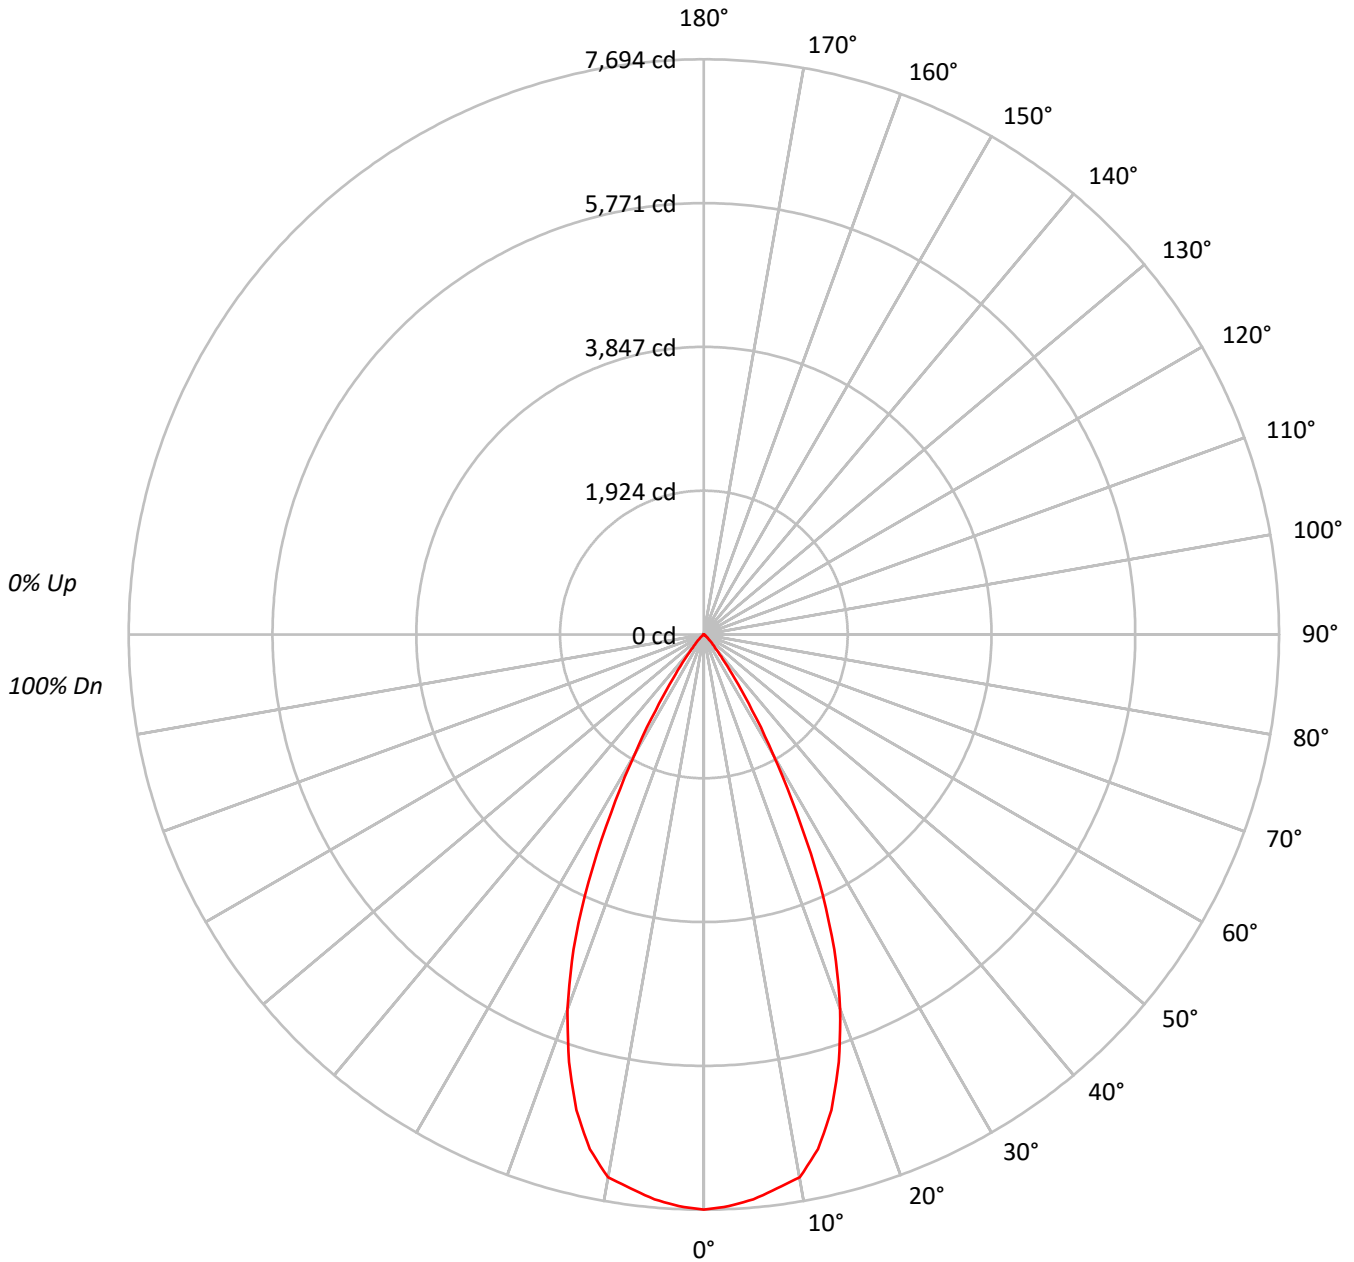



TEST NUMBER: P749429

CATALOG NUMBER: LD4D50D010-EU4DR5040509030-4LBDP1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	840598
5°	831788
10°	818085
15°	744931
20°	619862
25°	440017
30°	232898
35°	94915
40°	35244
45°	16132
50°	6612
55°	3467
60°	1704
65°	491
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 16132 cd/sqm



TEST NUMBER: P749429

CATALOG NUMBER: LD4D50D010-EU4DR5040509030-4LBDP1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	716.8	15.0
10°-20°	1811.6	37.9
20°-30°	1627.3	34.1
30°-40°	509.5	10.7
40°-50°	89.2	1.9
50°-60°	17.8	0.4
60°-70°	2.7	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4155.7	87.0
0°-40°	4665.2	97.7
0°-60°	4772.2	99.9
0°-90°	4774.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4774.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	7694	
5°	7584	717
15°	6586	1812
25°	3650	1627
35°	712	509
45°	104	89
55°	18	18
65°	2	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P749429

CATALOG NUMBER: LD4D50D010-EU4DR5040509030-4LBDP1MW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	7693.5
2.5°	7655.2
5°	7583.9
7.5°	7474.9
10°	7373.7
12.5°	7049.4
15°	6585.6
17.5°	5996.6
20°	5331.1
22.5°	4561.2
25°	3649.9
27.5°	2683.4
30°	1846.0
32.5°	1201.9
35°	711.6
37.5°	408.6
40°	247.1
42.5°	160.9
45°	104.4
47.5°	63.6
50°	38.9
52.5°	26.6
55°	18.2
57.5°	12.3
60°	7.8
62.5°	4.5
65°	1.9
67.5°	0.6
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)