

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P749753

Luminaire Tested: LD4D50D010-EU4DR7040509035-4LBDP1LI

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P749753
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-73)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D50D010-EU4DR7040509035-4LBDP1LI
Description: 4 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5183.3 lumens
Efficiency: N/A
Efficacy: 110.3 lumens/watt
Spacing Criteria (0/90/45): 0.88 / 0.88 / 0.82
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 47
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P749753
CATALOG NUMBER: LD4D50D010-EU4DR7040509035-4LBDP1LI

Luminous Intensity Polar Plot

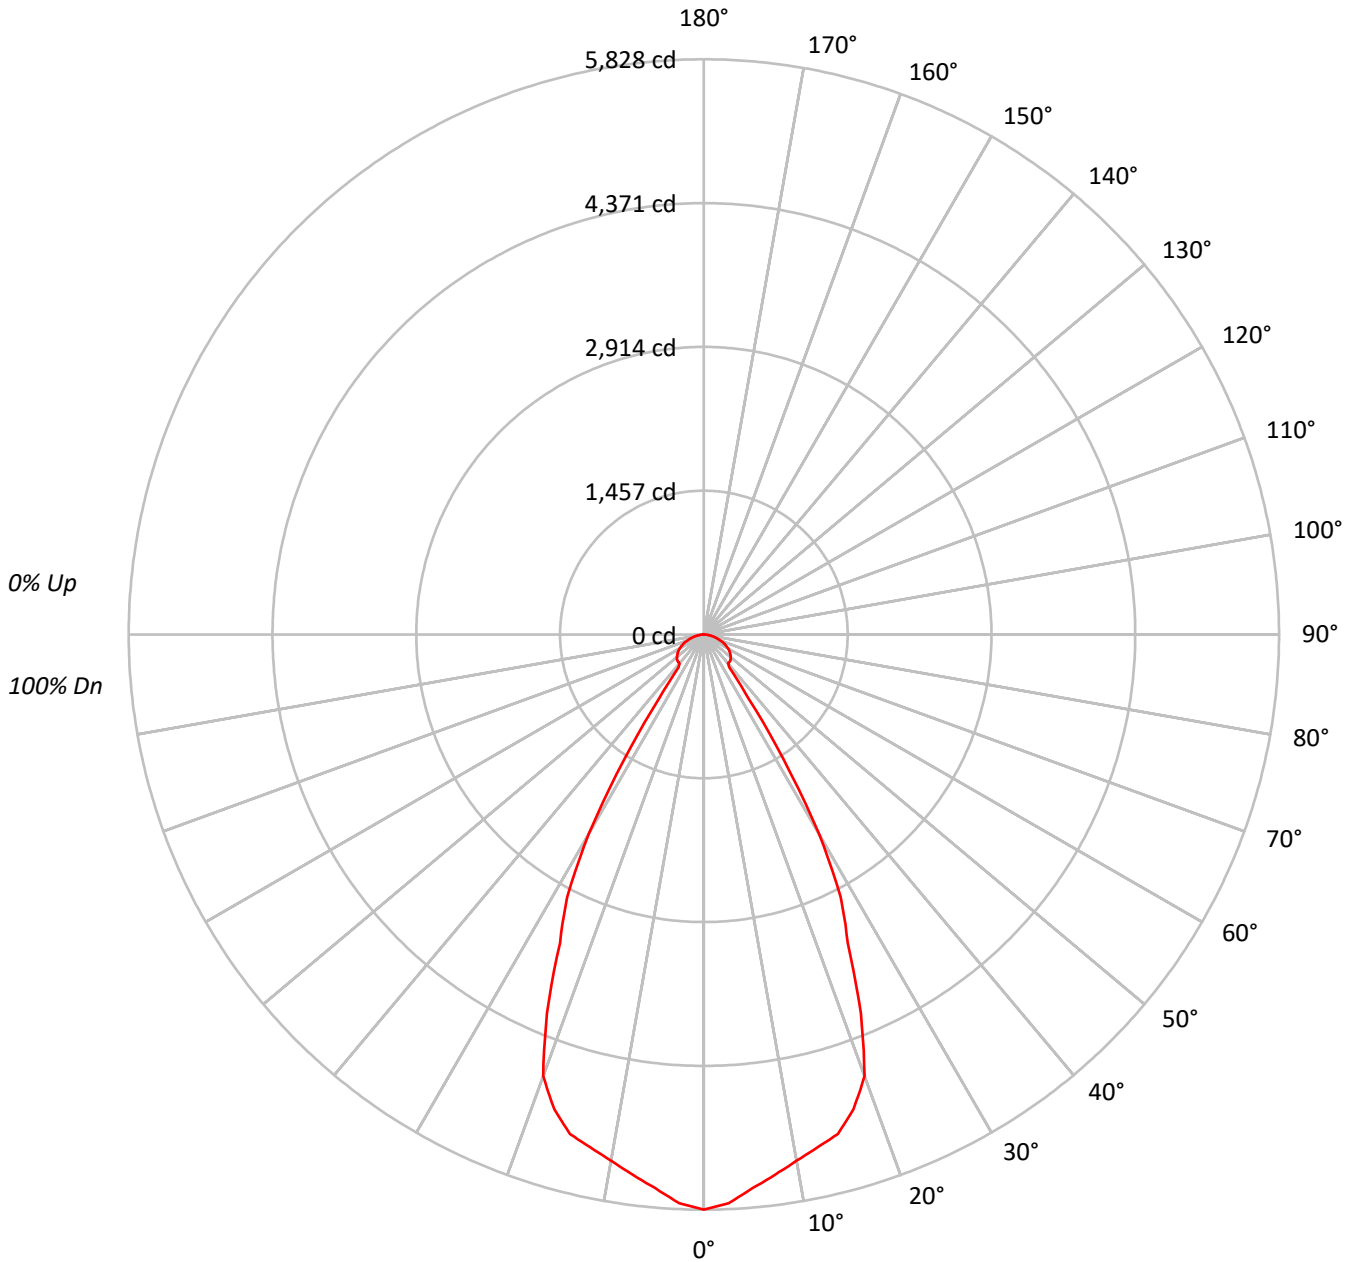



TEST NUMBER: P749753

CATALOG NUMBER: LD4D50D010-EU4DR7040509035-4LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	112	109	106	103	110	107	104	102	103	101	99	99	97	96	95	94	93	91			
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	85	83			
3	100	92	87	82	98	91	86	81	88	84	80	86	82	79	83	80	78	76			
4	94	86	80	75	92	85	79	74	82	77	73	80	76	73	78	75	72	70			
5	89	80	74	69	87	79	73	69	77	72	68	75	71	67	74	70	67	65			
6	85	75	68	64	83	74	68	64	73	67	63	71	66	63	70	66	62	61			
7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57			
8	77	66	60	56	75	66	60	56	65	59	55	64	59	55	63	58	55	53			
9	73	63	57	52	72	62	56	52	61	56	52	60	55	52	60	55	52	50			
10	70	59	53	49	69	59	53	49	58	53	49	57	52	49	57	52	49	48			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	636717
5°	617806
10°	600585
15°	592700
20°	553459
25°	415785
30°	293923
35°	104119
40°	54741
45°	58315
50°	60377
55°	61509
60°	61907
65°	60600
70°	57183
75°	52980
80°	47002
85°	38110

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 57.5°
 Luminance: 61921 cd/sqm



TEST NUMBER: P749753

CATALOG NUMBER: LD4D50D010-EU4DR7040509035-4LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	531.3	10.3
10°-20°	1457.3	28.1
20°-30°	1605.0	31.0
30°-40°	613.3	11.8
40°-50°	289.6	5.6
50°-60°	287.9	5.6
60°-70°	230.5	4.4
70°-80°	132.5	2.6
80°-90°	36.0	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3593.7	69.3
0°-40°	4206.9	81.2
0°-60°	4784.4	92.3
0°-90°	5183.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5183.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5828	
5°	5633	531
15°	5240	1457
25°	3449	1605
35°	781	613
45°	377	290
55°	323	288
65°	234	231
75°	126	132
85°	30	36
90°	0	



TEST NUMBER: P749753
CATALOG NUMBER: LD4D50D010-EU4DR7040509035-4LBDP1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	5827.5
2.5°	5766.6
5°	5632.9
7.5°	5521.2
10°	5413.3
12.5°	5321.9
15°	5239.8
17.5°	5041.4
20°	4760.0
22.5°	4152.9
25°	3448.9
27.5°	3002.3
30°	2329.7
32.5°	1504.9
35°	780.6
37.5°	421.7
40°	383.8
42.5°	381.1
45°	377.4
47.5°	369.1
50°	355.2
52.5°	339.5
55°	322.9
57.5°	304.5
60°	283.3
62.5°	259.3
65°	234.4
67.5°	206.7
70°	179.0
72.5°	151.3
75°	125.5
77.5°	98.7
80°	74.7
82.5°	52.6
85°	30.4
87.5°	12.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)