

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P749388

Luminaire Tested: LD4D50D010-EU4DR4540509050-4LBDP1H

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P749388
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D50D010-EU4DR4540509050-4LBDP1H
Description: 4 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5280.4 lumens
Efficiency: N/A
Efficacy: 112.3 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 47
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P749388
CATALOG NUMBER: LD4D50D010-EU4DR4540509050-4LBDP1H

Luminous Intensity Polar Plot

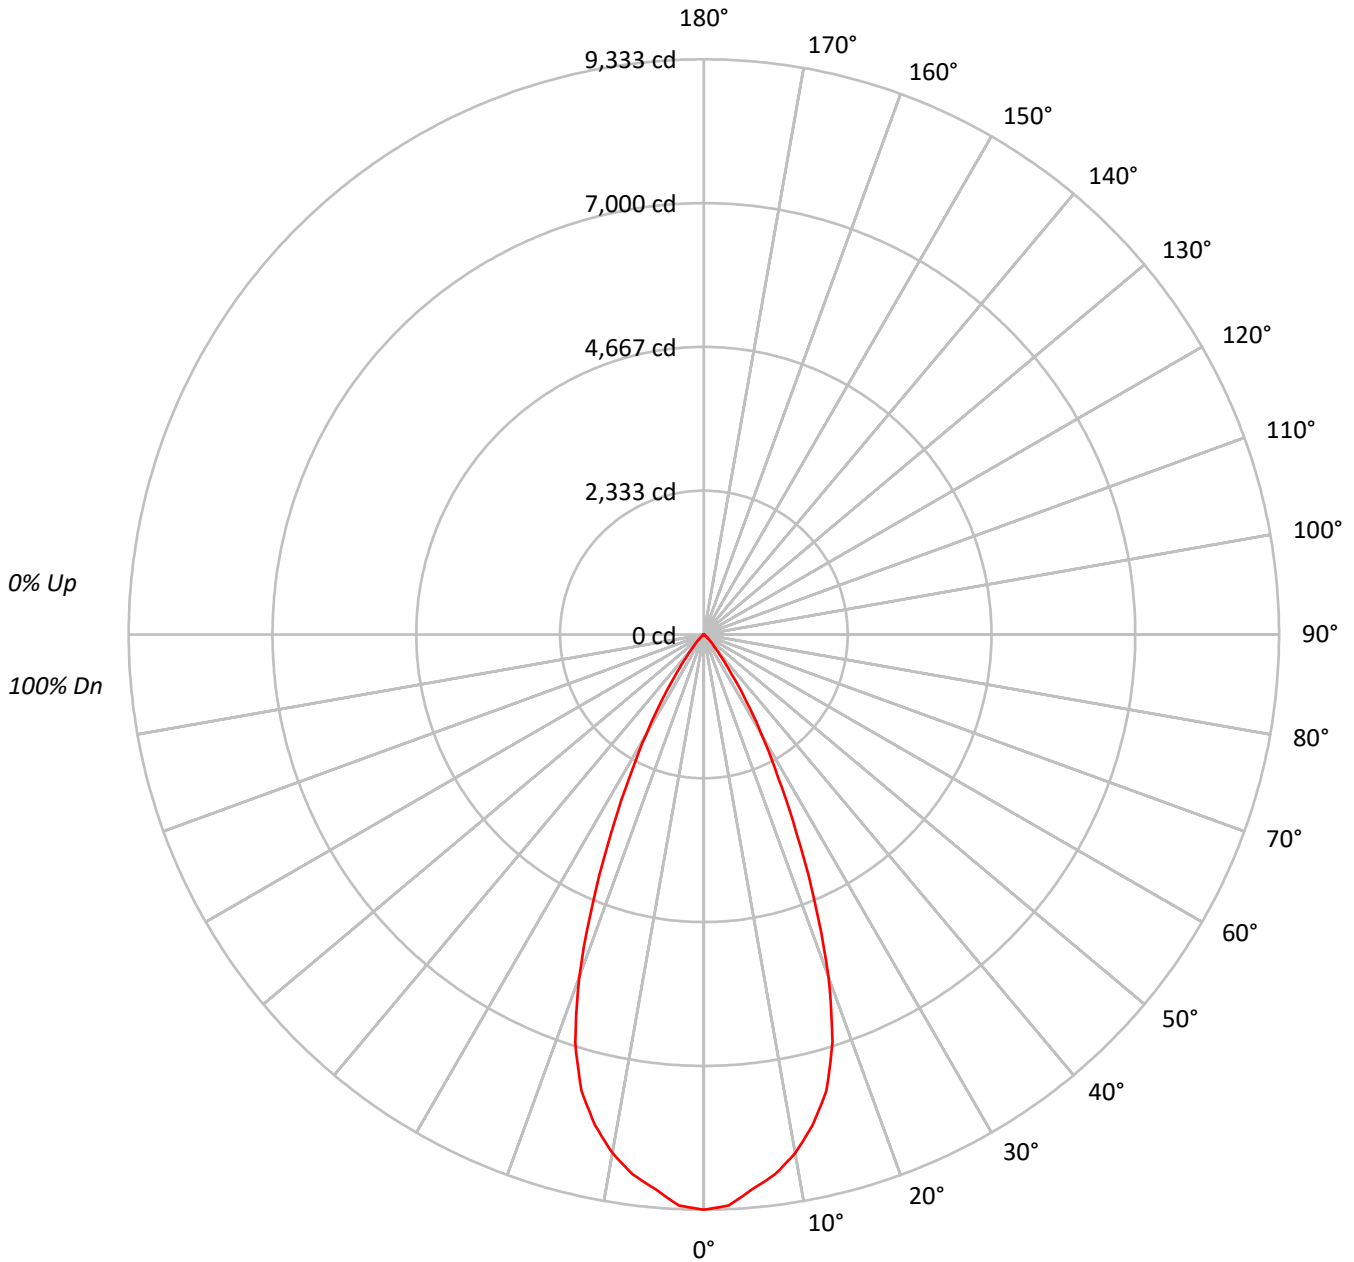



TEST NUMBER: P749388

CATALOG NUMBER: LD4D50D010-EU4DR4540509050-4LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95	95	95	95
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90	90	90	90
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85	85	85	85
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81	81	81	81
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77	77	77	77
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73	73	73	73
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69	69	69	69
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66	66	66	66
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63	63	63	63
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60	60	60	60

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1019763
5°	990733
10°	947858
15°	867491
20°	688219
25°	429673
30°	236821
35°	106333
40°	41876
45°	19732
50°	9366
55°	4896
60°	2404
65°	569
70°	224
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 19732 cd/sqm



TEST NUMBER: P749388

CATALOG NUMBER: LD4D50D010-EU4DR4540509050-4LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	848.7	16.1
10°-20°	2088.9	39.6
20°-30°	1654.2	31.3
30°-40°	550.9	10.4
40°-50°	109.3	2.1
50°-60°	24.8	0.5
60°-70°	3.6	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4591.8	87.0
0°-40°	5142.6	97.4
0°-60°	5276.8	99.9
0°-90°	5280.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5280.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	9333	
5°	9033	849
15°	7669	2089
25°	3564	1654
35°	797	551
45°	128	109
55°	26	25
65°	2	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P749388
CATALOG NUMBER: LD4D50D010-EU4DR4540509050-4LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	9333.3
2.5°	9272.4
5°	9033.1
7.5°	8835.6
10°	8543.4
12.5°	8154.4
15°	7669.1
17.5°	6939.4
20°	5919.0
22.5°	4703.4
25°	3564.1
27.5°	2609.7
30°	1877.1
32.5°	1276.6
35°	797.2
37.5°	472.8
40°	293.6
42.5°	193.1
45°	127.7
47.5°	82.2
50°	55.1
52.5°	36.7
55°	25.7
57.5°	16.9
60°	11.0
62.5°	5.9
65°	2.2
67.5°	0.7
70°	0.7
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)