

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P749986

Luminaire Tested: LD4D55D010-EU4DR3555659035-4LBDP1H

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P749986
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D55D010-EU4DR3555659035-4LBDP1H
Description: 4 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5281.2 lumens
Efficiency: N/A
Efficacy: 90.7 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 58.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P749986
CATALOG NUMBER: LD4D55D010-EU4DR3555659035-4LBDP1H

Luminous Intensity Polar Plot

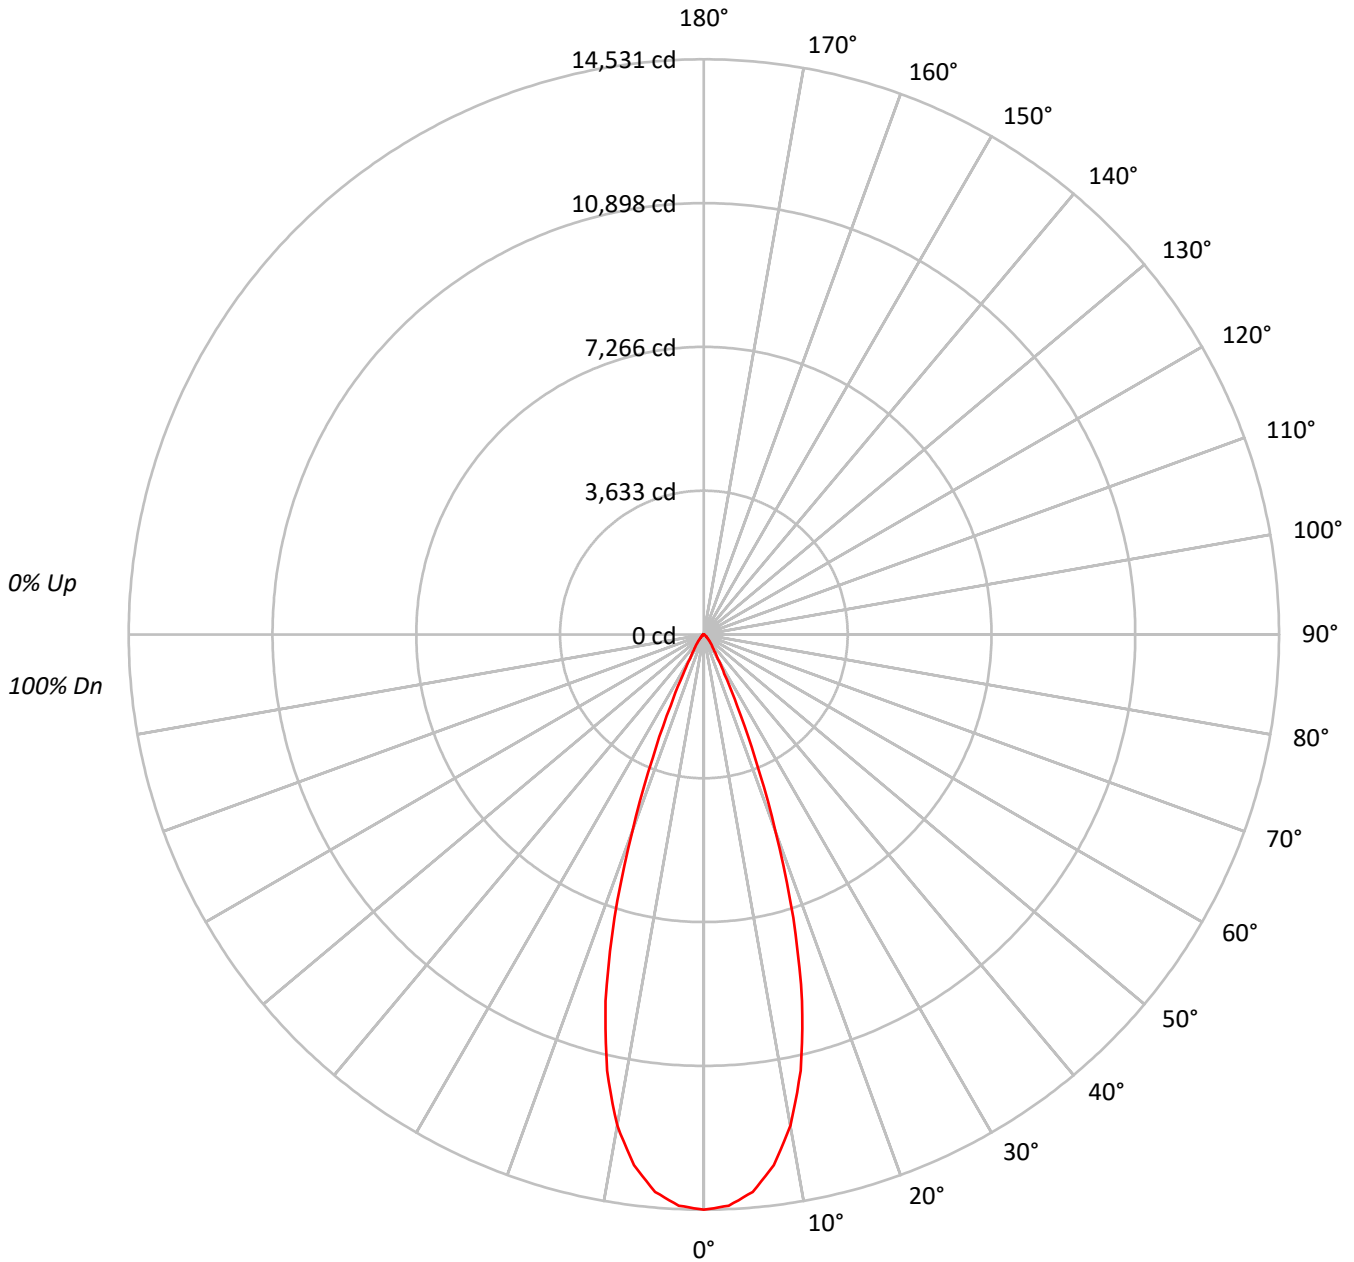



TEST NUMBER: P749986

CATALOG NUMBER: LD4D55D010-EU4DR3555659035-4LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1587690
5°	1550388
10°	1397313
15°	1084536
20°	615130
25°	239316
30°	89286
35°	48938
40°	31992
45°	19469
50°	12392
55°	8763
60°	6403
65°	3490
70°	256
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 19469 cd/sqm



TEST NUMBER: P749986

CATALOG NUMBER: LD4D55D010-EU4DR3555659035-4LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1300.1	24.6
10°-20°	2538.3	48.1
20°-30°	1035.2	19.6
30°-40°	247.7	4.7
40°-50°	103.3	2.0
50°-60°	42.7	0.8
60°-70°	13.4	0.3
70°-80°	0.3	0.0
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4873.6	92.3
0°-40°	5121.4	97.0
0°-60°	5267.3	99.7
0°-90°	5281.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5281.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	14531	
5°	14136	###
15°	9588	2538
25°	1985	1035
35°	367	248
45°	126	103
55°	46	43
65°	14	13
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P749986

CATALOG NUMBER: LD4D55D010-EU4DR3555659035-4LBDP1H

CANDELA DISTRIBUTION (FULL):

0°	
0°	14531.2
2.5°	14444.1
5°	14135.8
7.5°	13520.8
10°	12594.5
12.5°	11290.1
15°	9587.9
17.5°	7506.1
20°	5290.4
22.5°	3373.5
25°	1985.1
27.5°	1122.1
30°	707.7
32.5°	496.9
35°	366.9
37.5°	283.7
40°	224.3
42.5°	172.8
45°	126.0
47.5°	94.3
50°	72.9
52.5°	57.8
55°	46.0
57.5°	37.2
60°	29.3
62.5°	21.4
65°	13.5
67.5°	4.8
70°	0.8
72.5°	0.8
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.8
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)